NOTES:

1. FOR DUCT WALL PENETRATIONS SEE 2337-810
2. FOR VAV TERMINAL UNITS SEE 2336-441
3. PROVIDE SOUND ATTENUATION DUCT LINER IN SUPPLY AND RETURN DUCTWORK FROM AHU-24101 TO GRID LINE C.
4. PROVIDE SOUND ATTENUATION DUCT LINER IN 12"X12" TRANSFER AIR DUCTWORK FROM HALL INTO RESTROOMS.
5. IF DUCTWORK INTERFERES WITH INSTALLATION OF LIGHTING FIXTURES REROUTE DUCTWORK.
6. CEILING DIFFUSERS (CD): TITUS, MODEL TDCA-AA, OR EQUAL.
7. SUPPLY GRILLES (SG): TITUS, MODEL 272FS, OR EQUAL.
8. RETURN GRILLES (RG): TITUS, MODEL 350FL, OR EQUAL.

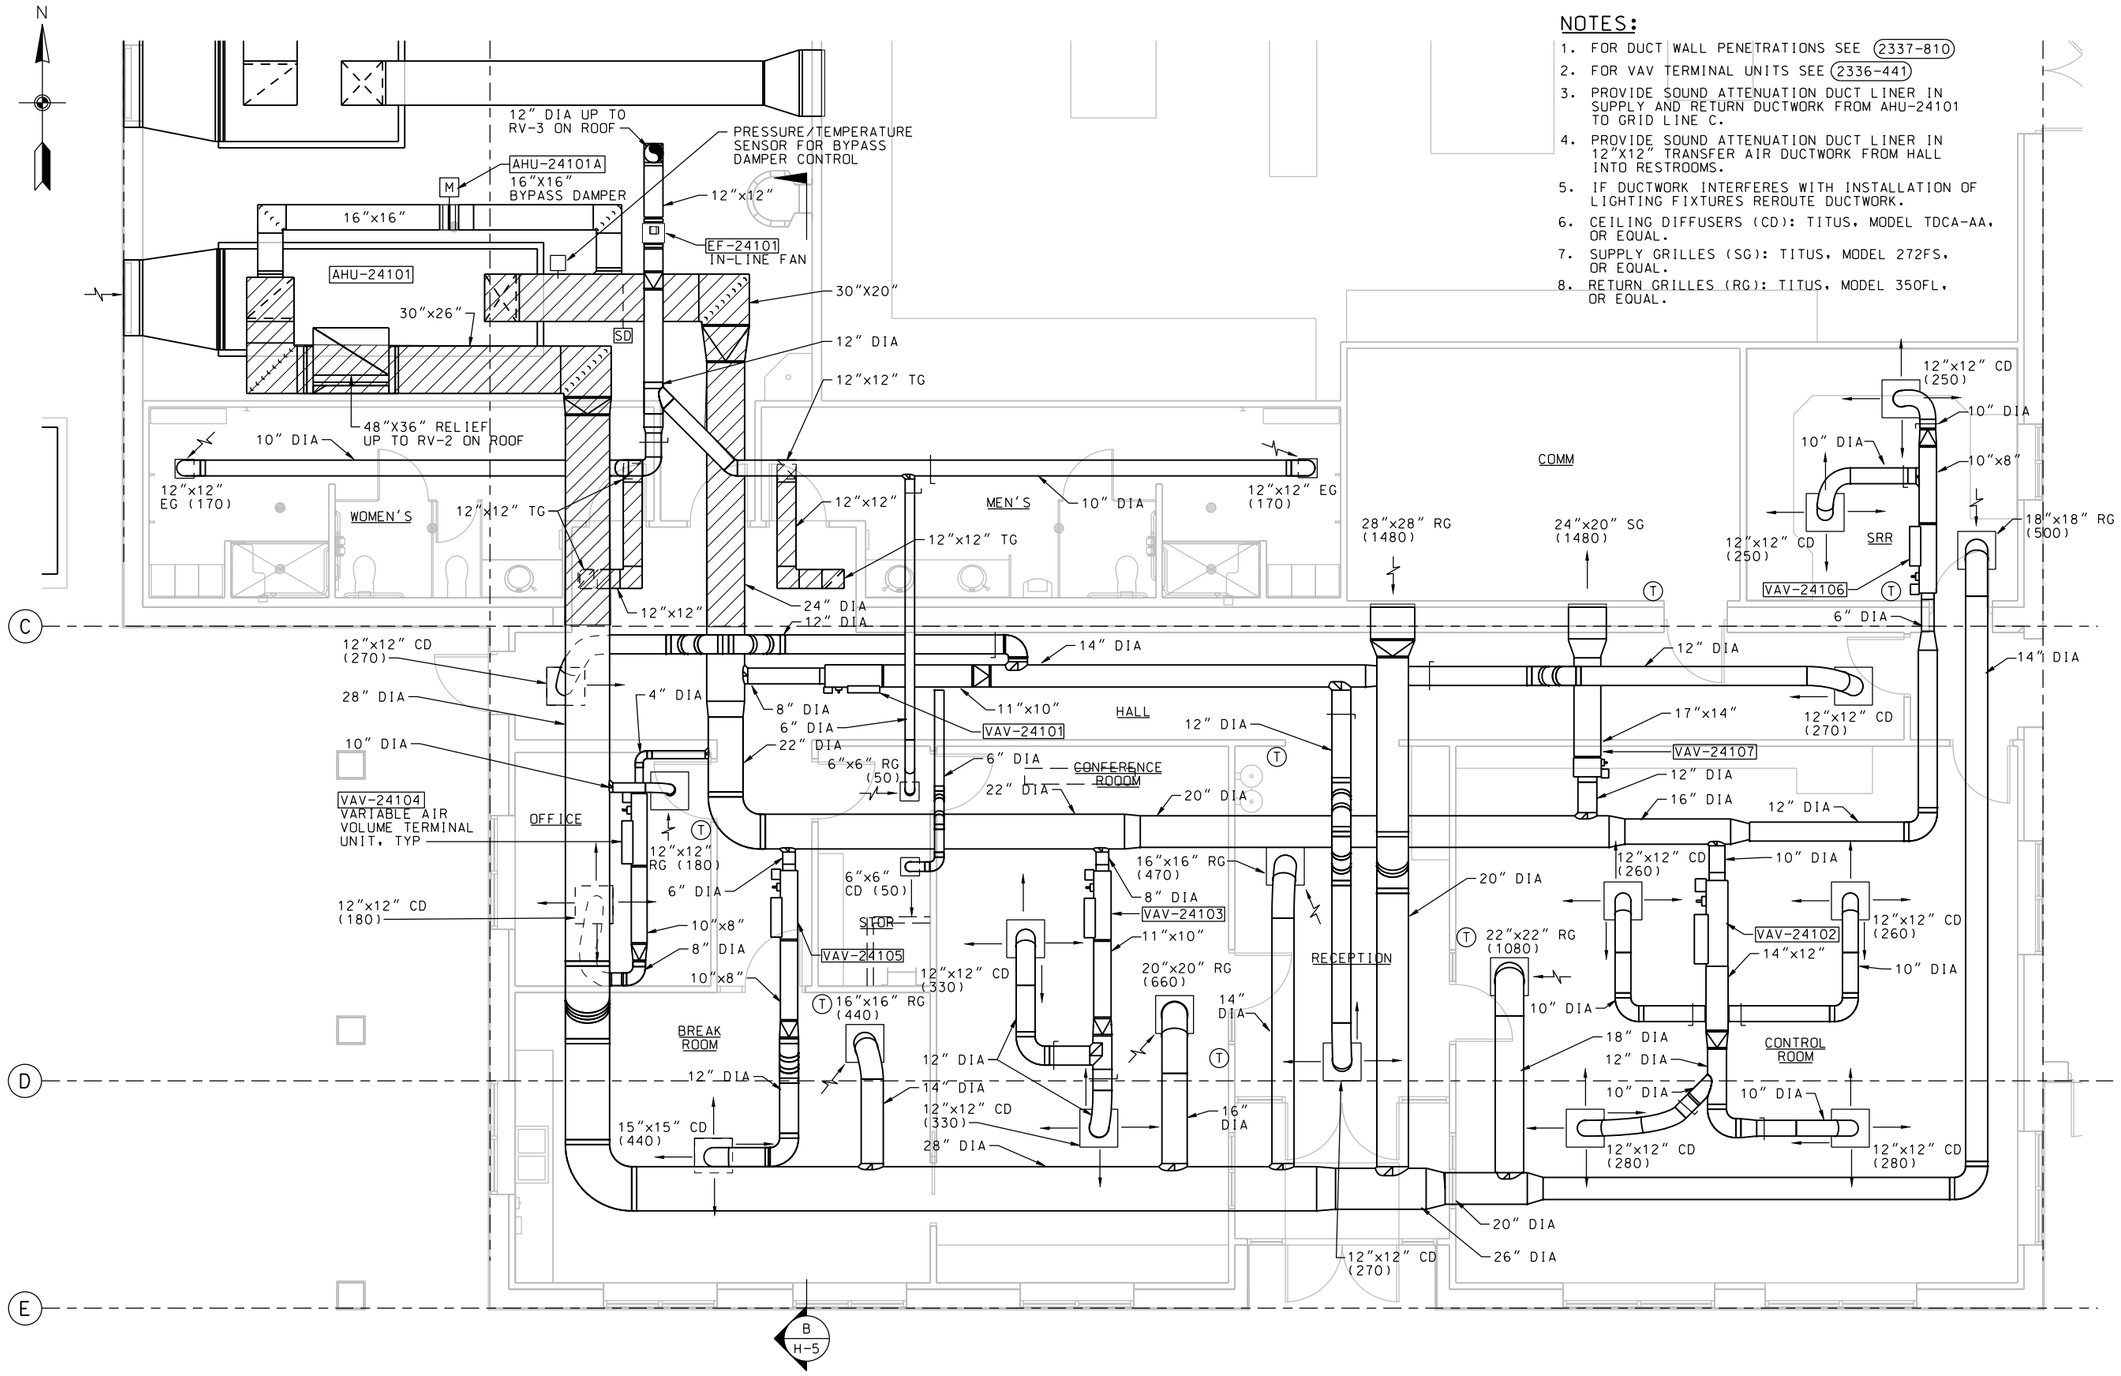

ADMIN AREA ENLARGED PLAN (1)
1/4"=1'-0" H-1

SYMBOL	DESCRIPTIONS	DATE	APPROVAL

REVISIONS

EASTERN MUNICIPAL WATER DISTRICT
PERRIS II DESALINATION FACILITY
PERRIS, CALIFORNIA

ADMIN AREA ENLARGED FLOOR PLAN

U.S. ARMY ENGINEER DISTRICT
LOS ANGELES
CORPS OF ENGINEERS

DESIGNED BY: K WELP
DRAWN BY: S HOSTETLER
CHECKED BY: B GIFFORD

CH2MHILL

SUBMITTED BY: ART JUNG, P.E. CHIEF, DESIGN BRANCH

CADD FILE NAME: PDFm114d.dgn

SPEC. NO.: NOT APPLICABLE

L.A. DISTRICT FILE NO. XXX-XXXX

REGISTERED PROFESSIONAL ENGINEER CARMEN G. GUAN No. 38654 Exp. 6-30-10 MECHANICAL STATE OF CALIFORNIA

DATE: 10/05/09

H-4

SHEET 131 OF 226 SHEETS

NDM-SCO:EMWD USACE PERRIS II/ PDFm114d.dgn PLOT DATE: 2/19/2010 PLOT TIME: 11:04:27 AM