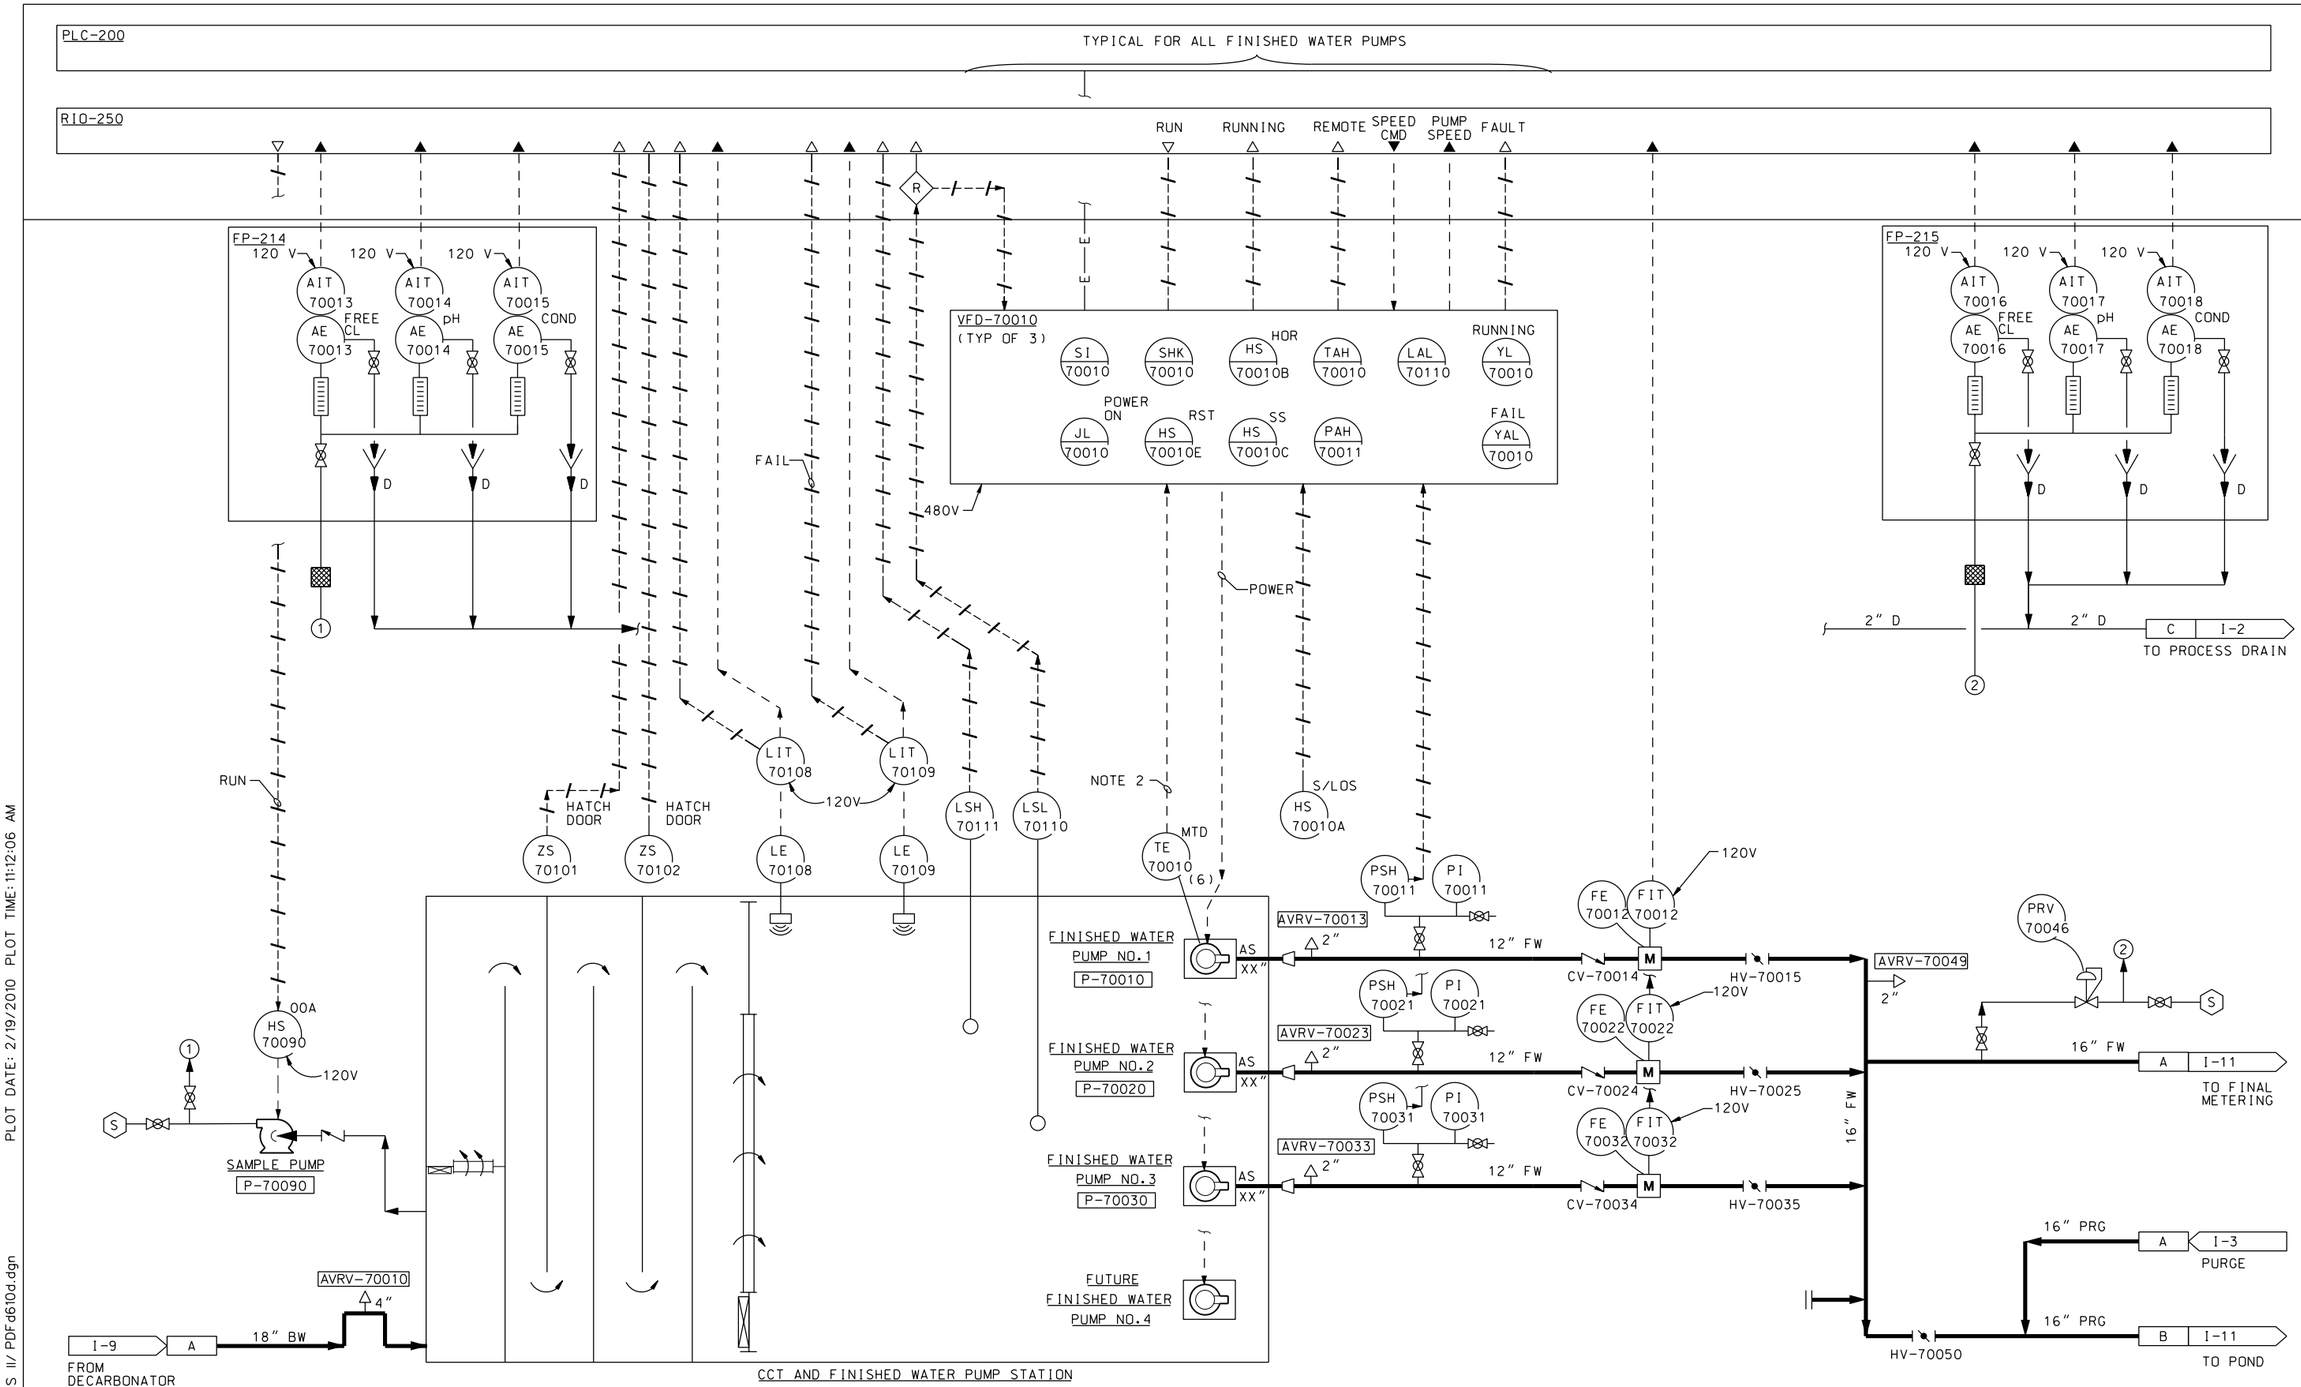

NOTE:

1. ALL TAG NUMBERS SHALL BE PRECEDED BY "D0010" FOR THE FACILITY NUMBER.
2. MOTOR TEMPERATURE ELEMENTS REQUIRED. ALL RTD TYPE.

REGISTERED PROFESSIONAL ENGINEER
LARRY NORDAL
No. 12566
EXP: 9-30-11
ELECTRICAL
STATE OF CALIFORNIA
DATE: 10/05/09

SYMBOL	DESCRIPTIONS	DATE	APPROVAL

REVISIONS

EASTERN MUNICIPAL WATER DISTRICT
PERRIS II DESALINATION FACILITY
PERRIS, CALIFORNIA

CLEARWELL AND FINISHED WATER PUMP STATION

DESIGNED BY: J NORDAL
DRAWN BY: J LORING
CHECKED BY: W PEARSON

U.S. ARMY ENGINEER DISTRICT
LOS ANGELES
CORPS OF ENGINEERS

CH2MHILL

SUBMITTED BY:
ART JUNG, P.E.
CHIEF, DESIGN BRANCH

CADD FILE NAME: PDFd610d.dgn
SPEC. NO.: NOT APPLICABLE
L.A. DISTRICT FILE NO. XXX-XXXX

I-10

SHEET 199 OF 226 SHEETS

PLOT DATE: 2/19/2010 PLOT TIME: 11:12:06 AM

NDM-SCO:EMWD USACE PERRIS II/ PDFd610d.dgn