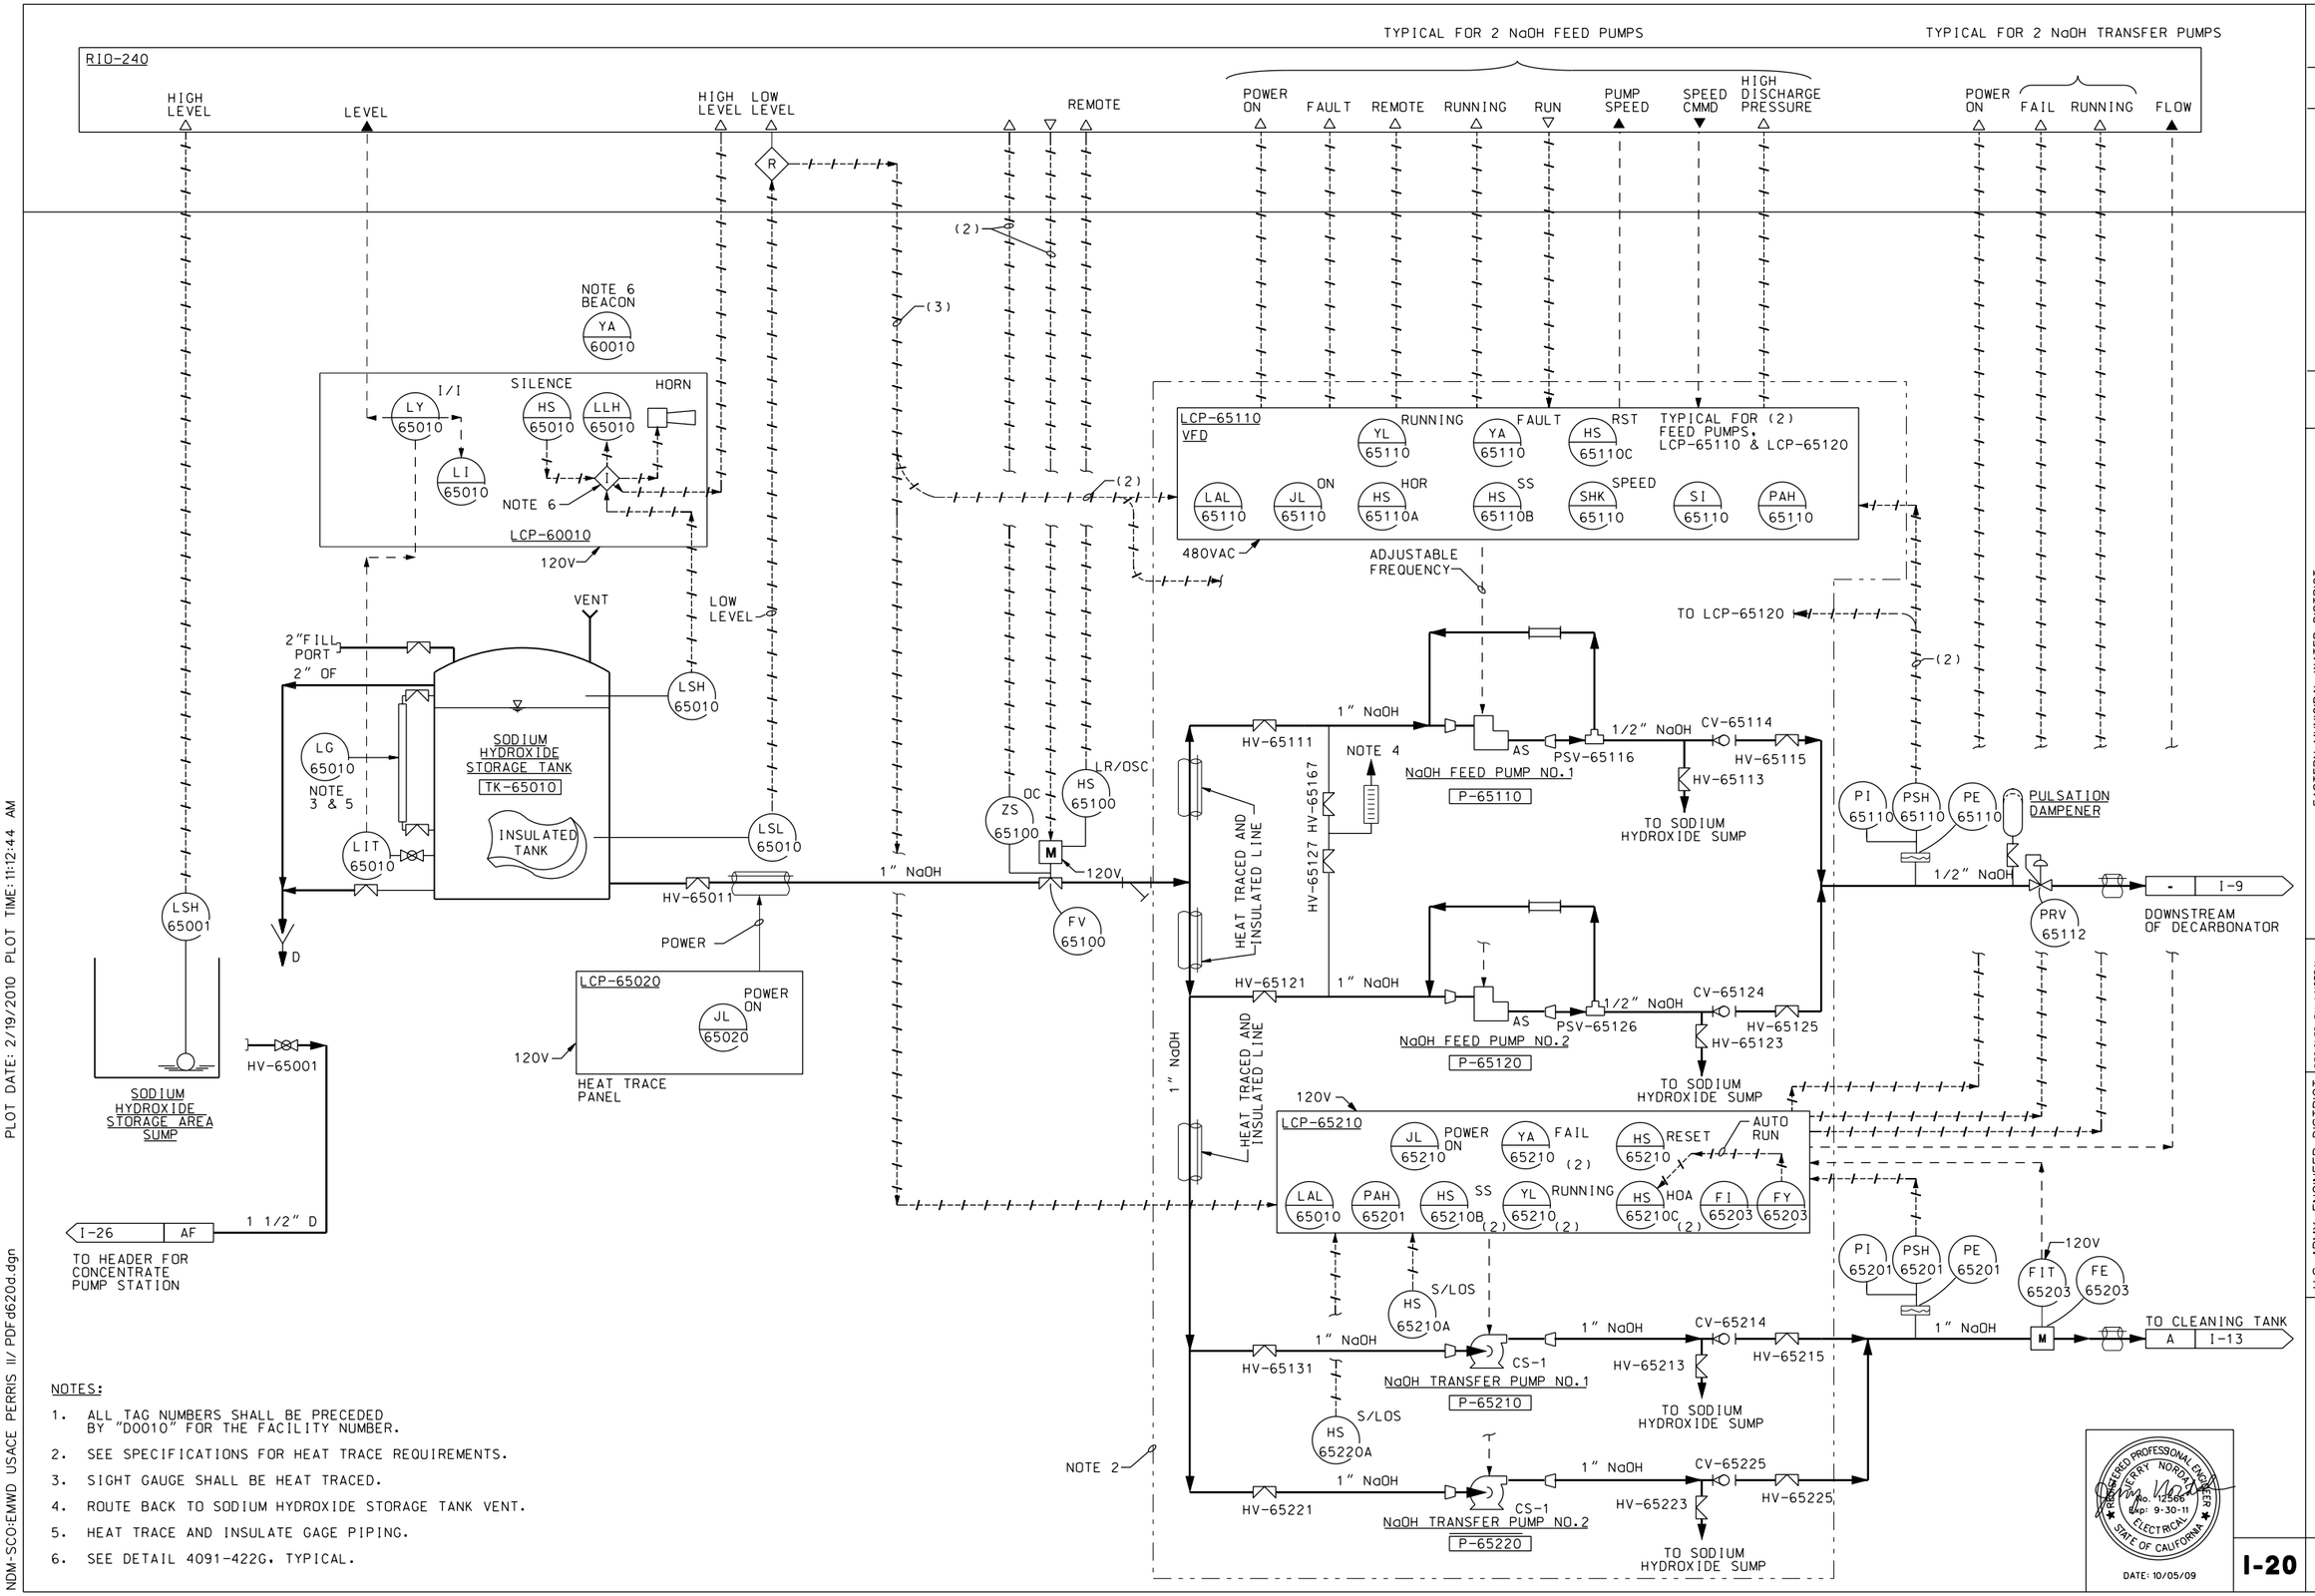

NOTES:

1. ALL TAG NUMBERS SHALL BE PRECEDED BY "D0010" FOR THE FACILITY NUMBER.
2. SEE SPECIFICATIONS FOR HEAT TRACE REQUIREMENTS.
3. SIGHT GAUGE SHALL BE HEAT TRACED.
4. ROUTE BACK TO SODIUM HYDROXIDE STORAGE TANK VENT.
5. HEAT TRACE AND INSULATE GAGE PIPING.
6. SEE DETAIL 4091-422G, TYPICAL.

SYMBOL	DESCRIPTIONS	DATE	APPROVAL

REVISIONS

EASTERN MUNICIPAL WATER DISTRICT
PERRIS II DESALINATION FACILITY
PERRIS, CALIFORNIA

SODIUM HYDROXIDE STORAGE AND FEED SYSTEM

DESIGNED BY: J NORDAL
DRAWN BY: J LORING
CHECKED BY: W PEARSON

U.S. ARMY ENGINEER DISTRICT
LOS ANGELES
CORPS OF ENGINEERS

CH2MHILL

SUBMITTED BY: ART JUNG, P.E.
CHIEF, DESIGN BRANCH

CADD FILE NAME: PDF d620d.dgn
SPEC. NO.: NOT APPLICABLE
L.A. DISTRICT FILE NO. XXX-XXXX

SHEET I-20
209 OF 226 SHEETS

PLOT DATE: 2/19/2010 PLOT TIME: 11:12:44 AM
NDM-SCO:EMWD USACE PERRIS II/ PDF d620d.dgn