


PROVIDE A PVC SLEEVE AND
FILL WITH A SUITABLE PLASTIC
EXPANDABLE COMPOUND WHERE
CONDUIT PASSES THROUGH SLAB

CONDUIT. FOR TYPE
REQUIRED, SEE
SPECIFICATIONS

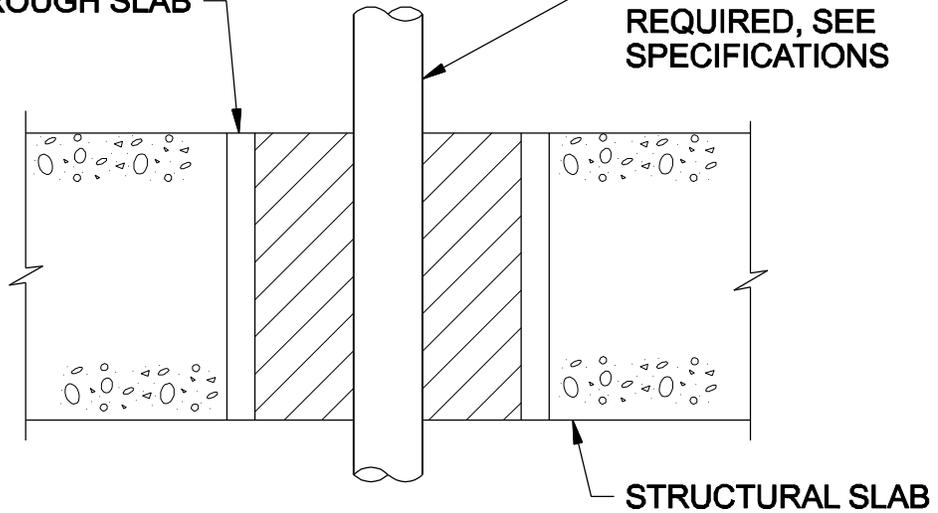

NOTE:

ALL CONDUITS THROUGH CONCRETE FLOOR SLABS AND
EQUIPMENT PADS SHALL BE INSTALLED IN ACCORDANCE
WITH THIS DETAIL.

SLAB PENETRATION

NTS

© CH2M HILL

2605-310