


CONDUIT RISER TO DEVICE, JUNCTION BOX OR CONTROL PANEL AT CHEMICAL TANK AS REQUIRED. CONDUIT SHALL BE SUPPORTED WITHIN 24 INCHES OF EXITING THE CONCRETE

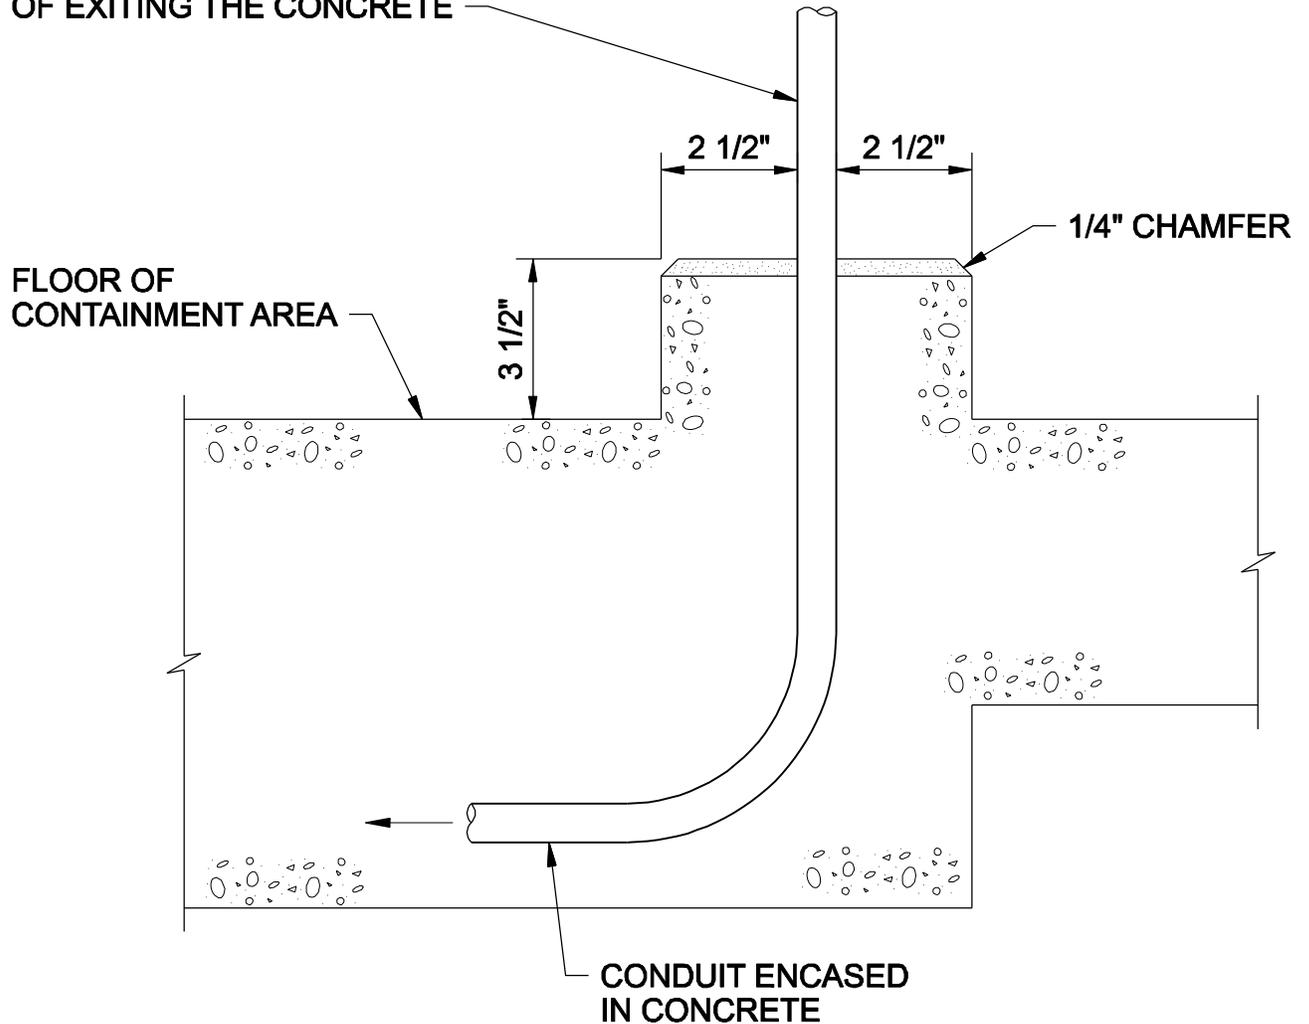

NOTE:

CONDUIT INSTALLED INSIDE OF A CONTAINMENT AREA SHALL BE INSTALLED IN ACCORDANCE WITH THIS DETAIL. FOR TYPE OF CONDUIT TO BE INSTALLED, SEE SPECIFICATION.

CONDUIT TERMINATION IN CONTAINMENT AREA

NTS

© CH2M HILL

2605-313