


DOUBLE MAT REINFORCEMENT

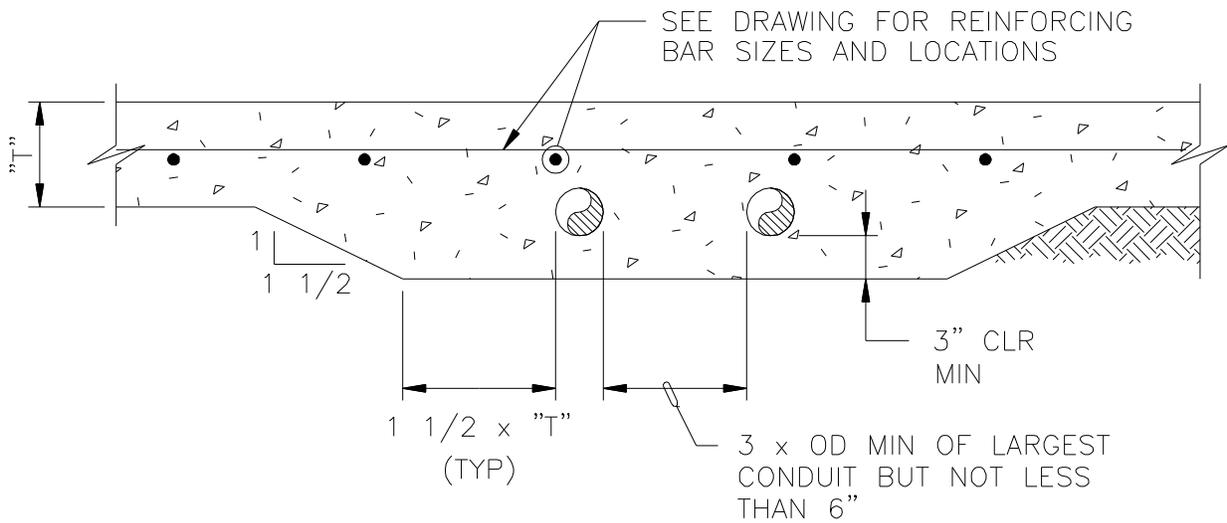

SINGLE MAT REINFORCEMENT

NOTES:

1. OD = OUTSIDE DIAMETER OF CONDUIT.
2. "S" = CLEAR SPACE BETWEEN REINFORCING.
3. MAX OD = SMALLER OF "T"/4 OR "S"-1/2".
4. FOR OD GREATER THAN "T"/4 OR "S"-1/2", PLACE CONDUIT UNDER SLAB AND ENCASE IN CONCRETE.
5. METAL CONDUITS SHALL BE ISOLATED WITH 3 WRAPS OF 10 MIL PVC TAPE AT THE POINT OF CONTACT WITH REINFORCING.

CONDUITS EMBEDDED IN CONCRETE SLAB ON GRADE

NTS

© CH2M HILL