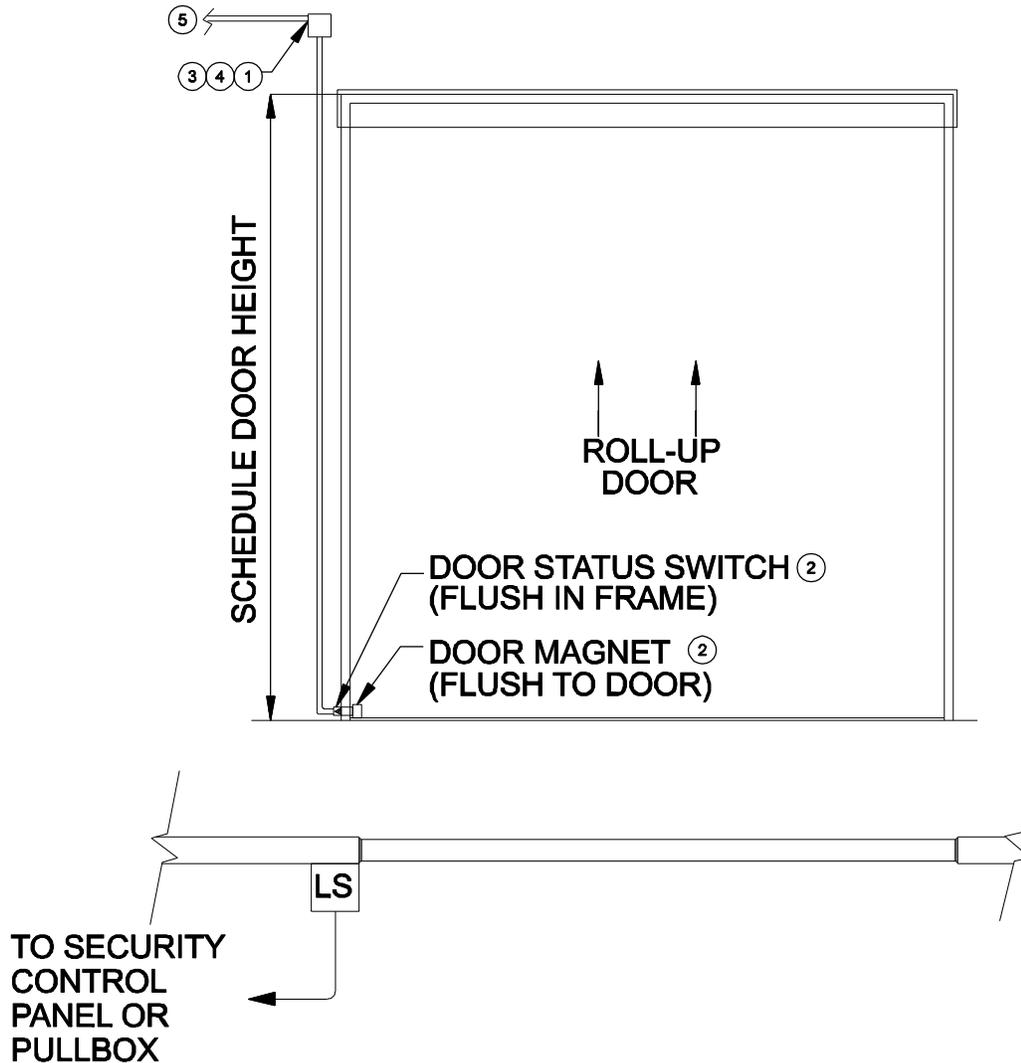


**NOTES:**

1. 4" X 4" SQUARE BOX.
2. SECURITY DEVICES PROVIDED BY SECURITY CONTRACTOR, TO BE INSTALLED BY ELECTRICAL CONTRACTOR. TYPE: MAGNETIC (SHOWN) OR LIMIT SWITCH.
3. CONDUIT AND FITTINGS BY ELECTRICAL CONTRACTOR.
4. LOCATED ON SECURE SIDE OF DOOR.
5. [CE-1] HOME RUN TO SCP, OR PULLBOX.

**FUNCTIONALITY:**

IN THE NORMAL STATE THE DOOR IS CLOSED, LOCKED ON THE OUTSIDE AND UNLOCKED ON THE INSIDE. IF THE DOOR IS OPENED, THE ALARM CONDITION IS MONITORED AT THE SECURITY CONTROL PANEL.

**ROLLUP DOOR SWITCH**

NTS

EASTERN MUNICIPAL WATER DISTRICT  
PERRIS II DESALINATION FACILITY

2605-811