


CONNECT TO
SAMPLE TAP

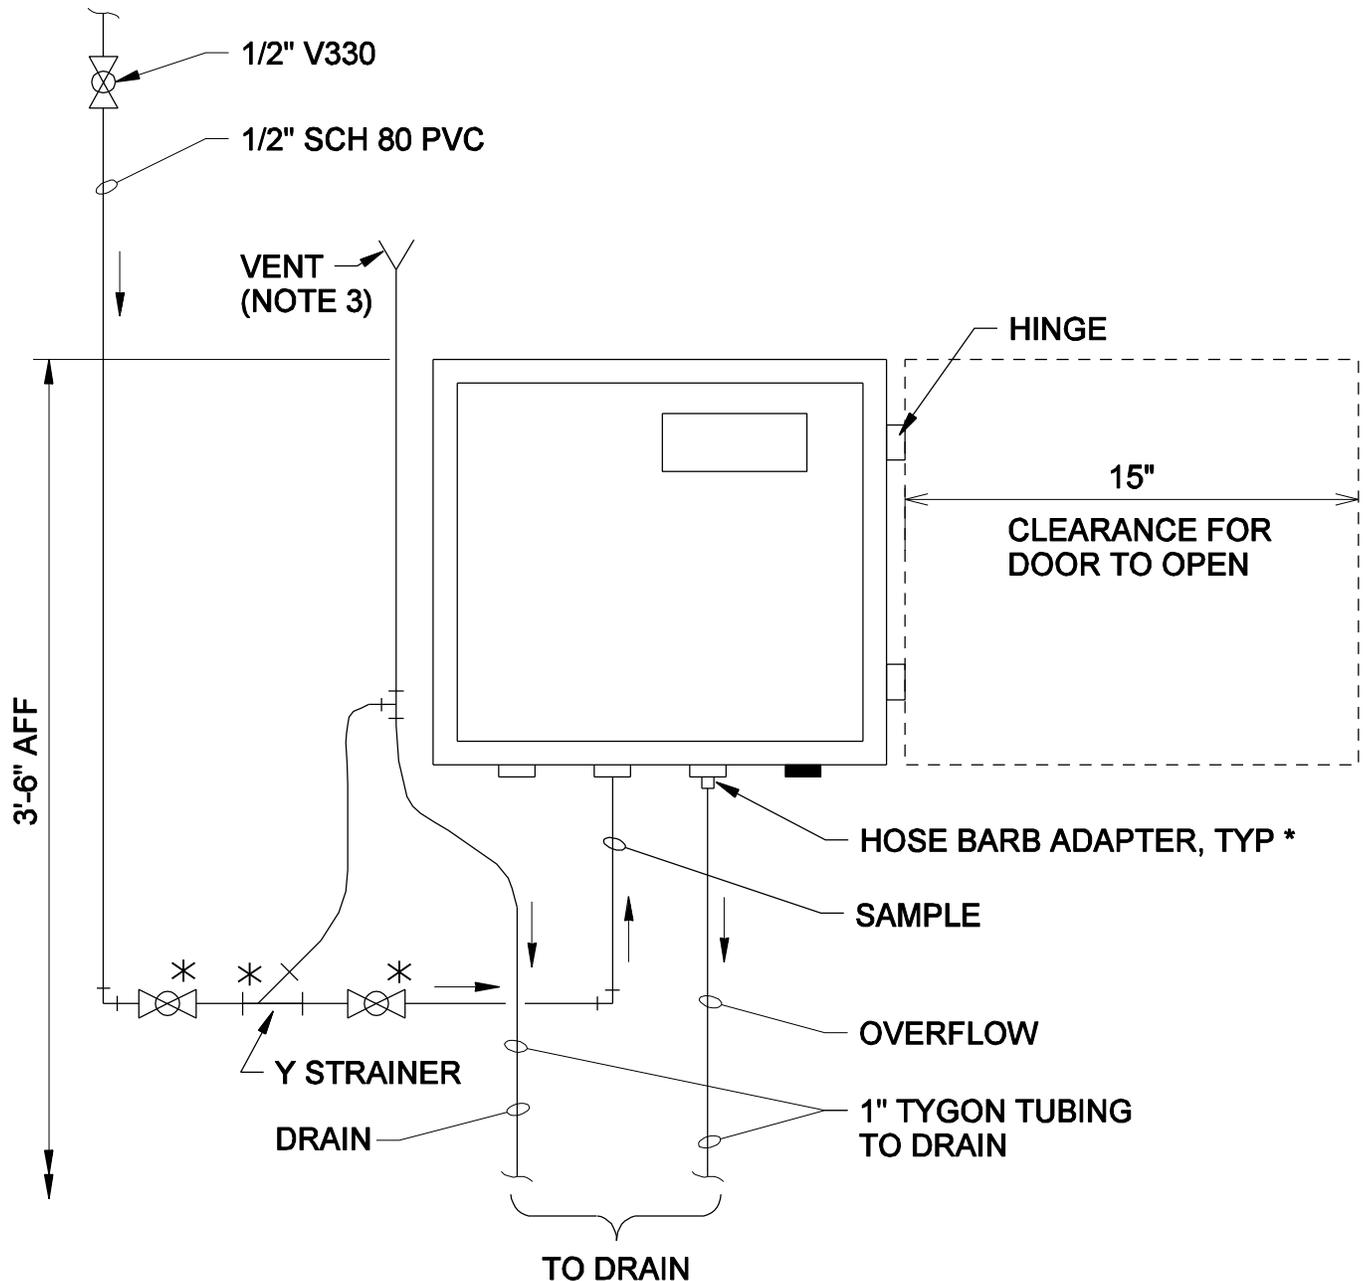

NOTES:

1. SECURE INSTRUMENTS TO PANEL WITH 1/4" FRP BOLTS.
2. COMPONENTS DESIGNATED BY * ARE SUPPLIED BY INSTRUMENT MANUFACTURER.
3. SET VENT ELEVATION TO PREVENT OVERFLOW

FREE / TOTAL RESIDUAL CHLORINE ANALYZER

NTS

EASTERN MUNICIPAL WATER DISTRICT
PERRIS II DESALINATION FACILITY

4091-172AG