




PROFILE SCALE
 VERT: 1 in = 4 ft.
 HORZ: 1 in = 40 ft.

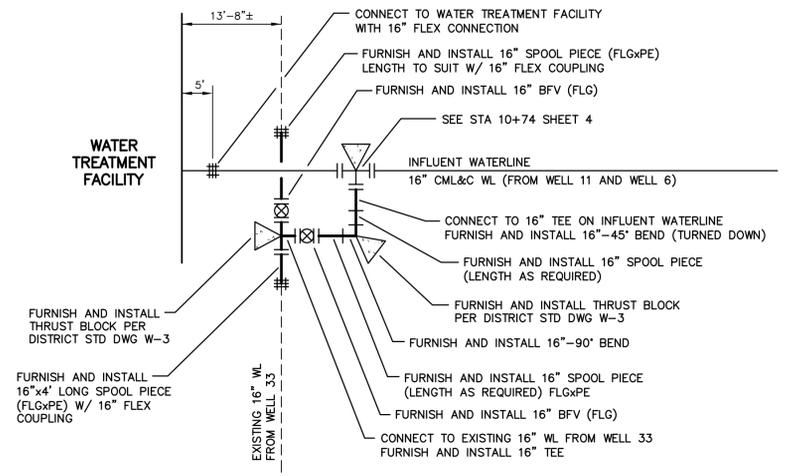


DETAIL 'A'
WELL 33 CONNECTION TO
WATER TREATMENT FACILITY - INFLUENT PIPELINE
 SCALE: NTS

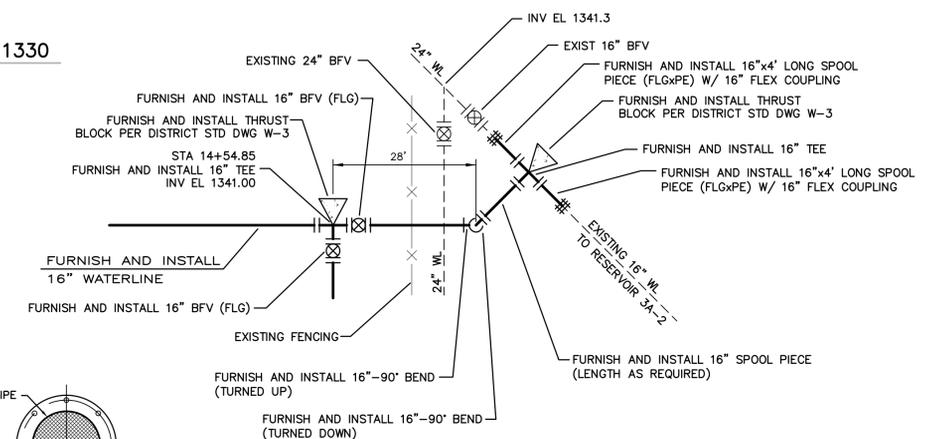

DETAIL 'B'
CONNECTION TO RESERVOIR R3A-2
 SCALE: NTS

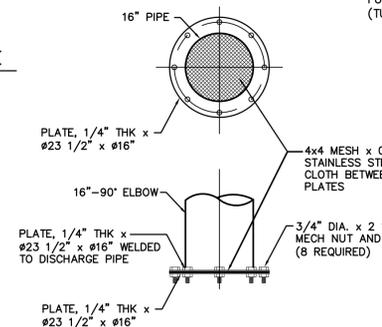


DISCHARGE SCREEN DETAIL
 SCALE: NTS

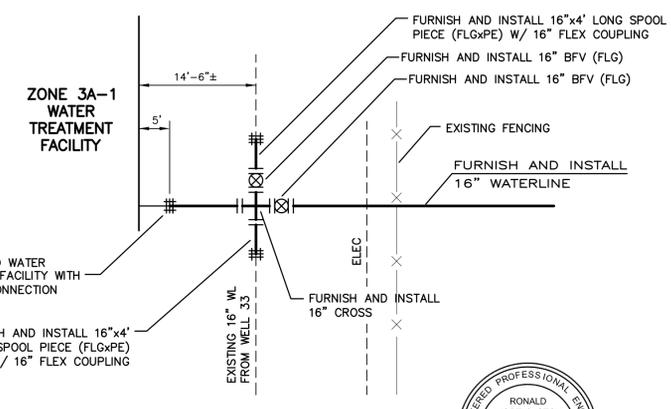

DETAIL 'C'
CONNECTION AT STA 11+63.75
 SCALE: NTS



NOTE: CONTRACTOR TO VERIFY LOCATION AND CONDITION OF EXISTING WATERLINES WHERE CONNECTIONS ARE TO BE MADE.

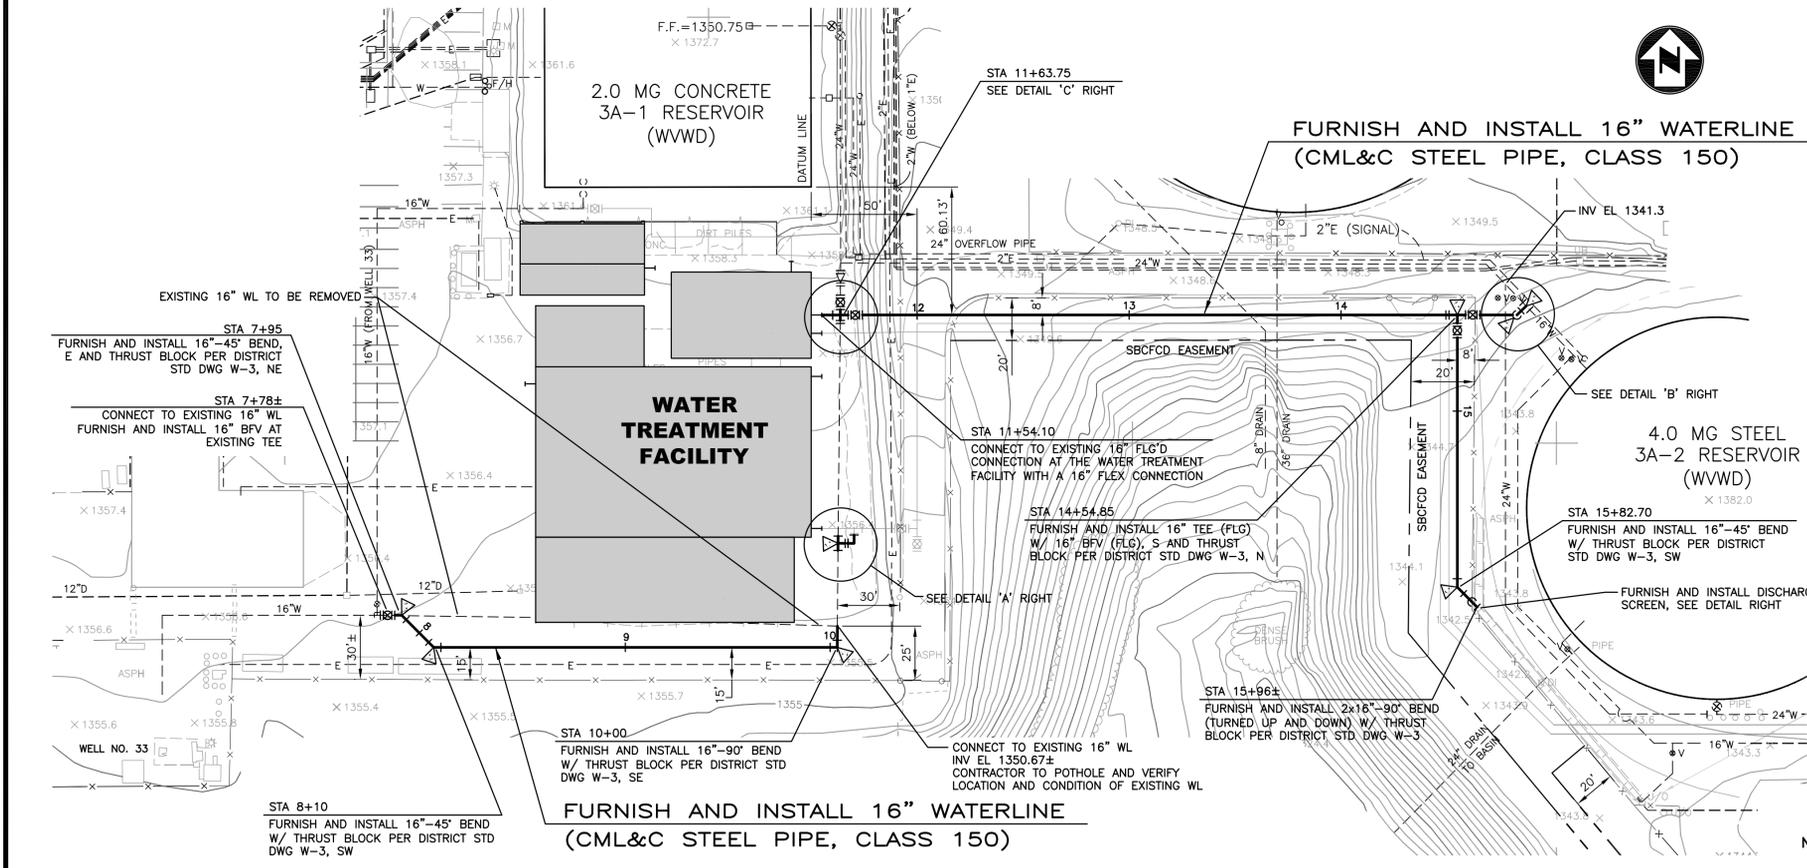

WATER TREATMENT FACILITY

4.0 MG STEEL 3A-2 RESERVOIR (WWD)

FURNISH AND INSTALL 16" WATERLINE (CML&C STEEL PIPE, CLASS 150)

CONSTRUCTION CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, CONSTRUCTION CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY, THAT THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS, AND CONSTRUCTION CONTRACTOR FURTHER AGREES TO DEFEND, INDEMNIFY AND HOLD DESIGN PROFESSIONAL HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF DESIGN PROFESSIONAL.

Underground Service Alert
 Call: TOLL FREE 1-800-227-2600
 TWO WORKING DAYS BEFORE YOU DIG

Revision	No.	By	Date	Approval

APPROVED	27395	Date
	RCE	
Designed	LSJ	Checked
		RW
Drawn	LSJ	Job No.
		62026.184
		Scale:
		AS SHOWN

ENGINEERING RESOURCES
 OF SOUTHERN CALIFORNIA, INC.
 1820 Commercial Circle
 San Bernardino, California 92408-3430
 (909) 890-1255 Fax (909) 890-0955

WEST VALLEY WATER DISTRICT / CITY OF RIALTO
WELL HEAD TREATMENT SYSTEM PROJECT
16" WATERLINES
WELL 33 BLENDING PIPELINES

SHEET 6 OF 12
 SHEETS 44-1344