


CALFED OPS GROUP Operations Briefing

May 26, 2010

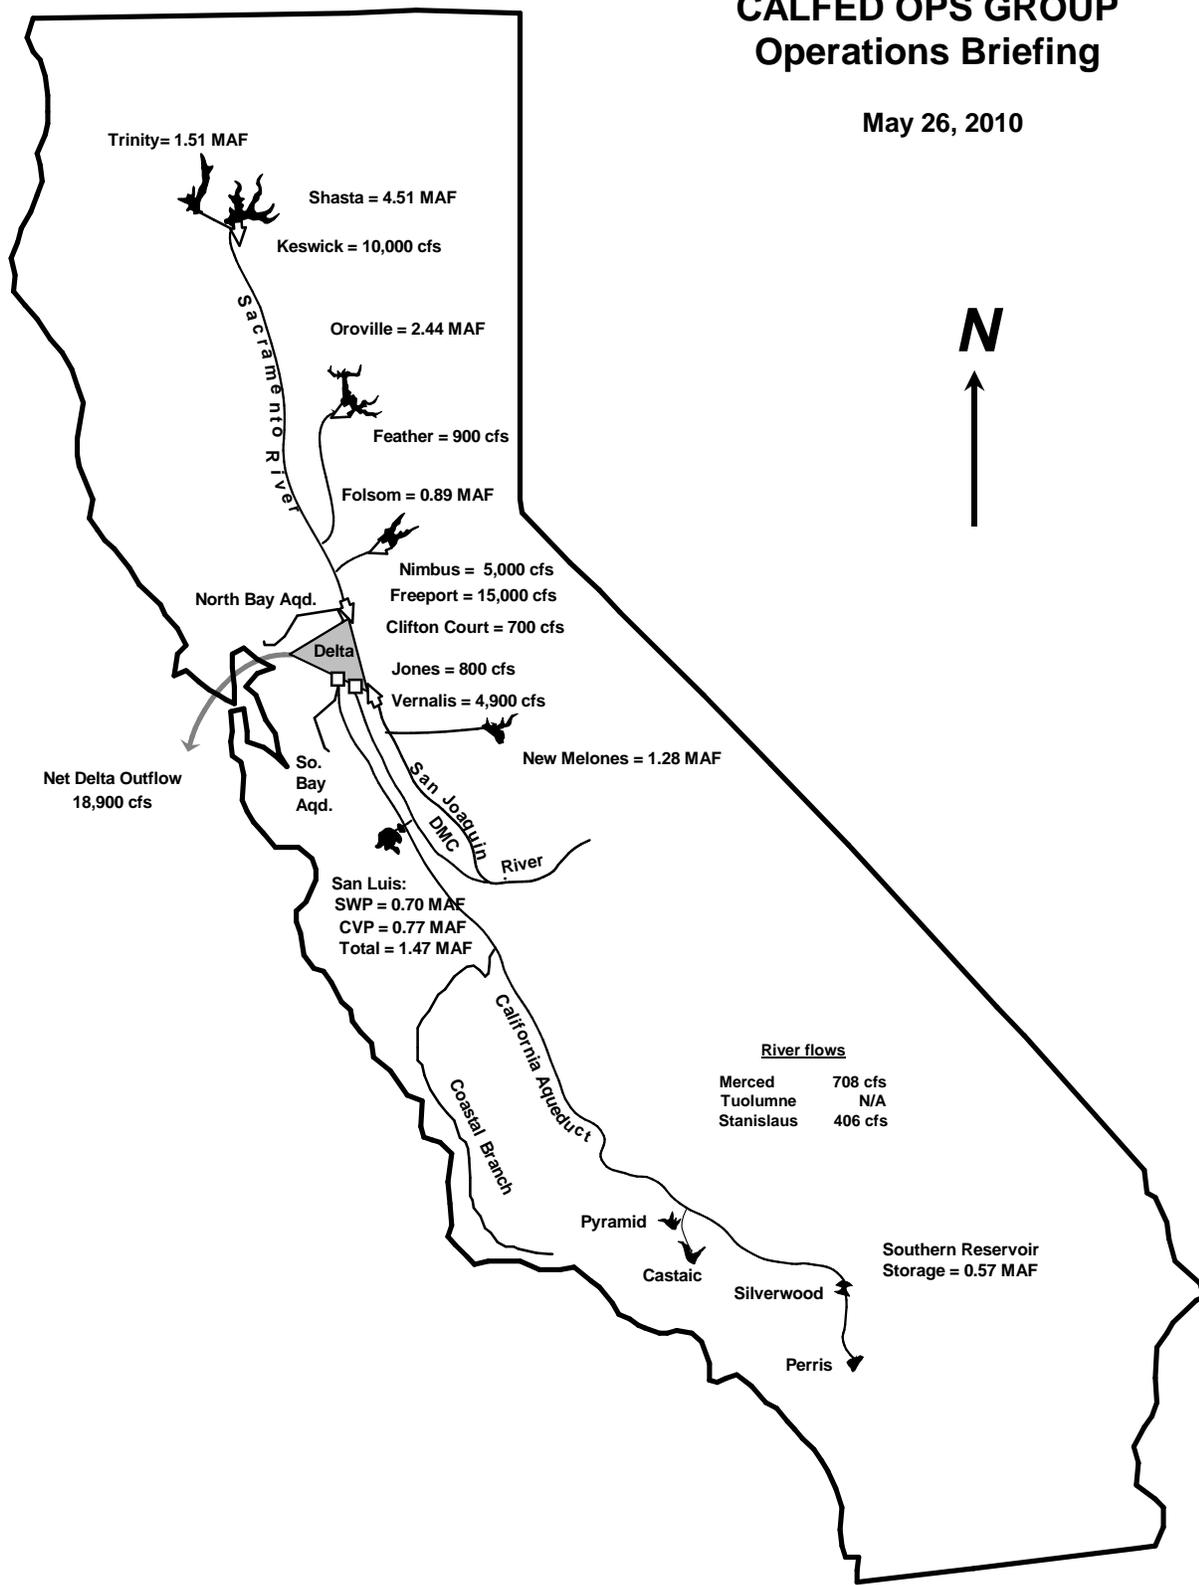



CURRENT SWP/CVP OPERATIONAL STATUS

**DATA AS OF
May 25, 2010**

Average Delta Hydrology Conditions


Average calculated from:
05/19/2010 thru 05/25/2010
 All values in cfs.

Delta Conditions: Excess
 Delta Cross
 Channel Gates: Closed
 7 Day Average % of
 Inflow Diverted: 6.85%

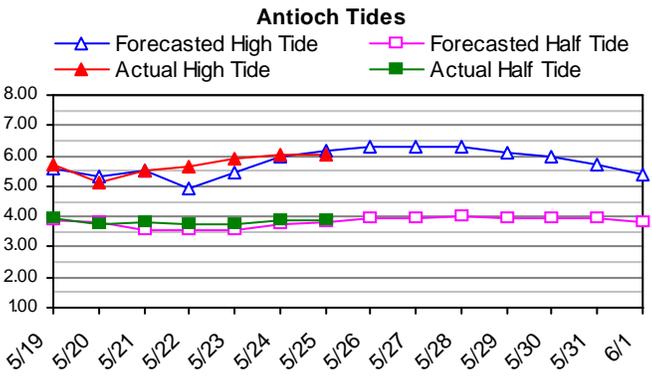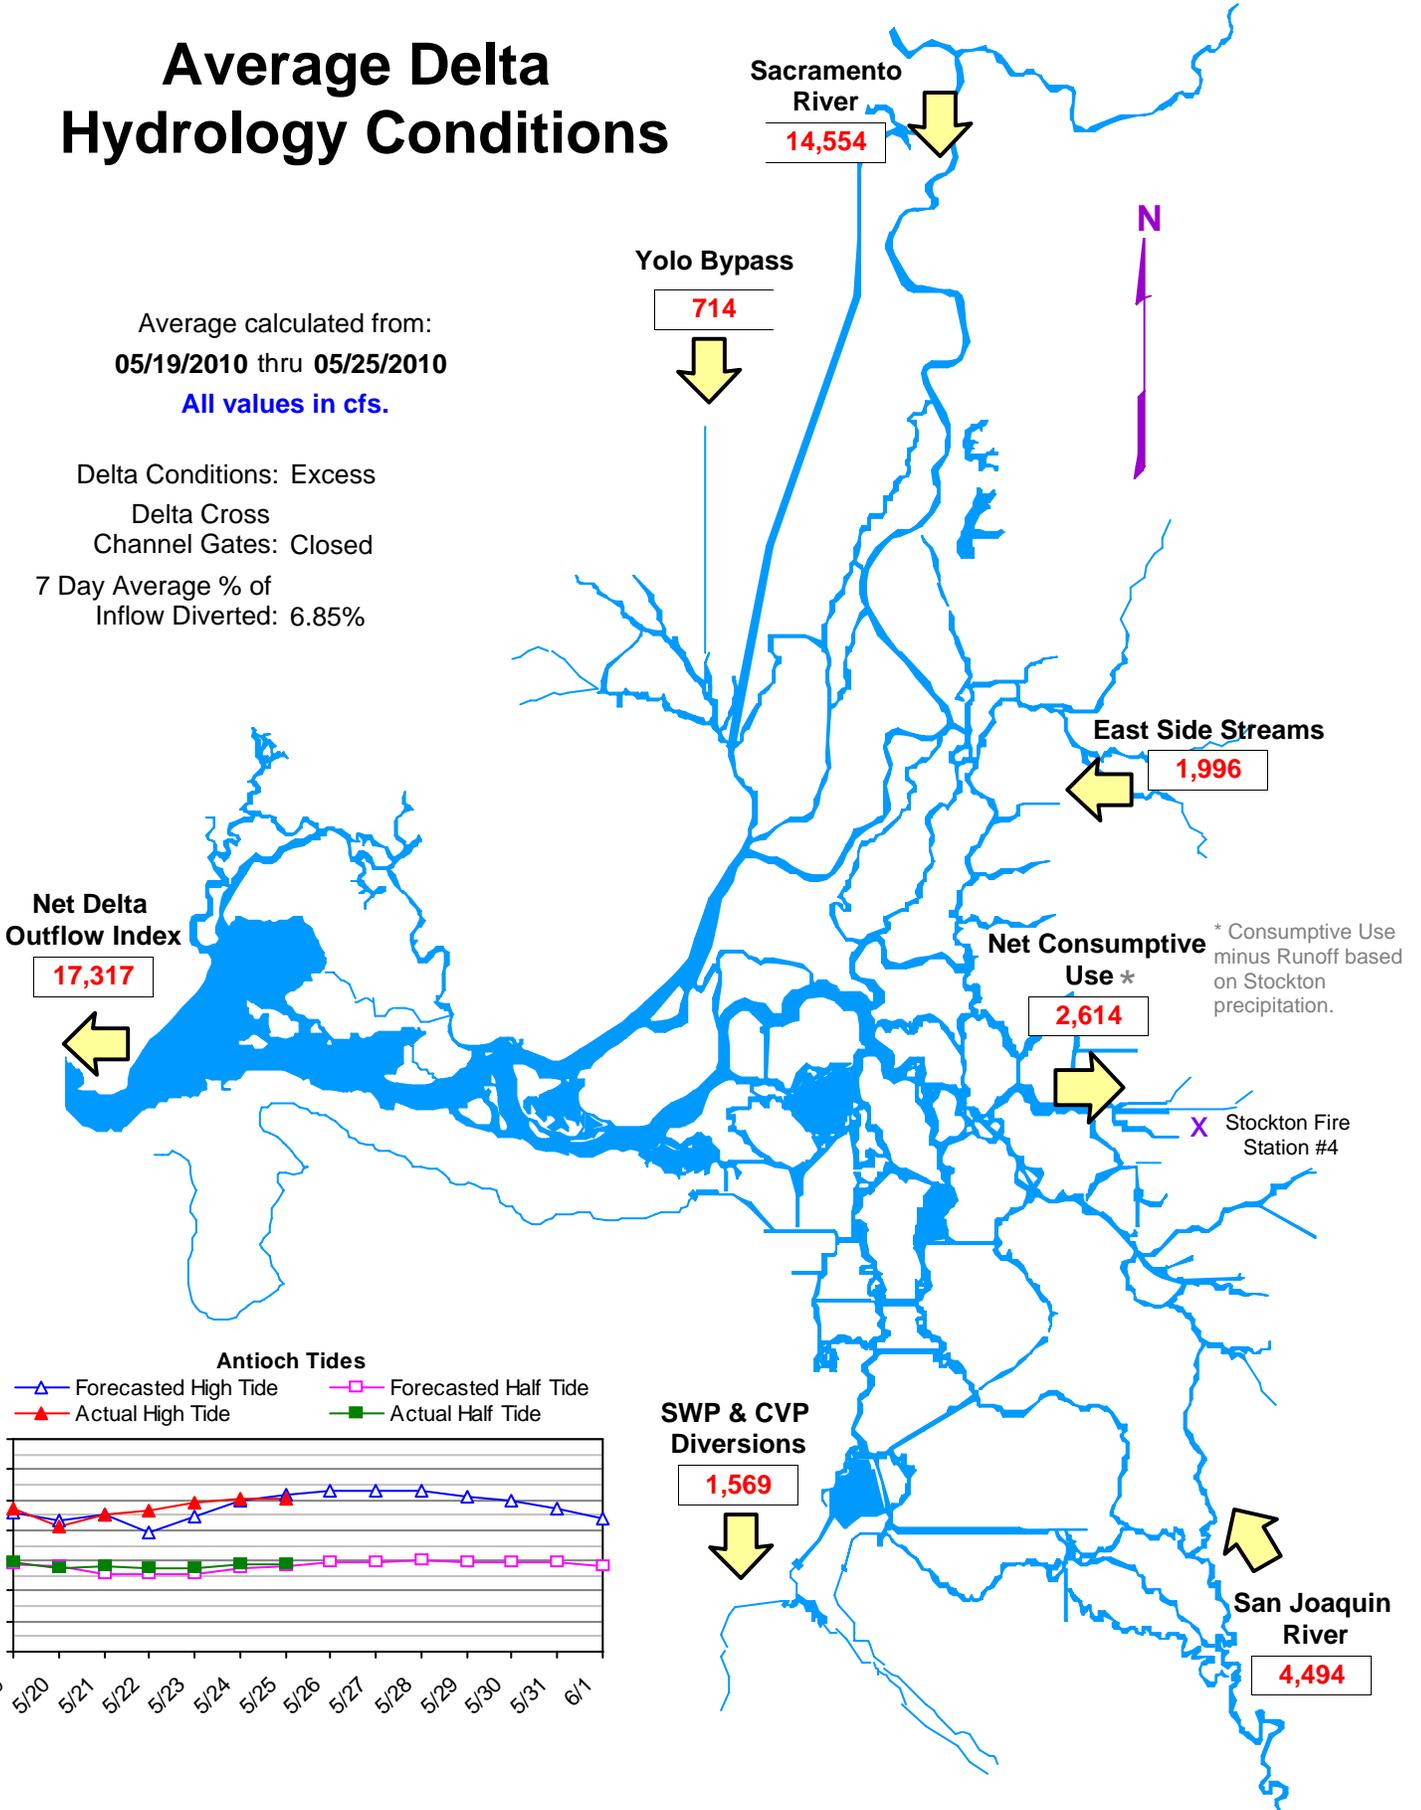

Average Delta Water Quality Conditions

Average calculated from:
05/19/2010 thru **05/25/2010**
 All values in mS/cm,
 except Contra Costa Canal.

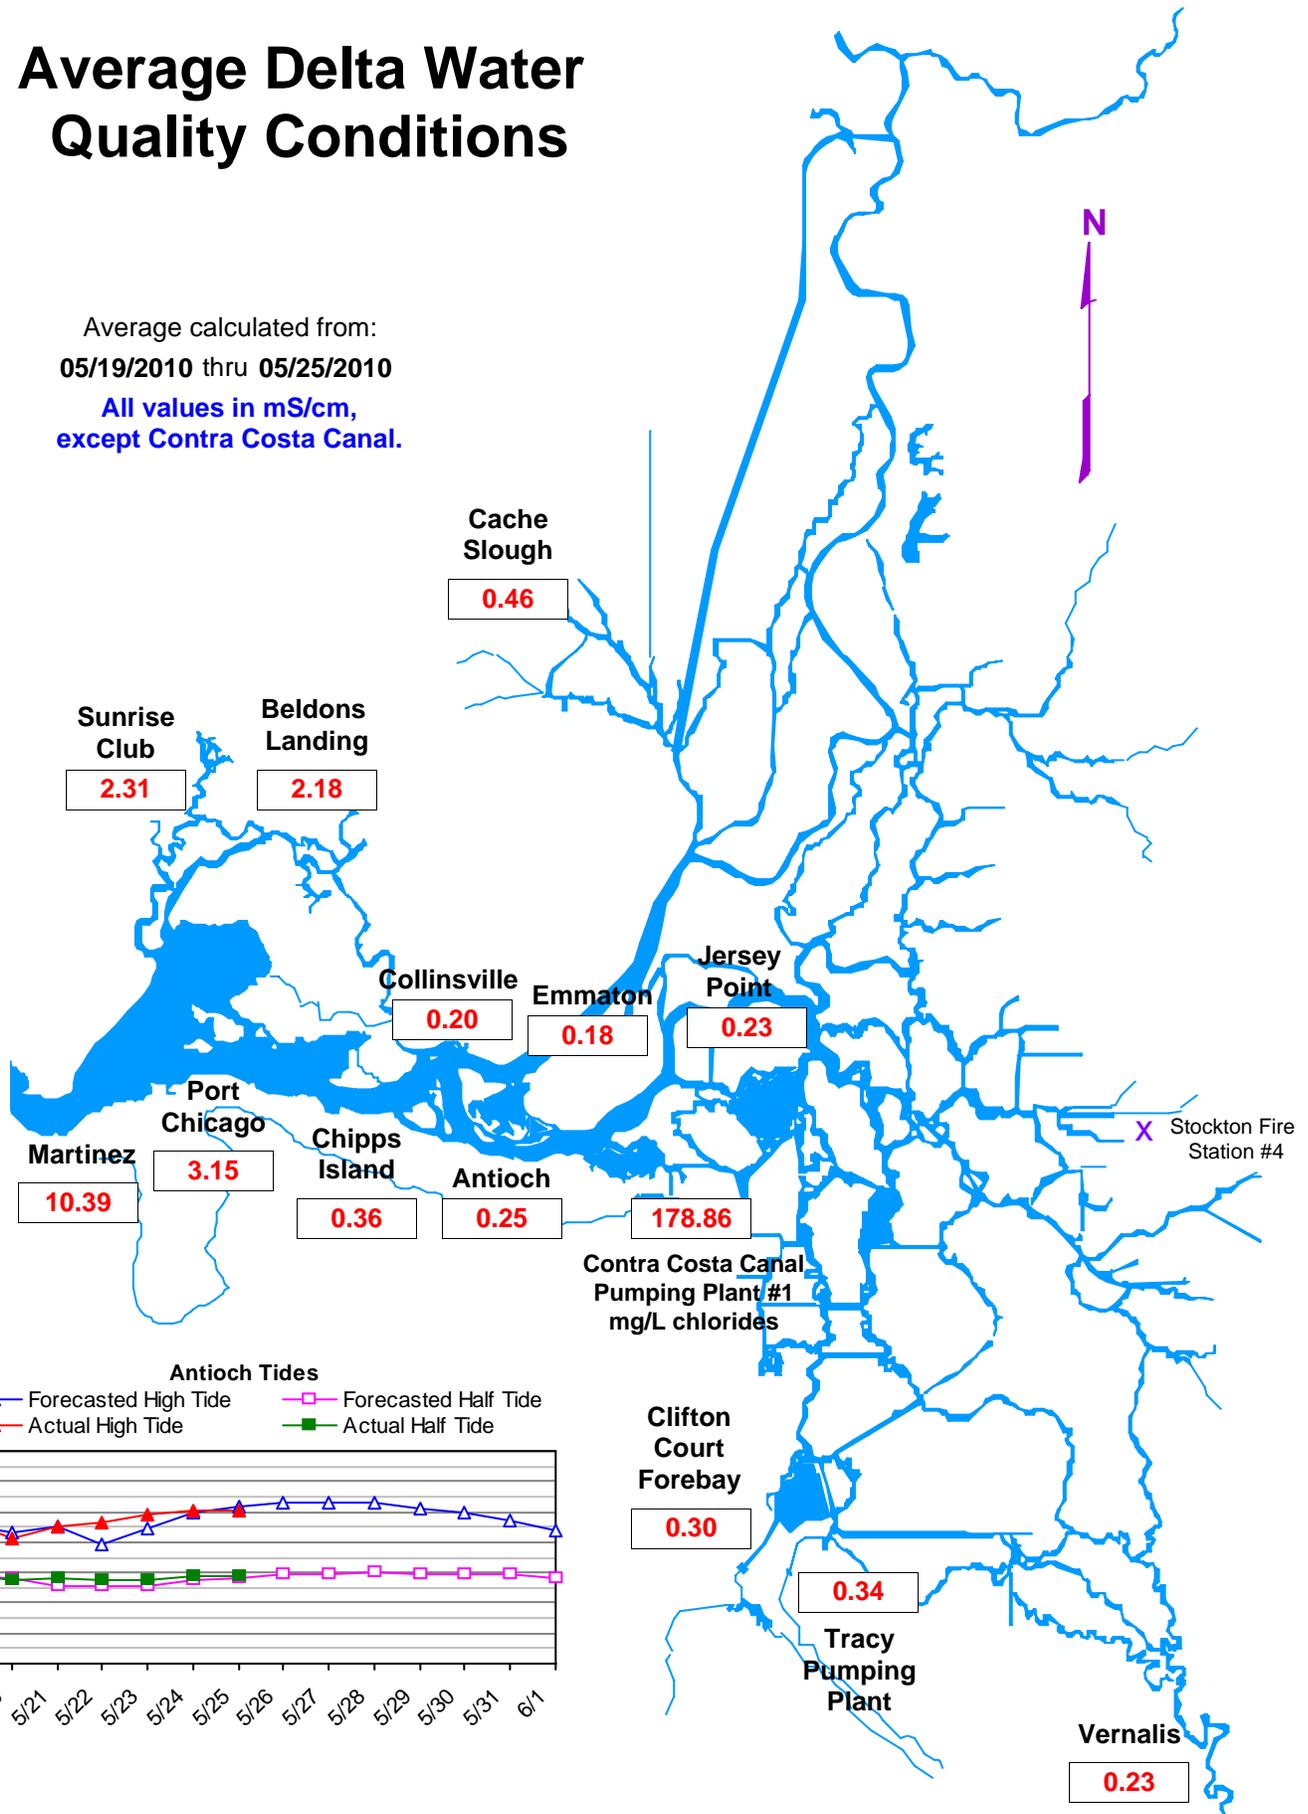

DRAFT

Bay-Delta Standards

Contained in D-1641

DRAFT


CRITERIA	May 2010	Jun 2010	Jul 2010	
FLOW/OPERATIONAL				
<ul style="list-style-type: none"> Fish and Wildlife SWP/CVP Export Limits Export/Inflow Ratio Minimum Outflow - mon. - 7 day avg. Habitat Protection Outflow, X2 River Flows: <ul style="list-style-type: none"> @ Rio Vista - min. mon. avg. - 7 day average @ Vernalis: Base -min. mon. avg. - 7 day average Pulse objective Delta Cross Channel Gates 	The greater of 1500 or 100% of 3-d avg. Vernalis flow			
	35 % of Delta Inflow		65% of Delta Inflow	
			6500 cfs	
			5200 cfs	
			7,100 - 11,400 cfs or X2 days	
	6 Days @ Port Chicago, met 14 days. 29 Days @ Chipps, have met 25 day so far with 2 carry over days from Apr.			
			3420 cfs	
			2736 cfs	
	4450 cfs per VAMP			
	Closed		Closed up to 14 days	
WATER QUALITY STANDARDS				
<ul style="list-style-type: none"> Municipal and Industrial All Export Locations Contra Costa Canal 	CI <= 250 mg/l			
	CI <= 150 mg/l for 175 days for Below Normal Water Year Type, have met 145 days so far			
<ul style="list-style-type: none"> Aariculture Western/Interior Delta Southern Delta 	Max. 14-day Avg EC <= 0.45 mmhos/cm @ Emmaton & Jersey Point		Max. 14-day Avg EC mmhos/cm <= 1.14 @ Emmaton & 0.74 @ Jersey Point	
	Max. 14-day Avg EC <= 0.45 mmhos/cm @ Terminous & San Andreas			
	30-day running average EC <= 0.7 mS			
<ul style="list-style-type: none"> Fish and Wildlife San Joaquin River Salinity Suisun Marsh Salinity 				
	12.5 mhtEC			

Water Year Classification: (Based on forecast, 5/1/2010)

SRI (40-30-30 @ 50%) = 6.9 MAF (Below Normal)
 SJV (60-20-20 @ 75%) = 3.5 MAF (Above Normal)

SWP & CVP CY 2010 Forecasted Operations

(based on May 1, 2010 Water Supply Forecast)

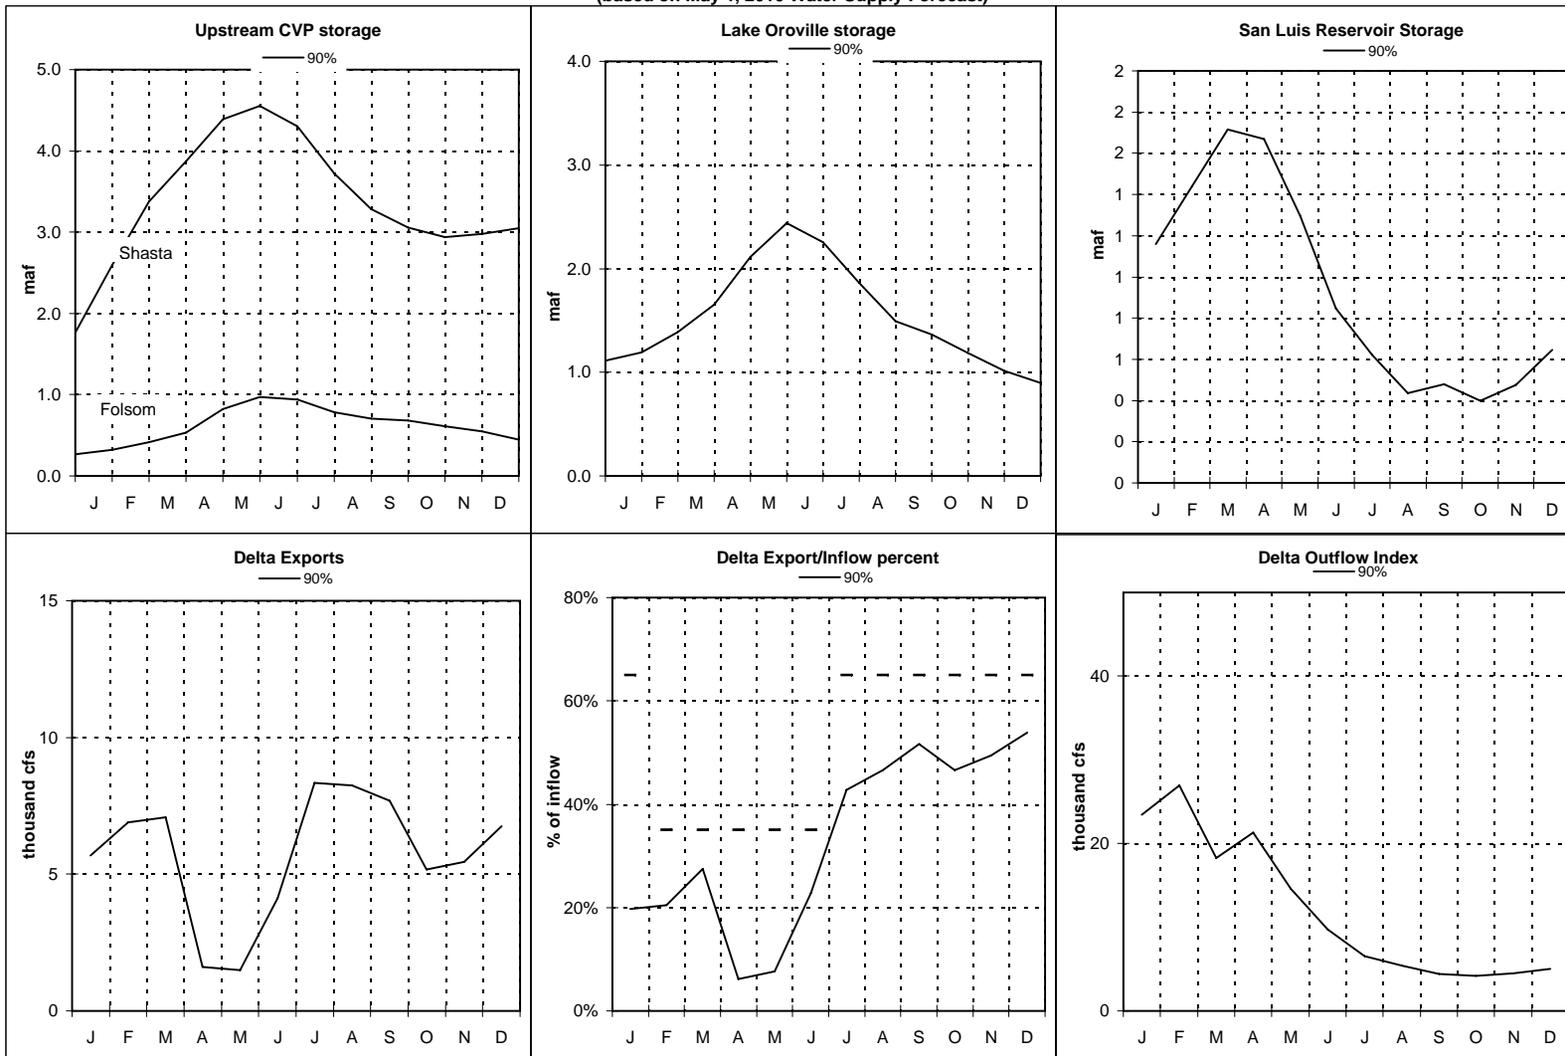

Flows are monthly averages.