Legend

Small Public Water Wells •	Assn. Member Wells	
△	○	Less than 50% MCL (MCL = 45 mg/L)
◭	◒	50% MCL to MCL
▲	●	Greater than or Equal to MCL
⬢	■	Closed Wells

• Small Public Water Supply System Wells regulated by the County of Stanislaus. Location is accurate only to the nearest section.

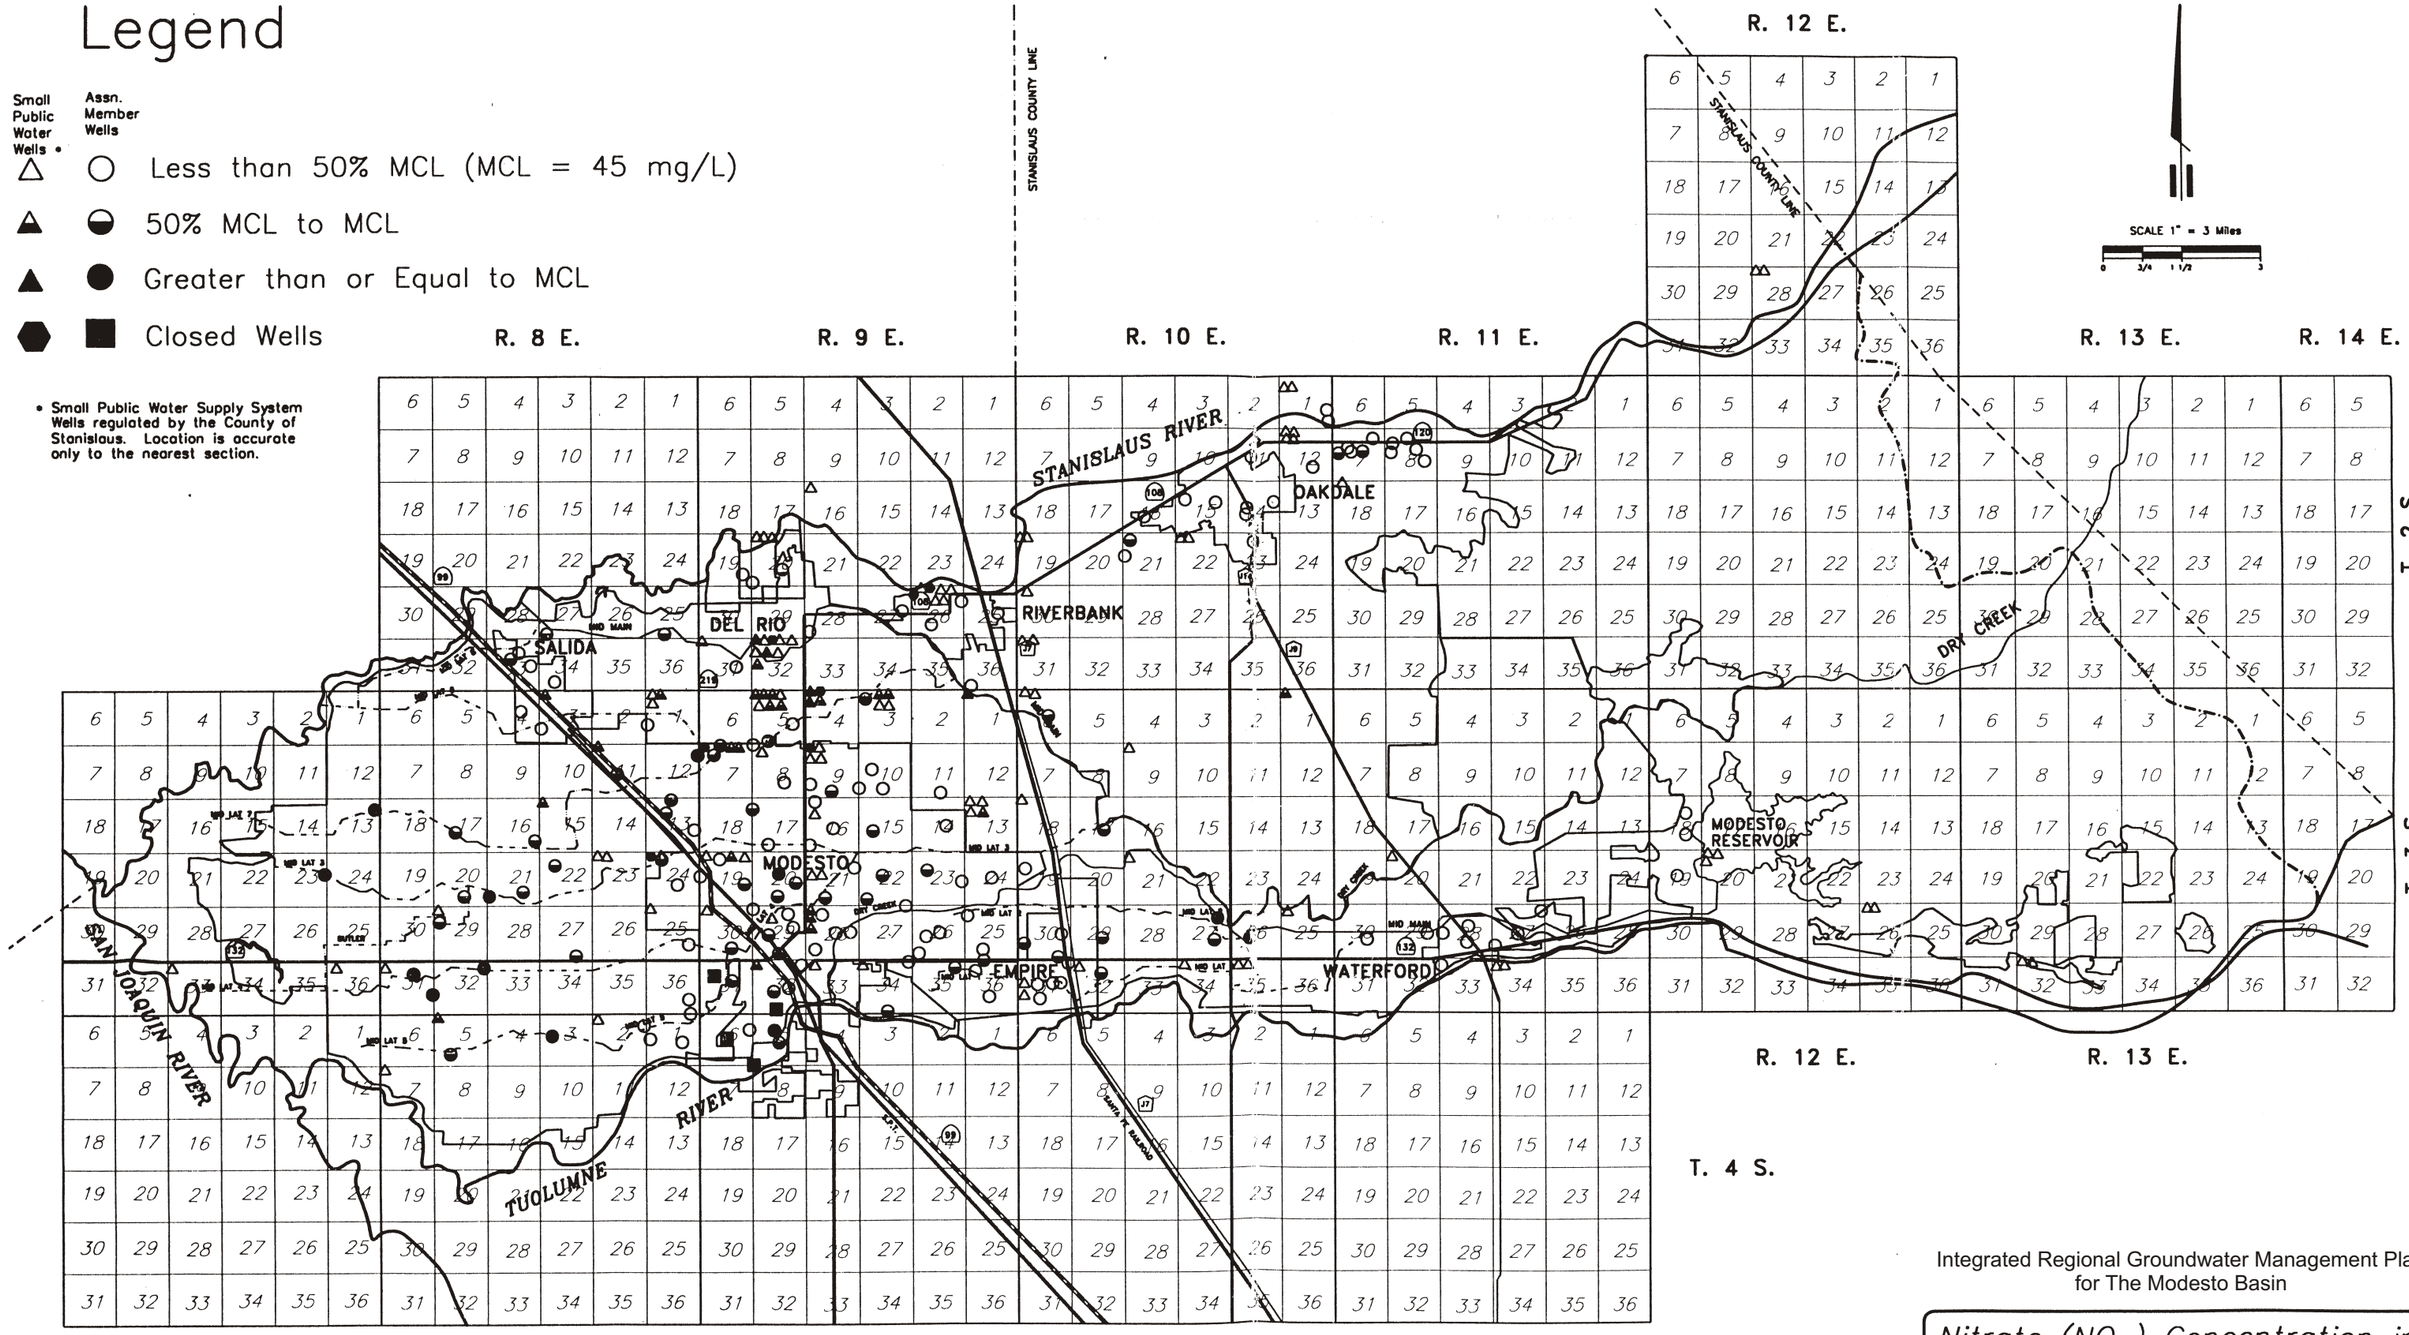

Reproduced from Development of a Groundwater Management Plan Phase 1 (1995)

Integrated Regional Groundwater Management Plan for The Modesto Basin

Nitrate (NO_3) Concentration in Water Wells In 1990

Figure 4-19

05-10-04 S:GIS/Projects/040190/Corel/Figure 4-18.cdr