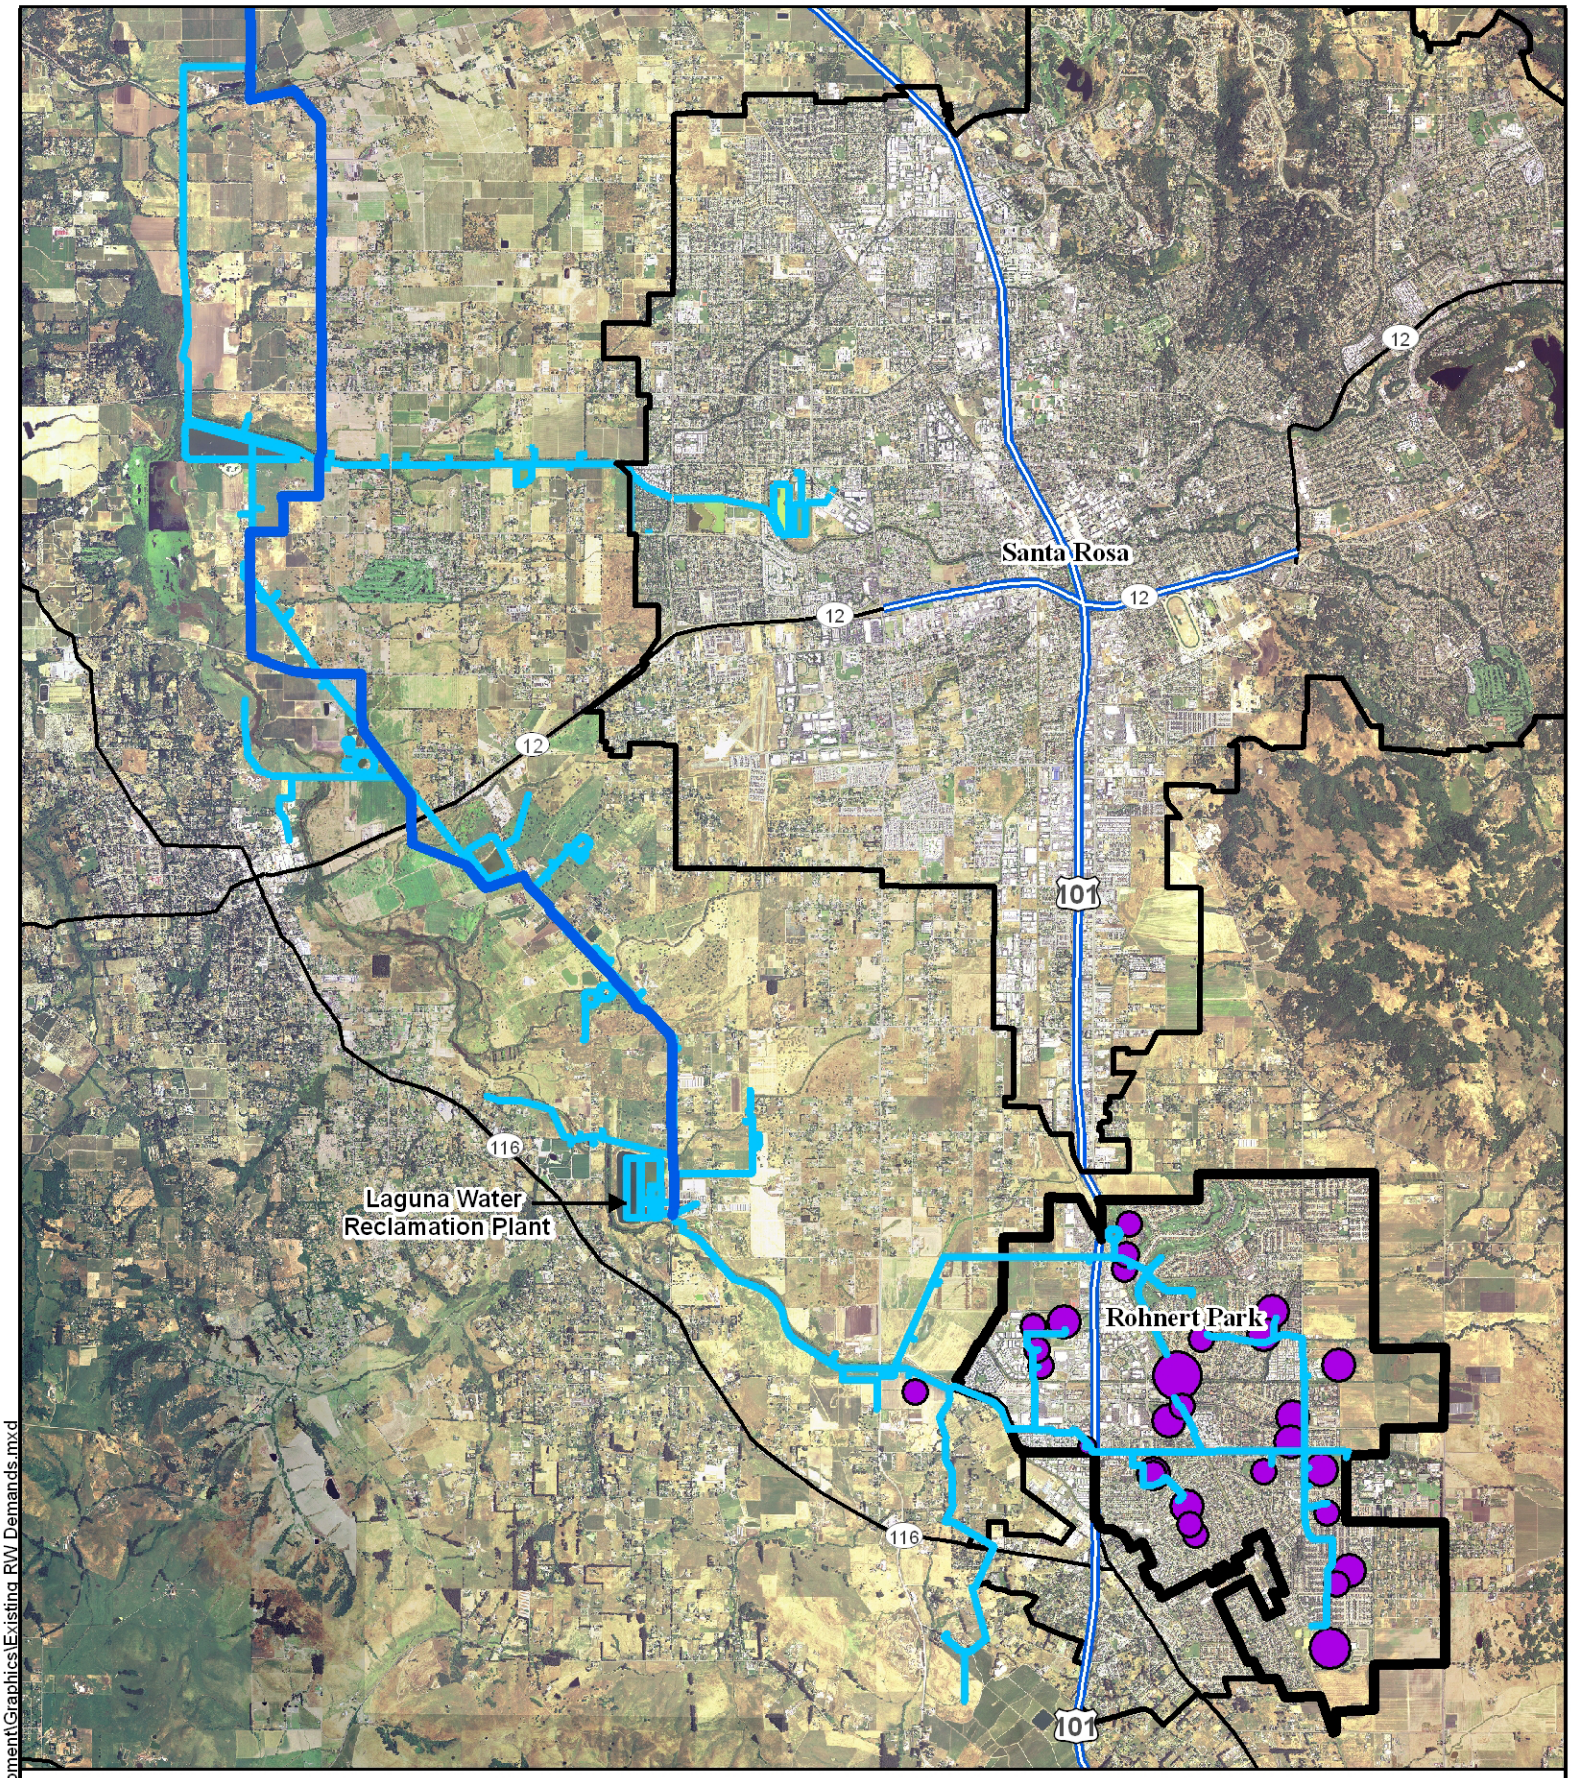

Legend

- City Limits
- GeysersPipeline
- Subregional System Irritation Pipeline

Existing Recycled Water Demands MGY

- 0 - 1
- 2 - 5
- 6 - 20
- 21 - 50
- 51 - 160

N

0 2,500 5,000 Feet

Figure 5-1
Subregional Water Reuse System

City of Rohnert Park
2005 Urban Water Management Plan
Sonoma County, California
04205627
August 2007

WINZLER & KELLY
CONSULTING ENGINEERS

J:\04\205627\UWMP Development\Graphics\Existing RW Demands.mxd