CALIFORNIA WATER SERVICE COMPANY
SAN JOSE, CALIFORNIA

Revised Cal. P.U.C. Sheet No. 1685-W

Cancelling Revised Cal. P.U.C. Sheet No. 714-W

SERVICE AREA MAP
HERMOSA-REDONDO DISTRICT

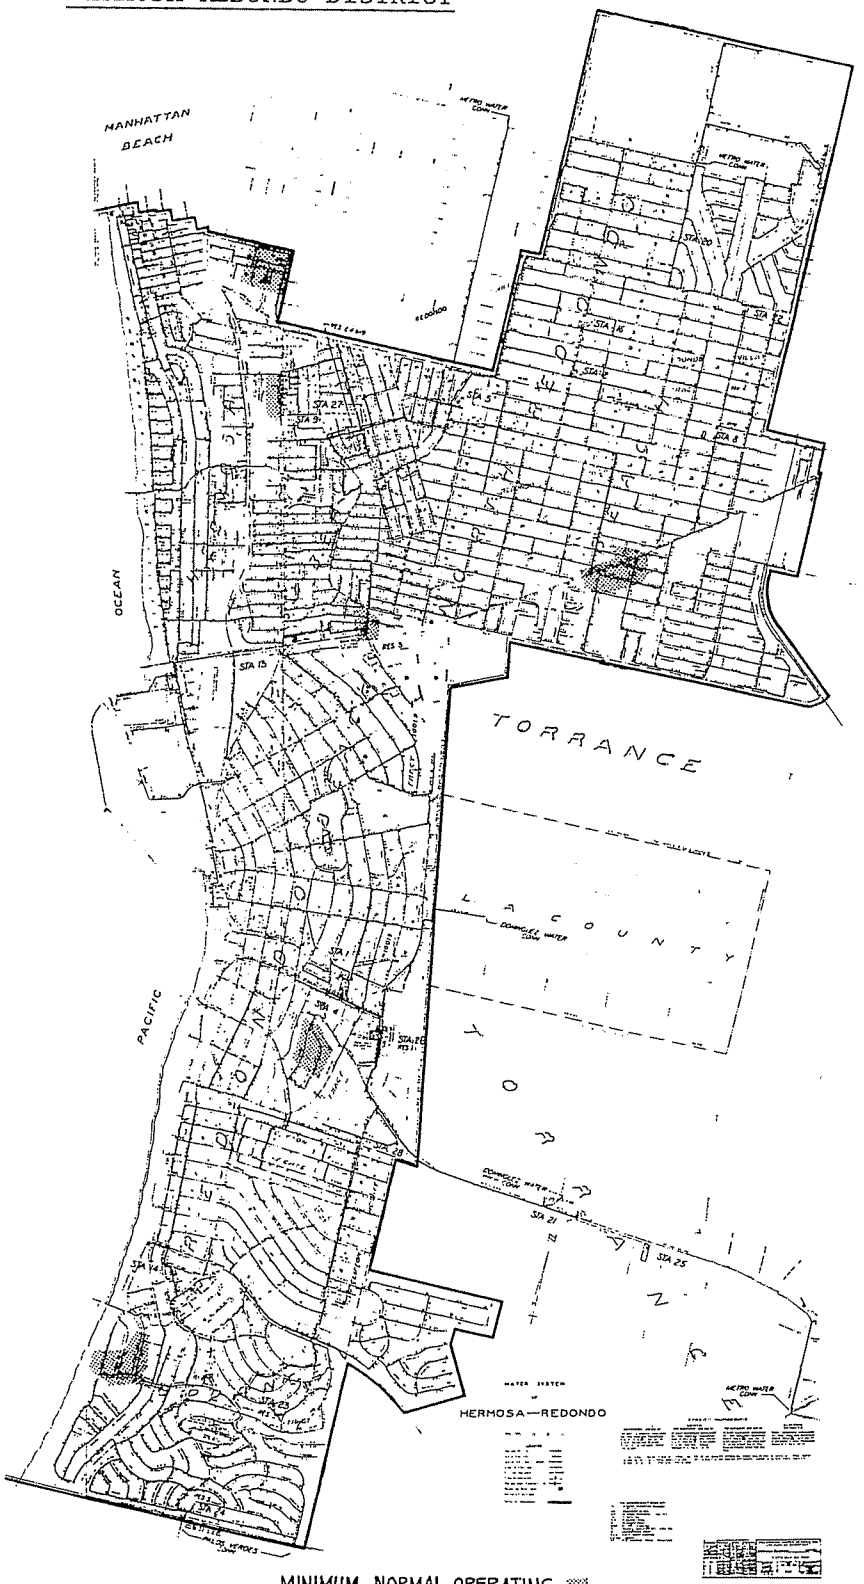

MINIMUM NORMAL OPERATING PRESSURE 25 TO 40 P.S.I.

Issued by

Ed F. Catey

ED F. CATEY, *Vice President*

Advice Letter No. 493

Decision No. 84334

Date Filed JUN 4 1976

Effective JUN 9 1976