

Selma District Conservation Master Plan: 2011 - 2015

California Water Service Company

Prepared by

M.Cubed
Gary Fiske and Associates, Inc.
A&N Technical Services, Inc.

April 2011



Table of Contents

| | |
|--|------|
| List of Acronyms/Abbreviations..... | vi |
| Executive Summary | vii |
| ES-1 Introduction | vii |
| ES-2 Baseline Per-Capita Demand..... | viii |
| ES-3 Demand-Reduction Targets..... | viii |
| ES-3.1 SBx7-7 Requirements | ix |
| ES-3.2 MOU Requirements | x |
| ES-3.3 SBx7-7 Per Capita Targets | x |
| ES-3.4 Gross and Net Savings Requirements..... | xi |
| ES-4 Conservation Program Analysis..... | xii |
| ES-5 Portfolio Development..... | xv |
| ES- 6 Required Staffing and Expenditure Levels..... | xix |
| ES-6.1 Administration and Research..... | xix |
| ES-6.2 Public Information and School Education | xix |
| ES-6.3 Cost Summary..... | xx |
| ES-6.4 Expected Savings..... | xx |
| ES-7 Plan Monitoring and Updates..... | xxi |
| 1 Introduction | 1 |
| 1.1 Master Plan Scope and Objectives | 1 |
| 1.2 Plan Development..... | 2 |
| 1.3 Report Organization..... | 3 |
| 2 District Profile..... | 5 |
| 2.1 Introduction..... | 5 |
| 2.2 Service Area Description | 5 |
| 2.3 Population and Service Connections | 5 |
| 2.4 Historical Water Demand..... | 7 |
| 2.5 Unadjusted Baseline Water Demand Projection | 9 |
| 2.6 Local Water Supply Issues | 10 |
| 2.7 Future Water Cost..... | 11 |
| 2.7.1 Short-Run Avoided Costs..... | 11 |
| 2.7.2 Long-Run Avoided Costs..... | 12 |

| | | |
|-------|--|----|
| 2.8 | Future Water Rates..... | 12 |
| 3 | Statewide Urban Water Demand Reduction Policies..... | 13 |
| 3.1 | Introduction..... | 13 |
| 3.2 | CPUC GPCD Policy..... | 13 |
| 3.3 | State Per Capita Water Use Policies and Targets..... | 13 |
| 3.3.1 | SBx7-7 GPCD Reduction Targets..... | 13 |
| 3.3.2 | Regional Compliance..... | 14 |
| 3.3.3 | Cal Water SBx7-7 Compliance Strategy..... | 15 |
| 3.4 | Urban Water Conservation MOU..... | 16 |
| 3.4.1 | MOU Compliance Options..... | 16 |
| 3.4.2 | Cal Water MOU Compliance Strategy..... | 17 |
| 4 | SBx7-7 and MOU Savings Targets..... | 19 |
| 4.1 | Introduction..... | 19 |
| 4.2 | SBx7-7 Target Calculation..... | 19 |
| 4.3 | MOU Flex Track Target Calculation..... | 22 |
| 4.4 | Difference from Unadjusted Baseline Water Use..... | 24 |
| 5 | Water Savings Required from New Programs..... | 25 |
| 5.1 | Introduction..... | 25 |
| 5.2 | Expected Savings from Efficiency Codes..... | 25 |
| 5.3 | Expected Savings from Rates..... | 27 |
| 5.4 | Expected Savings from Current Programs..... | 27 |
| 5.5 | Adjusted Baseline Demand..... | 28 |
| 5.6 | Water Savings Needed from New Programs..... | 28 |
| 6 | Conservation Program Analysis..... | 31 |
| 6.1 | Introduction..... | 31 |
| 6.2 | Conservation Program Concepts..... | 31 |
| 6.2.1 | Concept Screening..... | 35 |
| 6.2.2 | Preliminary Quantitative Analysis..... | 37 |
| 6.2.3 | Identification of Core and Non-Core Programs..... | 38 |
| 6.3 | Benefit-Cost Analysis of Core and Non Core Programs..... | 41 |
| 7 | Portfolio Development..... | 43 |
| 7.1 | Introduction..... | 43 |
| 7.2 | SBx7-7 and MOU Savings Targets..... | 43 |
| 7.3 | 2011-13 General Rate Case Decision..... | 43 |

Selma District Conservation Master Plan: 2011-2015

| | | |
|-------|---|----|
| 7.4 | Minimum and Maximum Program Levels..... | 44 |
| 7.5 | Recommended Annual Program Activity and Staff Levels..... | 44 |
| 7.5.1 | Residential and Non-Residential Conservation Programs | 44 |
| 7.5.2 | Administration & Research..... | 45 |
| 7.5.3 | Public Information & School Education | 46 |
| 7.6 | Projected Annual Program Expenditures | 47 |
| 7.7 | Projected Portfolio Water Savings..... | 48 |
| 7.8 | Projected Water Demands | 49 |
| 7.9 | Program Cut Sheets | 50 |
| 8 | Plan Monitoring and Updates | 51 |
| 8.1 | Introduction..... | 51 |
| 8.2 | Program Tracking | 51 |
| 8.3 | 2014-16 General Rate Case | 51 |
| 8.4 | 2015 UWMP..... | 51 |
| 8.5 | MOU Flex Track Target..... | 51 |
| 8.6 | Water Savings Verification | 52 |
| 8.7 | Local Codes and Ordinances | 52 |
| 8.8 | 2015 Plan Update | 52 |

Appendix 1 Conservation Program Cut Sheets

Appendix 2 Conservation Program Modeling Assumptions and Results

Report Tables

| | |
|---|-------|
| Table ES-1. Cal Water Districts Sorted by Hydrologic Region..... | ix |
| Table ES-2. Regional SBx7-7 Targets for Cal Water Districts in Tulare Lake HR..... | xi |
| Table ES-3. Selma District Gross Savings Required for SBx7-7 and MOU Compliance | xi |
| Table ES-4. Selma District New Program Savings Required for SBx7-7 and MOU Compliance..... | xii |
| Table ES-5. Selma District Program Concepts Passing Qualitative Screen | xiii |
| Table ES-6. Cal Water Conservation Programs | xvi |
| Table ES-7. Selma District Core and Non-Core Program Benefit-Cost Ratios | xvii |
| Table ES-8. Selma District GRC Conservation Program Expenditure Constraints .. | xviii |
| Table ES-9. Selma District Recommended Residential and Non-Residential Program Levels..... | xix |
| Table ES-10. Selma District Projected Annual Conservation Expenditures | xx |
| Table ES-11. Selma District Projected Water Savings by Customer Class..... | xx |
| Table ES-12. Selma District Recommended Portfolio Projected 2015 Demand | xxi |
| Table 2-1. Selma District Historical and Projected Population..... | 6 |
| Table 2-2. Selma District Service Connections..... | 7 |
| Table 2-3. Selma District Unadjusted Baseline Demand Projection | 10 |
| Table 2-4. Selma District Avoided Cost Forecast..... | 12 |
| Table 2-5. Selma District Nominal Change in Service Rates | 12 |
| Table 3-1. Cal Water Districts Sorted by Hydrologic Region | 15 |
| Table 3-2. MOU Best Management Practices | 18 |
| Table 4-1. Selma District SBx7-7 GPCD Targets..... | 20 |
| Table 4-2. Regional SBx7-7 Targets for Cal Water Districts in Tulare Lake HR..... | 21 |
| Table 4-3. Programmatic BMPs Used to Calculate Flex Track Target | 23 |
| Table 4-4. Selma District 2015 MOU Flex Track Target..... | 24 |
| Table 4-5. Selma District Gross Savings Required for SBx7-7 and MOU Compliances | 24 |
| Table 5-1. Selma District 2011-2015 Code-Driven Water Savings..... | 26 |
| Table 5-2. Selma District 2011-2015 Water Savings from Proposed Rate Adjustment | 27 |
| Table 5-3. Selma District Water Savings from Meter Conversion and 2009-10 Conservation Programs..... | 28 |
| Table 5-4. Selma District Adjusted Baseline Demand Projection | 28 |
| Table 5-5. Selma District New Program Savings Required for SBx7-7 and MOU Compliance..... | 29 |
| Table 5-6. Selma District 2015 GPCD Required for SBx7-7 and MOU Compliance.... | 29 |
| Table 6-1. Selma District Indoor Conservation Program Concepts..... | 33 |
| Table 6-2. Selma District Outdoor Conservation Program Concepts | 34 |
| Table 6-3. Selma District General Conservation Program Concepts..... | 35 |
| Table 6-4. Selma District Program Concepts Passing Qualitative Screen..... | 36 |
| Table 6-5. Cal Water Conservation Programs..... | 40 |

Table 6-6. Selma District Core and Non-Core Program Benefit-Cost Ratios..... 42
Table 7-1. Selma District GRC Conservation Program Expenditure Constraints..... 44
Table 7-2. Selma District Recommended Residential and Non-Residential Program Levels..... 45
Table 7-3. Selma District Projected Annual Conservation Expenditures..... 48
Table 7-4. Selma District Projected Water Savings by Program 49
Table 7-5. Selma District Projected Water Savings by Customer Class 49
Table 7-6. Selma District Recommended Portfolio Projected 2015 Demand 50

Report Figures

Figure ES-1. Selma District Historical Per Capita Demand..... viii
Figure 2-1. Selma District Distribution of Services by Customer Type 6
Figure 2-2. Selma District Historical Demand 7
Figure 2-3. Selma District Percent of Total Demand by Type of Use 8
Figure 2-4. Selma District Historical Per Capita Demand 9
Figure 2-5. Selma District Unadjusted Baseline Demand Projection..... 10
Figure 4-1. Selma District SBx7-7 Per Capita Target Demand 21
Figure 7-1. Cal Water Conservation Program Management Regions 47
Figure 7-2. Selma District 2011-15 Conservation Expenditure Shares..... 48

List of Acronyms/Abbreviations

| | |
|--------------|--|
| AF | Acre-Feet |
| AFY | Acre-feet Per Year |
| BCR | Benefit-Cost Ratio |
| BMP | Best Management Practice, as in MOU Conservation BMPs |
| Cal Water | California Water Service Company |
| CII | Commercial, Industrial, Institutional |
| Comm | Commercial |
| Cont | Contractor |
| CPUC | California Public Utilities Commission |
| Cust | Customer |
| CUWCC | California Urban Water Conservation Council |
| CW | Clothes Washer |
| Dist | Distributor |
| DWR | California Department of Water Resources |
| ETo | Reference Evapotranspiration |
| GPCD | Gallons Per Capita Per Day |
| GPM | Gallons Per Minute |
| GRC | General Rate Case |
| HE | High-Efficiency, as in HE Toilets |
| HECW | High-Efficiency Clothes Washer |
| HET | High-Efficiency Toilet |
| HR | Hydrologic Region |
| Inc | Incentive |
| Irrig or Irr | Irrigation |
| Lg | Large, as in Large Landscape Survey |
| Lndscp | Landscape |
| MCL | Maximum Contaminant Level |
| MOU | Memorandum of Understanding Regarding Urban Water Conservation in California |
| NAICS | North American Industrial Classification System |
| Reb | Rebate |
| SBx7-7 | Senate Bill 7 (Steinberg), The Water Conservation Act of 2009 |
| SWP | State Water Project |
| ULFT | Ultra Low Flush Toilet |
| UWMP | Urban Water Management Plan |
| UWMPA | Urban Water Management Planning Act |
| WBIC | Weather-Based Irrigation Controller (also called “Smart Controllers”) |
| WSS | WaterSense Specification |

Executive Summary

ES-1 Introduction

California Water Service Company (Cal Water) is in the process of expanding current conservation programs and developing new programs for its 24 service districts. Over the next five years, Cal Water conservation program expenditures are likely to increase significantly due in large measure to recently adopted state policies requiring significant future reductions in per capita urban water use. These include the passage of Senate Bill No. 7 (SBx7-7) in November 2009, which mandated a statewide 20% reduction in per capita urban water use by 2020, as well as recent decisions by the California Public Utilities Commission (CPUC) directing Class A and B water utilities to adopt conservation programs and rate structures designed to achieve reductions in per capita water use, and the *Memorandum of Understanding Regarding Urban Water Conservation in California* (MOU), of which Cal Water has been a signatory since 1991.

Aside from these mandates, conservation will also help the Selma District address local groundwater quality and overdraft issues affecting the long-term reliability of district water supply.

In preparing for this program expansion, Cal Water has spent the past year developing five-year conservation program plans for each of its service districts. Each district plan was developed with the following questions in mind:


- How much water conservation will each district need to implement in order to comply with state urban per capita water use targets?
- How much of this conservation requirement can be met by existing water efficiency codes and ordinances, scheduled increases in water rates, and past investment in conservation programs?
- How much of this conservation requirement will need to be met through new investments in conservation?
- Which water conservation programs at what levels of activity result in the most benefit to Cal Water ratepayers?
- Should existing programs be expanded, new programs developed, or both?
- How can conservation be used to help address local water supply constraints?

- How many conservation programs can Cal Water reasonably expect to operate given the geographic dispersion of its districts, and staffing and budgetary constraints?
- How can regional partnerships be leveraged to more efficiently achieve a district's water conservation targets?

ES-2 Baseline Per-Capita Demand

The determination of the required future demand reductions must begin with a clear understanding of past and current per-capita demands. As Figure ES-1 shows, Selma's per-capita demands have fluctuated between 250 and 280 gpcd over the last decade. Assuming that future per-capita demand stays constant, total future demand will grow at the rate of population growth, which is forecast to be about 2.1% annually over the next decade.

Figure ES-1. Selma District Historical Per Capita Demand

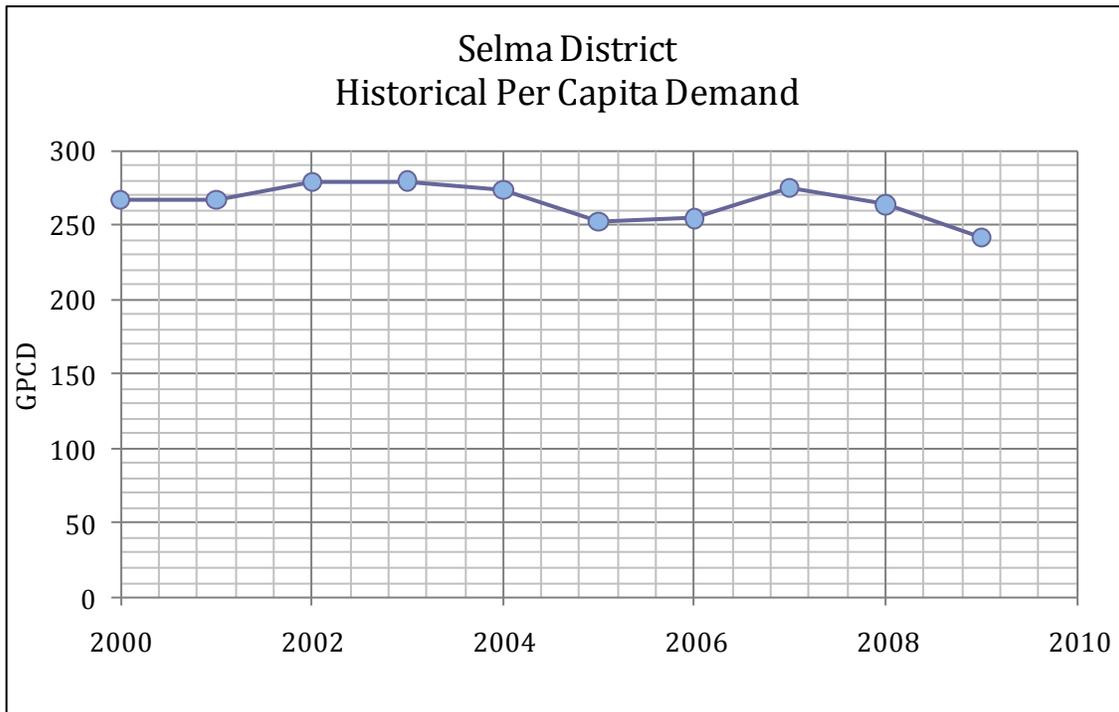

ES-3 Demand-Reduction Targets

The two statewide policies that result in quantified future demand reduction targets are those of SBx7-7 and the MOU. Following are brief discussions of each of these requirements.

ES-3.1 SBx7-7 Requirements

Senate Bill 7 (SBx7-7), which was signed into law in November 2009, amended the State Water Code to require a 20% reduction in urban per capita water use by 2020. Commonly known as the 20x2020 policy, the new requirements apply to every retail urban water supplier subject to the Urban Water Management Planning Act (UWMPA).

SBx7-7 requires the state to achieve a 20% reduction in urban per capita water use by December 31, 2020. The state is required to make incremental progress toward this goal by reducing per capita water use by at least 10% on or before December 31, 2015. SBx7-7 requires each urban retail water supplier to develop interim and 2020 urban water use targets in accordance with specific requirements. They will not be eligible for state water grants or loans unless they comply with those requirements.

The law provides each water utility several ways to calculate its interim 2015 and ultimate 2020 water reduction targets. In addition, water suppliers are permitted to form regional alliances and set regional targets for purposes of compliance. Under the regional compliance approach, water suppliers within the same hydrologic region can comply with SBx7-7 by either meeting their individual target or being part of a regional alliance that meets its regional target. Cal Water districts sorted by hydrologic region are shown in Table ES-1.

Table ES-1. Cal Water Districts Sorted by Hydrologic Region

| Hydrologic Region | Cal Water Districts in Region |
|--------------------------|--|
| North Coast | Redwood Valley |
| San Francisco Bay Area | Bear Gulch, Livermore, Los Altos, Mid-Peninsula, South San Francisco |
| Central Coast | King City, Salinas |
| South Coast | Domiguez, East LA, Hermosa-Redondo, Palos Verdes, West Lake |
| Sacramento River | Chico, Dixon, Marysville, Oroville, Willows |
| San Joaquin | Stockton |
| Tulare Lake | Bakersfield, Kern River Valley, Selma , Visalia |
| North Lahontan | None |
| South Lahontan | Antelope Valley |
| Colorado River | None |

Cal Water’s SBx7-7 compliance strategy involves:

1. Identifying for each district the largest allowable interim and 2020 GPCD targets under the relevant compliance methods allowed by the statute;
2. Grouping districts by hydrologic region and calculating population-weighted regional targets where applicable; and

3. Developing conservation programs aimed at achieving the regional and/or district-specific targets.

As shown in Table ES-1, the Selma District lies within the Tulare Lake hydrologic region, along with Bakersfield, Kern River Valley, and Visalia districts. Under SBx7-7, these four districts, in addition to developing their district-specific per capita demand targets, can form a regional alliance and define regional 2015 and 2020 compliance targets.

ES-3.2 MOU Requirements

Administered by the California Urban Water Conservation Council (CUWCC), the *Memorandum of Understanding Regarding Urban Water Conservation in California* (MOU) has guided urban water conservation programs in California since it was first adopted in 1991. There are three ways in which a water supplier can comply with the MOU. The first way is to implement a set of water conservation best management practices (BMPs) according to the requirements and schedules set forth in Exhibit 1 of the MOU. The second way, called Flex Track compliance, is to implement conservation programs expected to save an equivalent or greater volume of water than the BMPs. The third way, similar to SBx7-7, is to reduce per capita water use. Because the Flex Track compliance option affords the most flexibility in selecting conservation programs suited to each Cal Water district and allows for more streamlined reporting, Cal Water plans to use Flex Track to comply with the MOU. Because CUWCC tools for calculating a district's Flex Track savings target are not yet available, Cal Water developed its own target estimates for planning purposes.

ES-3.3 SBx7-7 Per Capita Targets

District-specific and regional targets for Cal Water districts within the Tulare Lake hydrologic region are shown in Table ES-2.¹ The 2015 and 2020 district-specific targets for Selma District are 242 and 215 gpcd, respectively. Over the last five years district demand has averaged about 258 gpcd. Thus, per capita demand needs to fall by about 6% by 2015 and by about 17% by 2020 in order for Selma District to meet its district-specific targets. Alternatively, demand for the four Cal Water districts within the Tulare Lake hydrologic region can average no more than 250 gpcd in 2015 and 222 gpcd in 2020.

¹ District-specific targets are based either on Method 1 or Method 3, as defined in SBx7-7, whichever yielded the highest per capita target for the district.

Table ES-2. Regional SBx7-7 Targets for Cal Water Districts in Tulare Lake HR

| District | Population | 2015 Target (GPCD) | 2020 Target (GPCD) |
|-------------------------------------|-------------------|---------------------------|---------------------------|
| Bakersfield | 252,010 | 268 | 239 |
| Kern River Valley | 6,359 | 190 | 179 |
| Selma | 24,260 | 242 | 215 |
| Visalia | 132,930 | 219 | 194 |
| Regional Targets¹ | | 250 | 222 |

¹ Regional targets are the population-weighted average of the district targets.

ES-3.4 Gross and Net Savings Requirements

Table ES-3 shows the gross savings required under SBx7-7 and MOU Flex Track compliance. These, however, do not reflect the savings that are required to be achieved from new conservation programming, which are net of the expected savings from water efficiency codes, expected future rate adjustments, and already-existing conservation programs. The impacts of these savings components are shown in Table ES-4. In the case of SBx7-7, an additional 96 AF of savings is needed for SBx7-7 compliance in 2015. For MOU Flex Track compliance, an additional 2 AF of savings is required.

While Selma District is well positioned to achieve its 2015 interim targets, between 2015 and 2020 it will need to reduce per capita demand by an additional 11% in order to meet its 2020 district-specific target.

Table ES-3. Selma District Gross Savings Required for SBx7-7 and MOU Compliance

| Gross Water Savings Required by 2015 | SBx7-7 | MOU Flex Track |
|---|---------------|-----------------------|
| 2015 Unadjusted Baseline Demand | 8,199 AF | 8,199 AF |
| 2015 Target Demand | 7,695 AF | 8,189 AF |
| Gross Savings Requirement | 504 AF | 10 AF |

Table ES-4. Selma District New Program Savings Required for SBx7-7 and MOU Compliance

| 2015 Net Savings Requirement (AF) | SBx7-7 | MOU Flex Track |
|---|---------------|-----------------------|
| Gross Savings Requirement | 504 | 10 |
| Less | | |
| Savings from codes | 51 | NA |
| Savings from rates | 73 | NA |
| Savings from existing programs and metering | <u>284</u> | <u>8</u> |
| <i>Subtotal Expected Savings</i> | <i>409</i> | <i>8</i> |
| Savings Required from New Programs | 96 | 2 |

ES-4 Conservation Program Analysis

As a result of an exhaustive search of the literature, consultation with experts in the field, knowledge of conservation programming by other water suppliers, and the experience of the project team, a universe of more than 75 conservation program concepts was defined. At this point in the process, the goal was to be as inclusive as possible. The list was therefore intentionally large to ensure that all possible program concepts were considered. Cal Water did not want to risk inadvertently excluding a program from consideration.

For the purposes of this plan, a conservation program concept is comprised of two components:

- Targeted technologies or changes in customer behavior; and
- A delivery mechanism by which customers will be encouraged (or required) to adopt the technology(ies) or change their behavior.

Each program may apply to multiple customer classes (Single Family, Multi-Family, Commercial/ Industrial/Institutional, and Large Landscape).

Once the universe of program concepts was defined, the next step was to subject each program concept to a careful district-specific qualitative screen, the objective of which was to eliminate those program concepts that were clearly inappropriate. For this purpose, six screening criteria were developed. For each program concept, Cal Water staff answered “yes” or “no” for each of these criteria. A “yes” answer on all of these criteria was considered to be essential for program success. Thus, a negative response to any one of the criteria for a particular program concept eliminated that concept from further consideration. Once Cal Water had completed

the initial qualitative screen, it met with local community leaders to share the results and solicit feedback on conservation program concepts for the district.

The final set of programs passing the qualitative screen for Selma District is shown in Table ES-5.

Table ES-5. Selma District Program Concepts Passing Qualitative Screen

| Technology/Intervention | Delivery Mechanism | CUSTOMER CLASS | | | |
|---|--|----------------|--------------|-----|----------|
| | | Single Family | Multi-Family | CII | Lg Lndsp |
| INDOOR | | | | | |
| HE Toilets | Customer rebates or vouchers | x | x | x | |
| | Vendor, distributor & contractor incentives | x | x | x | |
| | Distribution (by utility, community group, vendor) | x | x | x | |
| | Direct install | x | x | x | |
| Urinals | Customer rebates or vouchers | | | x | |
| | Vendor, distributor & contractor incentives | | | x | |
| | Distribution (by utility or vendor) | | | x | |
| | Valve replacement | | | x | |
| Clotheswashers: in-unit, common area, & coin-op | Customer rebates & vouchers | x | x | x | |
| | Vendor, distributor & contractor incentives | x | x | x | |
| Showerhead (2.0, 1.5 gpm)/ flapper/aerators | Kit distribution or install | x | x | | |
| Shower timers, Reminder cards | Distribution | x | x | | |
| Cooling Towers | Customer rebates, customized incentives | | | x | |
| Food Steamers | Customer rebates | | | x | |
| Ice Machines | Customer rebates | | | x | |
| Steam Sterilizers | Customer rebates | | | x | |
| Car Washes | Customer rebates | | | x | |
| | Audits | | | x | |
| Spray valves | Customer rebates | | | x | |
| | Audits | | | x | |
| X Ray film & photo processors | Customer rebates | | | x | |
| Industrial process | Audits & incentives | | | x | |
| OUTDOOR | | | | | |
| Large Landscape Surveys | | | | | x |
| WBIC | Direct Install | x | x | x | x |
| | Customer rebate | x | x | x | x |
| | Vendor, distributor & | x | x | x | x |

Selma District Conservation Master Plan: 2011-2015

| Technology/Intervention | Delivery Mechanism | CUSTOMER CLASS | | | |
|---|---|----------------|--------------|-----|----------|
| | | Single Family | Multi-Family | CII | Lg Lndsp |
| | contractor incentives | | | | |
| | Distribution | x | x | x | x |
| Irrigation System (including, but not limited to, high efficiency nozzles for pop-up heads, drip, soil moisture sensors, rain shut off, pressure control) | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| Landscape design | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| Turf buy back (Cash for Grass) | Customer rebate | x | x | x | x |
| Large Landscape Water Use Reports | | | | | x |
| Pool, hot tub covers & other upgrades | Customer rebate or voucher | x | x | x | |
| | | | | | |
| GENERAL | | | | | |
| Audits & Surveys (incl high bill contacts) | | x | x | x | x |
| Water use meter alerting device | | x | x | x | |
| Water recycling, grey water use, rainwater harvesting | Customized incentives | x | x | x | |
| New construction guidelines | | x | x | x | |
| New const conservation offsets | | x | x | x | |
| Education/outreach | | x | x | x | x |

The savings and cost parameters associated with each of these program concepts were then identified and each program concept was subjected to a preliminary quantitative analysis to help Cal Water distinguish between core and non-core programs. A key challenge facing Cal Water is finding a way to efficiently scale up conservation programming across its 24 districts with the limited staffing it has to implement and manage these programs. The current General Rate Case (GRC) decision authorizes 4 full-time conservation program staff for 2011-13. These staff will be responsible for implementing and managing programs in 24 geographically dispersed districts serving a combined population of over 1.7 million.²

Even with the added staffing beginning in 2014 that Cal Water intends to propose to the CPUC, the most efficient way for Cal Water to manage programs across its geographically dispersed districts is to standardize programs and centralize their implementation and oversight. Using the results of the qualitative screening and the preliminary quantitative analysis, Cal Water identified five core programs that it would run in every district over the next five years.

² By way of comparison, the East Bay Municipal Utility District has a conservation program staff of 21 full-time positions serving a population of 1.3 million within a geographically contiguous and compact service area.

In addition to the core programs, an additional set of non-core programs was selected. Unlike core programs, Cal Water may not offer non-core programs in every district or in every year. Implementation of non-core programs will depend on whether additional water savings are required for SBx7-7 or MOU compliance, or to help address local supply constraints.

The set of core and non-core programs that Cal Water will offer over the next five years is shown in Table ES-6.

A detailed benefit-cost analysis was then performed for all of the core and non-core programs, the results of which are shown in Table ES-7.

ES-5 Portfolio Development

The program analysis results described above provided the starting point for portfolio development. The next step was to determine the annual levels of program activity needed to, at minimum, meet Selma District's water savings targets. Several considerations informed these decisions, including budgetary constraints included in the current GRC decision, Cal Water conservation program administrative capacity, program market and water savings potential, and the program benefit-cost results shown in Table ES-7.

Cal Water's current GRC decision established conservation budgets for each district for the years 2011-2013. These budgets specify the total annual expenditure on conservation programs, as well as the maximum amount that can be allocated to (1) program administration and research, (2) public information and school education programs, (3) residential conservation programs, and (4) non-residential conservation programs. Table ES-8 shows these budgetary restrictions for Selma District.

Table ES-6. Cal Water Conservation Programs

| Program Name | Description | Target Market |
|--|---|--|
| CORE PROGRAMS | | |
| Rebate/Vouchers for toilets, urinals, and clothes washers | Provide customer rebates for high-efficiency toilets, urinals, and clothes washers | All customer segments |
| Residential Surveys | Provide residential surveys to low-income customers, high-bill customers, and upon customer request or as pre-screen for participation in direct install programs | All residential market segments |
| Residential Showerhead/Water Conservation Kit Distribution | Provide residential showerhead/water conservation kits to customers upon request, as part of residential surveys, and as part of school education curriculum | All residential market segments |
| Pop-Up Nozzle Irrigation System Distribution | Offer high-efficiency pop-up irrigation nozzles through customer vouchers or direct install. | All customer segments |
| Public Information/Education | Provide conservation messaging via radio, bill inserts, direct mail, and other appropriate methods. Provide schools with age appropriate educational materials and activities. Continue sponsorship of Disney Planet Challenge program. | All customer segments |
| NON-CORE PROGRAMS | | |
| Toilet/Urinal Direct Install Program | Offer direct installation programs for replacement of non-HE toilets and urinals | All customer segments |
| Smart Irrigation Controller Contractor Incentives | Offer contractor incentives for installation of smart irrigation controllers | All customer segments |
| Large Landscape Water Use Reports | Expand existing Cal Water Large Landscape Water Use Report Program providing large landscape customers with monthly water use reports and budgets | Non residential customers with significant landscape water use and potential savings |
| Large Landscape Surveys & Irrigation System Incentives | Provide surveys and irrigation system upgrade financial incentives to large landscape customers participating in the Large Landscape Water Use Reports programs and other targeted customers | Non residential customers with significant landscape water use and potential savings |
| Food Industry Rebates/Vouchers | Offer customer/dealer/distributor rebates/vouchers for high-efficiency dishwashers, food steamers, ice machines, and pre-rinse spray valves | Food and drink establishments, institutional food service providers |
| Cooling Tower Retrofits | Offer customer/dealer/distributor rebates/vouchers of cooling tower retrofits | Non-residential market segments with significant HVAC water use |
| Industrial Process Audits and Retrofit Incentives | Offer engineering audits/surveys and financial incentives for process water efficiency improvement | Non-residential market segments with significant industrial process water uses |

Table ES-7. Selma District Core and Non-Core Program Benefit-Cost Ratios

| Program ID | Program Name | Customer Class | BCR |
|-------------------|--|-----------------------|------------|
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | 0.65 |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | 1.38 |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | 0.43 |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | 0.21 |
| 5 | CW common: Cust Reb or Voucher | Multi Family | 0.22 |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | 0.15 |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | 0.25 |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | 0.27 |
| 9 | HE Toilets: Direct Install | Single Family | 0.28 |
| 10 | HE Toilets: Direct Install | Multi Family | 0.77 |
| 11 | HE Toilets: Direct Install | Commercial | 0.26 |
| 12 | Urinals: Direct Install | Commercial | 0.29 |
| 13 | Audits & Surveys (incl high bill contacts) | Single Family | 0.13 |
| 14 | Audits & Surveys (incl high bill contacts) | Multi Family | 0.50 |
| 15 | Audits & Surveys (incl high bill contacts) | Commercial | 0.84 |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | 1.12 |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | 1.12 |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | 1.12 |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | 0.33 |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | 0.33 |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | 0.14 |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | 0.27 |
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | 0.28 |
| 24 | Large Landscape Water Use Reports | Irrigation | 0.30 |
| 25 | Lg Lndscp Surveys & Irrig Sys: Rebates | Irrigation | 0.25 |
| 26 | Comm Irrigation System: Rebates | Commercial | 0.90 |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | 2.58 |
| 28 | Food Steamers: Cust Rebates | Commercial | 0.24 |
| 29 | Ice Machines: Cust Rebates | Commercial | 0.99 |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | 0.77 |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | 0.84 |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | 0.85 |
| 33 | Industrial Process: Audits & Incentives | Industrial | 0.63 |

Table ES-8. Selma District GRC Conservation Program Expenditure Constraints

| Budget Constraint (\$000) | 2011 | 2012 | 2013 |
|----------------------------------|-------------|-------------|-------------|
| Overall Budget | \$175.0 | \$175.0 | \$175.0 |
| Admin & Research | \$21.7 | \$21.7 | \$21.7 |
| Public Info & School Educ. | \$21.5 | \$21.5 | \$21.5 |
| Programmatic Activity | \$131.8 | \$131.8 | \$131.8 |
| Expenditure Caps | | | |
| Residential Programs | \$121.0 | \$121.0 | \$121.0 |
| Non Residential Programs | \$137.4 | \$137.4 | \$137.4 |

For each district, Cal Water then specified minimum and maximum program activity levels to guide portfolio development. The minimum levels were those below which it would not be administratively feasible or cost-effective to offer the program in the district, while the maximum levels were those that could reasonably be achieved given district customer characteristics, current market demand, and past experience marketing similar programs/technologies to district customers. The constraints placed on annual program activity levels are presented in Appendix 2.

Based on the foregoing, Table ES-9 shows the recommended annual program levels for residential and non-residential programs. The program levels were derived from the following decision rules:

- For 2011-13, set annual program activity to maximize water savings subject to the GRC conservation program budget constraints and the min/max annual activity constraints. This ensured that the portfolio would reflect the least-cost mix of core and non-core conservation programs consistent with the GRC budget constraints.
- For 2014-15, set annual activity to minimum program levels. For programs with BCRs greater than one, increase activity to its maximum level. This ensured that the portfolio would benefit ratepayers by helping to lower average water supply costs.
- For 2014-15, if needed to satisfy the 2015 district-specific SBx7-7 and MOU Flex Track water savings targets, increase program activity of programs with BCRs less than one in order of cost-effectiveness. This ensured the least-cost set of activity levels needed to achieve the water savings targets.

Table ES-9. Selma District Recommended Residential and Non-Residential Program Levels

| Program | Recommended Annual Activity Levels ¹ | | | | |
|---|---|-------|-------|-------|-------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| CORE PROGRAMS | | | | | |
| Rebates/Vouchers | | | | | |
| Toilets | 70 | 70 | 70 | 90 | 90 |
| Clothes Washers | 60 | 60 | 70 | 60 | 60 |
| Urinals | 0 | 0 | 0 | 0 | 0 |
| Customer Surveys/Audits | 70 | 70 | 70 | 70 | 70 |
| Conservation Kit Distribution | 110 | 110 | 110 | 110 | 110 |
| Pop-Up Nozzle Distribution | 1,100 | 1,100 | 1,220 | 3,300 | 3,300 |
| NON-CORE PROGRAMS | | | | | |
| Direct Install Toilets/Urinals | 140 | 140 | 140 | 130 | 130 |
| Smart Irr. Controller Vendor Incentives | 90 | 90 | 90 | 10 | 10 |
| Large Landscape Water Use Reports | 30 | 30 | 30 | 40 | 40 |
| Large Landscape Surveys/Incentives | 10 | 10 | 10 | 10 | 10 |
| Commercial Kitchen Rebates/Vouchers | 0 | 0 | 0 | 10 | 10 |
| Cooling Tower/Process Water Retrofit Incentives | 0 | 0 | 0 | 0 | 0 |
| ¹ Annual activity levels are aggregated across customer classes and rounded up to the nearest 10 units of activity. Appendix 2 contains the detail modeling results broken down by customer class and program measure. | | | | | |

ES- 6 Required Staffing and Expenditure Levels

ES-6.1 Administration and Research

District staff levels and expenditure for administration and research for 2011-13 are set by the current GRC. At present, Cal Water divides its 24 districts into two program management regions which are administered by its two conservation program coordinators. Program reporting and analysis will be conducted by its conservation program analyst. Proposed expenditures for 2014 and 2015 assume two additional conservation program coordinator positions and one additional conservation analyst position for a total of seven full-time positions. Given the scale and diversity of programs proposed in this plan and the geographic dispersion of Cal Water’s districts, this is the minimum staffing level recommended for program implementation, and assumes Cal Water will divide its 24 districts into four program management regions. Program administration costs for 2014-15 are prorated to the districts based on their share of company-wide conservation program expenditures.

ES-6.2 Public Information and School Education

District expenditure for public information and school education programs in 2011-13 is set by the current GRC. Recommended expenditures in 2014 and 2015 were

set to allow some expansion in these programs to support proposed increases in residential and non-residential program levels.

ES-6.3 Cost Summary

Annual program expenditures for conservation programming, administration and research, and public information and education, based on the recommended program levels and GRC budget allocations are shown in Table ES-10.

Table ES-10. Selma District Projected Annual Conservation Expenditures

| Expenditure Category | Projected Annual Expenditures (\$000) | | | | |
|-------------------------|---------------------------------------|----------------|----------------|----------------|----------------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| Program Costs: | | | | | |
| Residential | \$95.9 | \$95.9 | \$95.9 | \$69.5 | \$69.5 |
| Non-Residential | \$35.9 | \$35.9 | \$35.9 | \$32.5 | \$32.5 |
| Program Subtotal | \$131.8 | \$131.8 | \$131.8 | \$102.1 | \$102.1 |
| Admin/Research | \$21.7 | \$21.7 | \$21.7 | \$11.1 | \$11.1 |
| Public Info/Education | \$21.5 | \$21.5 | \$21.5 | \$23.7 | \$23.7 |
| TOTAL ANNUAL | \$175.0 | \$175.0 | \$175.0 | \$136.9 | \$136.8 |

ES-6.4 Expected Savings

Table ES-11 summarizes projected annual water savings by customer class. By 2015 projected water savings are approximately 118 AF. Programs impacting residential water demands account for approximately three-fourths of these savings, while programs impacting commercial, industrial, and irrigation demands account for one-fourth.

Table ES-11. Selma District Projected Water Savings by Customer Class

| Customer Class | Annual Water Savings (AF) | | | | |
|----------------------------|---------------------------|-------------|-------------|-------------|--------------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| Single Family | 11.4 | 22.2 | 32.5 | 47.4 | 61.9 |
| Multi Family | 4.9 | 9.6 | 15.0 | 21.4 | 27.5 |
| Commercial/Industrial | 3.9 | 7.6 | 11.2 | 16.9 | 22.6 |
| Irrigation | 3.2 | 3.6 | 4.0 | 6.0 | 6.4 |
| Total Water Savings | 23.3 | 43.1 | 62.7 | 91.7 | 118.4 |

Table ES-12 shows the adjusted 2015 baseline demand (in gpcd), the demand targets required to comply with SBx7-7 and the MOU, and the projected 2015 demand based on the recommended conservation portfolio.³ Projected demand in

³ The adjusted baseline demand forecast deducts expected reductions in demand due to codes/ordinances, conversion of flat rate customers to metered billing, scheduled adjustments to water rates, and past conservation program investment.

2015 under the recommended portfolio is approximately the same as 2015 SBx7-7 target and approximately 2% below the MOU Flex Track target.

Between 2015 and 2020, per capita demand will need to decrease another 11% in order for the district to meet its 2020 SBx7-7 target of 215 gpcd. Alternatively, per capita demand for the four Cal Water districts in the Tulare Lake hydrologic region will need to average no more than 222 gpcd in 2020 in order to achieve regional compliance.

Table ES-12. Selma District Recommended Portfolio Projected 2015 Demand

| Demand Projection | Demand (GPCD) | Difference from Adjusted Baseline (GPCD) |
|--------------------------|----------------------|---|
| Adjusted Baseline | 245 | |
| SBx7-7 Target | 242 | -3 |
| MOU Flex Track Target | 245 | 0 |
| Recommended Portfolio | 241 | -4 |

ES-7 Plan Monitoring and Updates

Cal Water will need to regularly review the plan and make adjustments to it as appropriate. Key monitoring and updating activities Cal Water anticipates undertaking following plan implementation include:

- Cal Water will assess and adopt conservation program tracking software to be used to track and manage its core and non-core programs.
- Cal Water will submit its initial filing for the 2014-16 GRC in July 2012. Prior to that filing, Cal Water may elect to update this plan to reflect new information and changed circumstances affecting the baseline water demands, calculated water savings targets, recommended conservation programs, projected water savings, and proposed conservation program budgets.
- Cal Water may, in conjunction with preparation of its 2015 Urban Water Management Plans, elect to update its baseline demand estimates and gpcd targets, if new information warrants doing so. Depending on the final methodology adopted by DWR for the as-yet unspecified fourth target calculation option, Cal Water may decide to update the SBx7-7 targets included in the plan using this alternative methodology.
- Cal Water may elect to update this plan to reflect a revised Flex Track target based on a CUWCC-sanctioned Flex Track target calculator, expected to be available in the first half of 2011.

- Results from studies, such as the one Cal Water and San Jose State University Research Foundation are jointly undertaking to better estimate realized water savings from converting customers from flat rate to metered billing, will be used by Cal Water to update the water savings projections contained in this plan.
- Cal Water will work with local planning and enforcement departments to ensure that its conservation programs are consistent with and complementary to local water use codes and ordinances, and may elect to modify the design or level of implementation of programs included in the plan in order to do so.
- Cal Water plans to update these plans no less frequently than every five years, in conjunction with the update and reporting cycle for the district-specific UWMPs. Plan updates may entail adjustment of existing programs and addition of new programs based on performance history, community input, and changes to state and local conservation requirements.

1 Introduction

1.1 Master Plan Scope and Objectives

California Water Service Company (Cal Water) is in the process of expanding current conservation programs and developing new programs for its 24 service districts. Over the next five years, Cal Water conservation program expenditures are likely to increase significantly. Recently adopted state policies requiring future reductions in per capita urban water use are providing much of the impetus for this effort. Primarily the passage of Senate Bill No. 7 (SBx7-7) in November 2009, which mandated a statewide 20% reduction in per capita urban water use by 2020, but also recent decisions by the California Public Utilities Commission (CPUC) directing Class A and B water utilities to adopt conservation programs and rate structures designed to achieve reductions in per capita water use, and the *Memorandum of Understanding Regarding Urban Water Conservation in California* (MOU), of which Cal Water has been a signatory since 1991. In addition, conservation will help to address local water supply constraints in some districts.

In preparing for this program expansion, Cal Water has spent the past year developing five-year conservation program plans for each of its service districts. Each district plan was developed with the following questions in mind:

- How much water conservation will each district need to implement in order to comply with state urban per capita water use targets?
- How much of this conservation requirement can be met by existing water efficiency codes and ordinances, scheduled increases in water rates, and past investment in conservation programs?
- How much of this conservation requirement will need to be met through new investments in conservation?
- Which water conservation programs at what levels of activity result in the most benefit to Cal Water ratepayers?
- Should existing programs be expanded, new programs developed, or both?
- How can conservation be used to help address local water supply constraints?
- How many conservation programs can Cal Water reasonably expect to operate given the geographic dispersion of its districts, available staffing and budgetary resources?

- How can regional partnerships be leveraged to more efficiently achieve a district's water conservation targets?

The primary objective of this planning process was the development of a set of comprehensive, service-area-specific conservation plans to guide Cal Water conservation program development and investment over the next five years. This report describes the five-year plan developed for the Selma District.

1.2 Plan Development

Plan development proceeded in phases. The first phase focused on compiling data needed for projecting future district water demand, developing per capita water use targets, and analyzing conservation programs. The data collected during this phase is used extensively throughout this report and provides the foundation for the quantitative analyses used to develop the plan's per capita water use targets and conservation program recommendations.

The next phase of plan development centered on estimating the volume of water savings the district would need to achieve over the next five years in order to satisfy SBx7-7 and MOU interim compliance requirements. Once these volumes were determined, expected water savings from existing codes and ordinances, scheduled increases in water rates, and past conservation program activity were deducted in order to determine the amount of water savings that would need to come from new conservation programs.

Using the results of the second phase as a starting point, the third phase of plan development entailed a comprehensive assessment of conservation program concepts to identify the best mix of programs to achieve the required water savings. This included soliciting input on program concepts from community stakeholders, and passing a broad universe of conservation program concepts through qualitative and quantitative screens designed to eliminate program concepts that were not good matches for Cal Water districts. Program concepts making it through the screening process were further refined and used to develop a set of core and non-core conservation programs, where core programs are those that Cal Water will offer in every district over the next five years and non-core programs are those that Cal Water will offer in some districts as needed.

To complete the plan, the recommended annual levels of activity for core and non-core programs were developed for each district. Proposed district program activity levels were informed by several considerations, as follows:

- First, minimum and maximum levels of activity for each district were established, where the minimum level sets the point below which it would not be administratively feasible or cost-effective to offer the program in the district, and the maximum level sets the point above which additional program participation would be highly uncertain given current market

penetration and district experience.

- Second, the current CPUC General Rate Case (GRC) decision for Cal Water establishes each district's conservation budget for 2011-13 as well as the maximum amount of budget each district can allocate to residential and non-residential conservation programs. Thus, the proposed program activity levels are designed so as not to violate these budgetary constraints.
- Third, the proposed program activity levels seek to achieve each district's water use targets at lowest possible cost, subject to the activity level and budgetary constraints described above.
- Lastly, any program with a benefit-cost ratio greater than one was set to its maximum activity level in 2014 and 2015, since doing so would benefit ratepayers by lowering the average cost of water service.⁴

1.3 Report Organization

The organization of this plan closely follows the analytical process described above, and, in addition to this introduction, includes the following sections:

- *Section 2, District Profile*, provides a general overview of the Selma District, including service area description, historical and projected population and service connections, historical water demand, projected water demand (without additional conservation), future water supply constraints and costs, projected water rates affecting future water use in the district.
- *Section 3, Statewide Urban Water Demand Reduction Policies*, describes the inter-related state-level policies and agreements aimed at reducing urban water use. These include: (1) recent decisions by the CPUC directing Class A and B water utilities to reduce per capita urban water demand; (2) state legislation mandating urban water suppliers to reduce per capita demand 20% by 2020; and (3) the Memorandum of Understanding Regarding Urban Water Conservation in California (MOU).
- *Section 4, Per Capita and MOU Savings Targets*, derives the reduction in demand required by 2015 in order for Selma District to achieve interim compliance with SBx7-7 and the MOU.
- *Section 5, Water Savings Required from New Programs*, calculates the volume of water savings expected from existing water efficiency codes and ordinances, scheduled increases in water rates, and past investment in

⁴ This could not be done for 2011-13 because of the annual budget constraints resulting from the current General Rate Case (GRC).

conservation programs in order to derive the amount of water savings that will be needed from new conservation program investment.

- *Section 6, Conservation Program Analysis*, describes the conservation program screening and quantitative analysis used to identify, evaluate and select conservation programs for Selma District.
- *Section 7, Portfolio Development*, describes the process used to develop the recommended conservation program portfolio for Selma District.
- *Section 8, Plan Monitoring and Updates*, describes how plan implementation will be monitored, discusses key uncertainties related to plan implementation, realization of projected water savings, and achieving the stated water savings targets, and how the plan will be updated as conditions change and new information on the effectiveness and cost of programs becomes available.

2 District Profile

2.1 Introduction

This part of the plan provides a general overview of the Selma District, including service area description, historical and projected population and service connections, historical water demand, projected water demand (without additional conservation), future water supply constraints and costs, projected water rates affecting future water use in the district.

2.2 Service Area Description

The Selma District is located in Fresno County. It is situated in the Tulare Lake hydrologic region. The district is approximately 20 miles southeast of the City of Fresno and 90 miles north of the City of Bakersfield. The district serves the City of Selma and is surrounded by unincorporated parts of Fresno County.

2.3 Population and Service Connections⁵

The Selma District is a rapidly growing district which is increasing service connections through redevelopment of existing areas and by delivering new services to undeveloped areas of Selma. The Selma system is surrounded by and includes large parcels of land used for agriculture. These parcels are being converted to urban development.

The Selma District currently serves a population of about 25,000. Over the previous ten years, the district's population has been growing at an annual rate of about 1.9%. Population growth is projected to average about 2.1% over the next ten years. By 2020, the district's population is projected to exceed 31,000. Historical and projected population for the district is shown in Table 2-1.

⁵ The population and service connection projections in this section are based on the draft final projections for the district's 2011 UWMP. Because the final UWMP projections were not available during the development of this plan, the data in this section may differ slightly from the final projections contained in the 2011 UWMP update.

Table 2-1. Selma District Historical and Projected Population

| Historical | | Projected | |
|----------------------|------------|----------------------|------------|
| Year | Population | Year | Population |
| 1999 | 20,080 | 2010 | 25,650 |
| 2000 | 20,370 | 2011 | 26,180 |
| 2001 | 20,780 | 2012 | 26,730 |
| 2002 | 21,300 | 2013 | 27,280 |
| 2003 | 22,050 | 2014 | 27,850 |
| 2004 | 22,950 | 2015 | 28,420 |
| 2005 | 23,500 | 2016 | 29,010 |
| 2006 | 24,170 | 2017 | 29,620 |
| 2007 | 23,980 | 2018 | 30,230 |
| 2008 | 24,010 | 2019 | 30,860 |
| 2009 | 24,260 | 2020 | 31,510 |
| Av. Ann. Growth Rate | 1.9% | Av. Ann. Growth Rate | 2.1% |

Selma District primarily serves single-family households, which account for about 89% of total service connections. The distribution of services by customer type for 2009 is shown in Figure 2-1. Projected services through 2020 are shown in Table 2-2. Total services are projected to increase by 45% over the next 10 years.

Figure 2-1. Selma District Distribution of Services by Customer Type

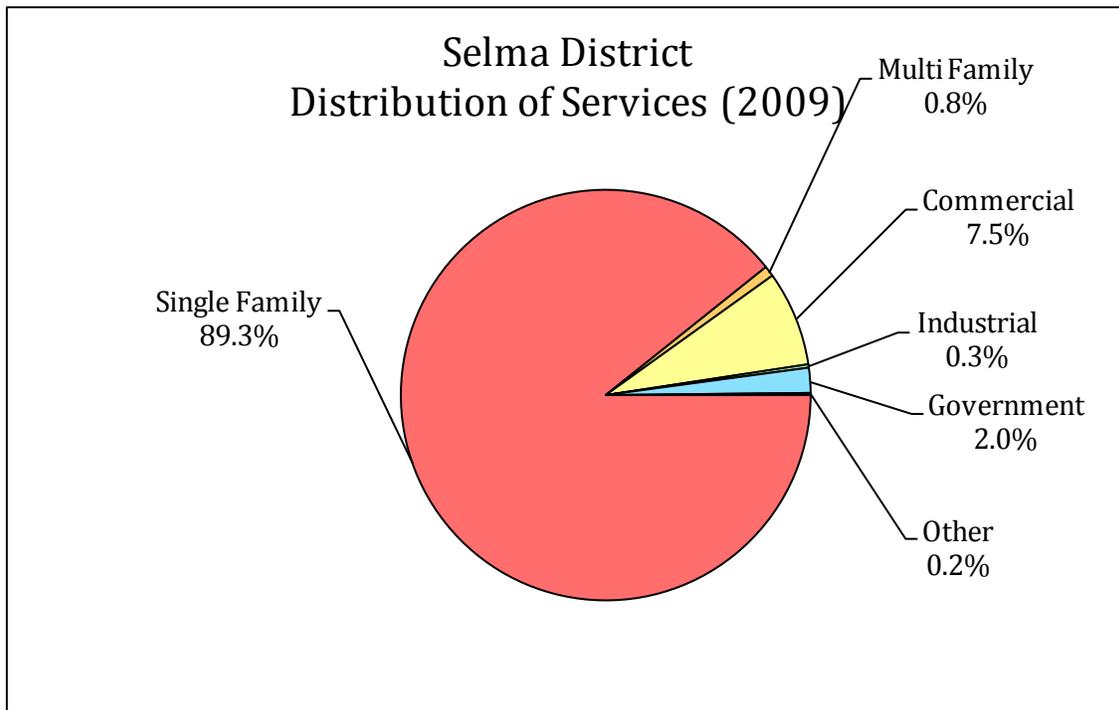


Table 2-2. Selma District Service Connections

| Customer Type | Projected Services 2010 | Projected Services 2015 | Projected Services 2020 |
|---------------------------|-------------------------|-------------------------|-------------------------|
| Single Family Residential | 6,278 | 7,638 | 9,293 |
| Multi Family Residential | 44 | 46 | 49 |
| Commercial | 498 | 529 | 563 |
| Industrial | 18 | 19 | 20 |
| Government | 103 | 110 | 116 |
| Other | 11 | 11 | 12 |
| Total | 6,952 | 8,354 | 10,053 |

2.4 Historical Water Demand

Since 2005, annual demand in the district has averaged about 6,900 AF. Historical demands by category are shown in Figure 2-2. Residential services currently account for about 75% of system demand. Demands from non-residential customer categories account for about 17%, and unaccounted water losses account for the remaining 8%. The percent of total demand in 2009 by type of use is shown in Figure 2-3.

Figure 2-2. Selma District Historical Demand


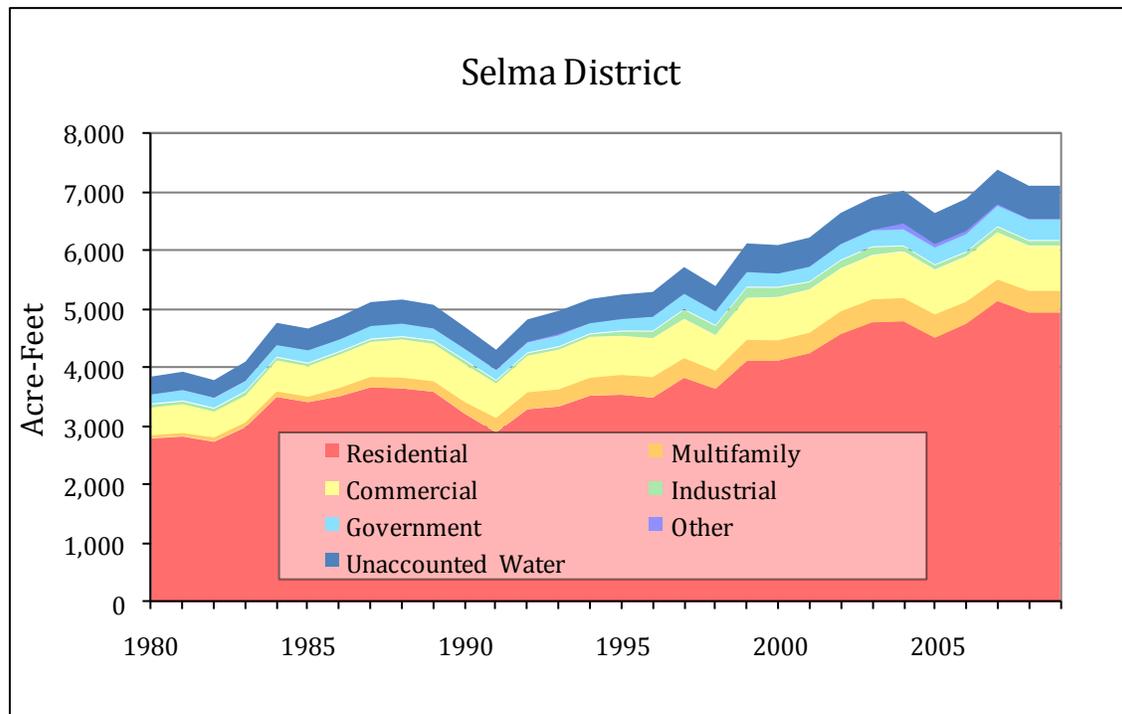



Figure 2-3. Selma District Percent of Total Demand by Type of Use

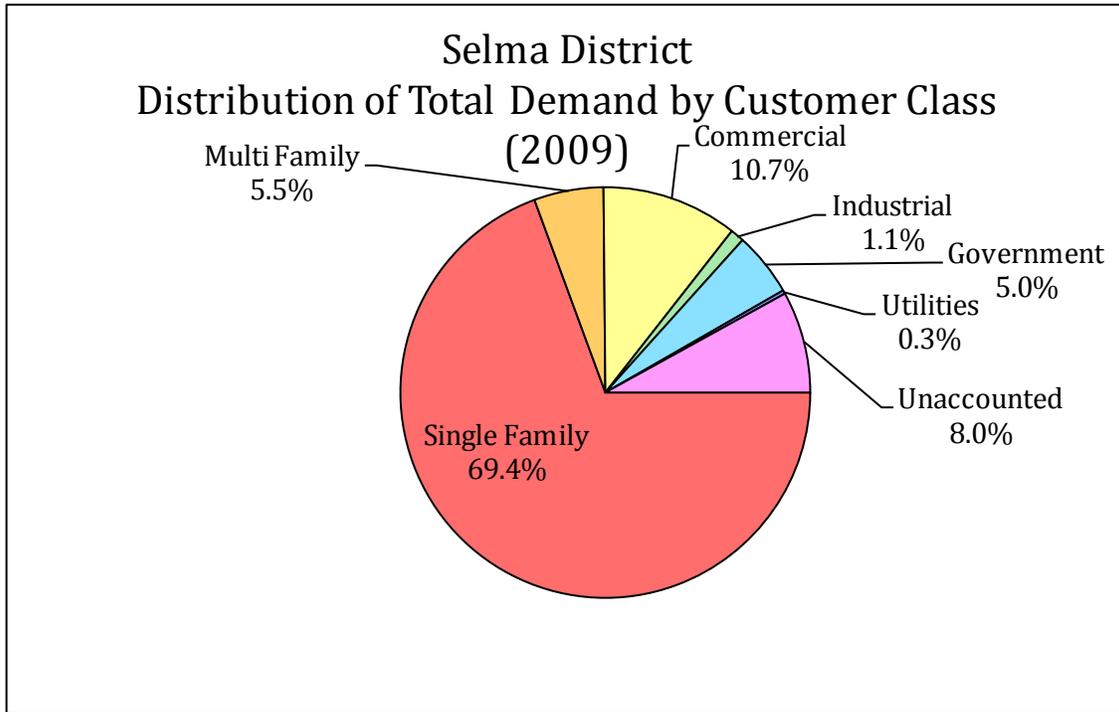

Historical per capita demand is shown in Figure 2-4.⁶ In the last five years, per capita demand has averaged 258 gallons per day. Per capita water use in the district is about 9% lower than average per capita use in the Tulare Lake hydrologic region, which the California Department of Water Resources (DWR) estimated at about 285 gallons per day.

⁶ Per capita demand is the quotient of total demand across all customer classes and the district population.

Figure 2-4. Selma District Historical Per Capita Demand

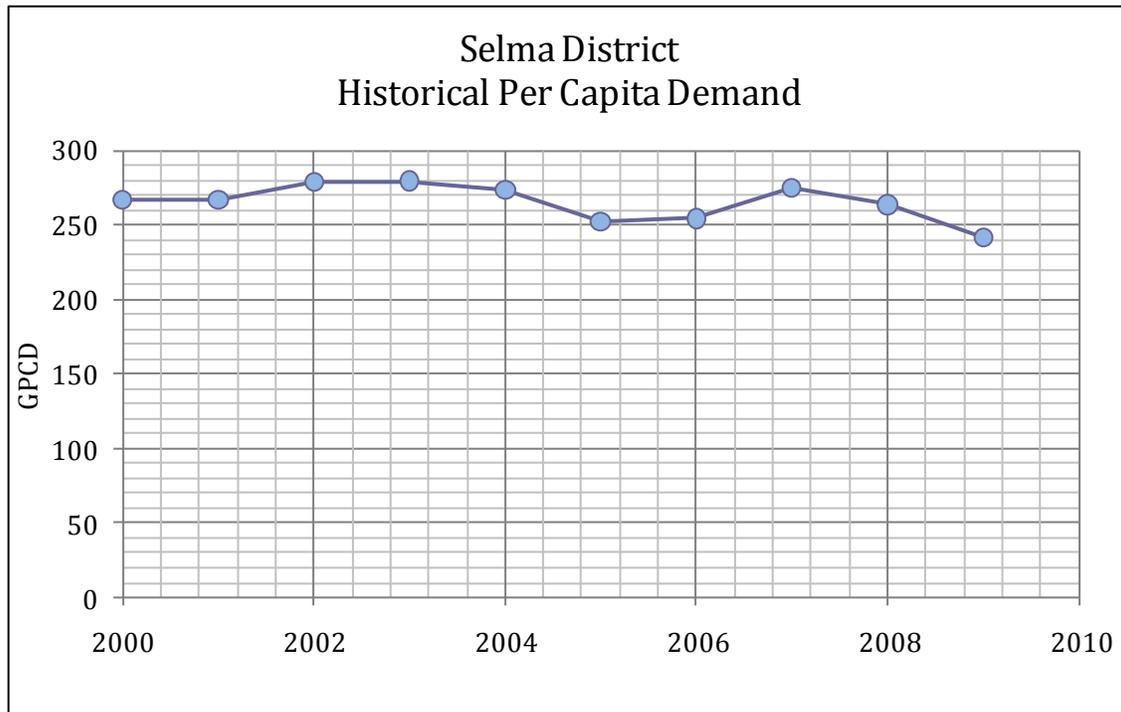

2.5 Unadjusted Baseline Water Demand Projection

The unadjusted baseline water demand projection is equal to forecasted district population multiplied by 2005-09 average GPCD. This shows expected future demand given current patterns of consumption and water use efficiency and expected population growth. The difference between the unadjusted baseline demand projection and projected demands based on SBx7-7 GPCD targets is used to establish the Plan's minimum water conservation requirements. These requirements and their derivation are presented in Section 4. The unadjusted baseline projection does not account for future changes in water demand due to the effects of plumbing fixture efficiency codes, changes in water rates, and existing conservation programs. These effects are taken into account in Section 5, resulting in an adjusted baseline from which the amount of water savings that will be required from new conservation programs in order to comply with SBx7-7 and MOU requirements can be determined.

The district's unadjusted baseline water demand projection is shown in Figure 2-5. Projected increases in demand under the unadjusted baseline are shown in Table 2-3. Under current projections of population growth, unadjusted baseline demand is expected to increase by 10.8% by 2015 and by 22.8% by 2020.

Figure 2-5. Selma District Unadjusted Baseline Demand Projection

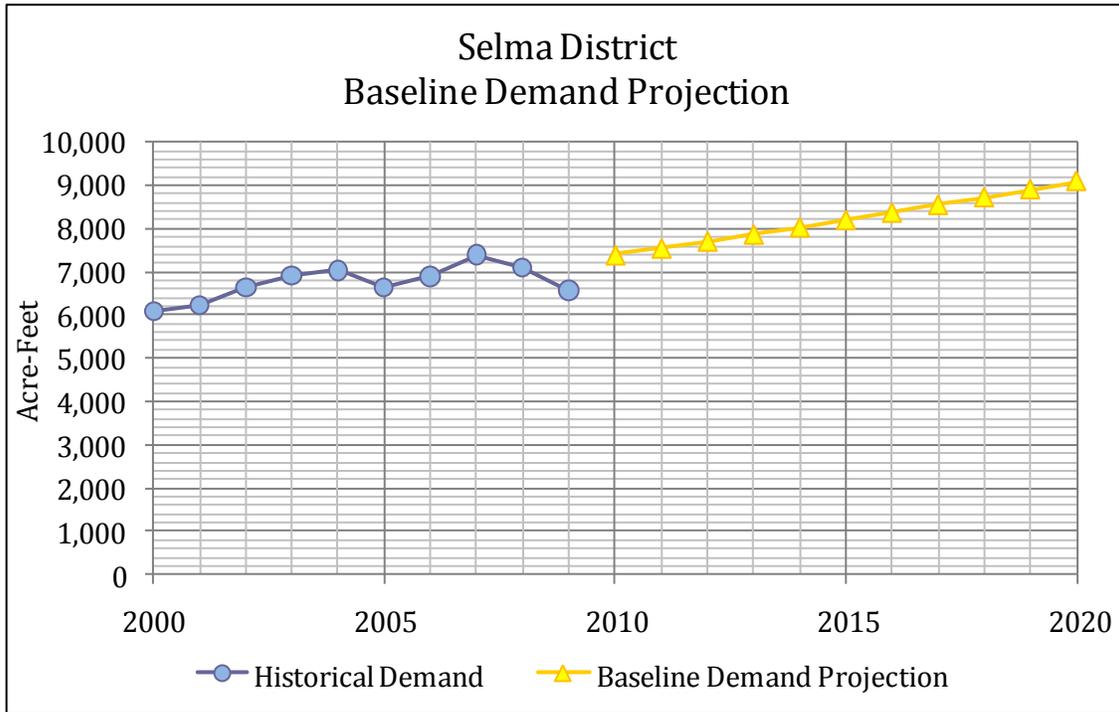


Table 2-3. Selma District Unadjusted Baseline Demand Projection

| Year | 2010 | 2015 | 2020 |
|---------------------------------|-------|-------|-------|
| Unadjusted Baseline Demand (AF) | 7,400 | 8,199 | 9,091 |
| Increase from 2010 (AF) | NA | 799 | 1,691 |
| Increase from 2010 (%) | NA | 10.8% | 22.8% |

2.6 Local Water Supply Issues

Historically, groundwater has satisfied 100% of the district’s water demand. The district has 17 groundwater wells, of which 13 are currently operational. The groundwater used by the Selma District is extracted from the aquifers of the Kings River fan that underlie the district. The downward trend in the basin’s static water levels indicates that the Kings Basin is in overdraft. In the near term, the groundwater basin appears to be adequate to meet demands; however, in the long term, the groundwater basin yield will further decline making it more difficult to meet increased future demand without offsetting actions. To date, declining water levels have had only a minor effect on well yields and production costs in the Selma District, but further declines in groundwater basin storage and levels are expected and these may negatively affect Selma well yields and pumping costs. Overdraft in the Selma area is currently estimated at 5,000 acre-feet/year. This overdraft can be attributed to Cal Water and to other pumpers in the area.

Because of the difficulty in defining an exact supply quantity available to the Selma District, the theoretical supply could be considered the amount that Cal Water has the ability to pump. The design capacity of all the active wells is currently 18,870 AFY. However, this value greatly exceeds projected water demands and it may be unrealistic to characterize this quantity as the available supply. A more conservative estimate of firm supply could be considered the total well capacity minus the largest well, and assuming 80 percent loading, yields a supply of 8,320 AFY. Based on 2009 operating records, these wells produced 6,562 AF. This brings the total supply much closer to actual demands. The excess production capacity between the design capacity and the actual annualized production is necessary in order to meet maximum day demand, peak demands, and fire flows. Above ground storage tanks are also used to satisfy peak demands. Cal Water recognizes the need for responsible management of groundwater resources and will remain committed to implementing conservation programs to minimize its pumping in the basin, and will remain supportive of the management efforts of CID. Cal Water will only pump enough water to meet the needs of its customers.

2.7 Future Water Cost⁷

As will be discussed below in Section 6, a key component of the analysis of potential water conservation programs for each district is a forecast of the district's future avoided costs of water supplies and infrastructure. Each unit of water conservation provides an economic benefit to the water utility by allowing the agency to avoid certain supply and/or infrastructure costs.

The avoided cost for each Cal Water district was estimated using the CUWCC/Water Research Foundation Avoided Cost Model. The model estimates the costs that the water utility will avoid as a result of each acre foot of water conserved. The model estimates both short run and long run avoided costs, and differentiates between water saved in the peak and off-peak seasons.⁸ Following is a description of how the avoided costs were estimated for Selma District.

2.7.1 Short-Run Avoided Costs

As water conservation programs reduce demand, less water must be purchased, produced, pumped, and/or treated. These reduced variable operating costs constitute the short-run avoided costs. To estimate the short-run avoided costs per acre-foot of reduced demand, the supplies and/or facilities that will be cut back in response to conservation-induced demand reductions (the so-called "marginal" supplies and facilities) must be identified. In the case of Selma District, the marginal supply is well water.

⁷ The district's 2010 Urban Water Management Plan provides a detailed discussion of district water supply sources and water supply management issues.

⁸ The peak season is separately specified for each district depending on district supply and demand characteristics. For Selma, the peak season includes the months of May-September.

The avoidable cost components for this supply include the power and chemical costs for pumping and treatment.

2.7.2 Long-Run Avoided Costs

In addition to the immediate reduction in variable operating costs, peak-season demand reductions may, in the long run, also enable a water supplier to defer or downsize planned future capital investments in supply and/or infrastructure capacity. For Selma District, several such projects were identified that were deemed to be deferrable in response to conservation-induced demand reductions. Thus, beginning in 2017, and based on each project’s estimated annualized capital and fixed operating costs, Selma District’s avoided costs will also include a long-run component.

Table 2-4 summarizes the Selma District avoided cost forecast.

Table 2-4. Selma District Avoided Cost Forecast

| Avoided Cost (\$/AF) | 2010 | 2020 | 2030 | 2040 |
|---|-------|-------|-------|-------|
| Short-Run | \$187 | \$187 | \$187 | \$187 |
| Long-Run ¹ | \$0 | \$340 | \$560 | \$235 |
| TOTAL | \$187 | \$527 | \$747 | \$422 |
| ¹ Long-Run costs are avoided only as a result of reductions in peak-season demand. | | | | |

2.8 Future Water Rates

Water service rates in the district are regulated by the California Public Utilities Commission (CPUC). The district files a General Rate Case with the CPUC every three years. The CPUC uses the information provided in the rate case to set rates so that the district can recover the cost of service and earn a reasonable return on its investments in the water system. The last rate case was concluded in 2010 and established rates for 2011, 2012, and 2013. The percentage increase in service rates over the prior year is shown in Table 2-5.⁹ These rate changes are incorporated into the analysis of future demand and net water saving requirements, as described in Section 5 of the plan.

Table 2-5. Selma District Nominal Change in Service Rates

| Year | 2011 | 2012 | 2013 |
|------------------------|-------|------|------|
| Change from Prior Year | 24.3% | 1.3% | 1.2% |

⁹More precisely, the increases for 2012 and 2013 show the percentage change in district revenue requirement, which may be slightly different than the percentage change in the average rate, but provide a close proxy for the expected change in volumetric rates.

3 Statewide Urban Water Demand Reduction Policies

3.1 Introduction

Inter-related state-level policies and agreements aimed at reducing urban water use have provided much of the impetus for this plan. These include: (1) recent decisions by the California Public Utilities Commission (CPUC) directing Class A and B water utilities to reduce per capita urban water demand; (2) state legislation mandating urban water suppliers to reduce per capita demand 20% by 2020; and (3) the Memorandum of Understanding Regarding Urban Water Conservation in California (MOU). This section of the plan discusses these requirements, their relationship to one another, and their relationship to Cal Water's overall conservation strategy.

3.2 CPUC GPCD Policy

The CPUC's Decision 07-05-062 directed Class A and B water utilities to submit a plan to achieve a 5% reduction in average customer water use over each three-year rate cycle. This policy was refined under Decision 08-02-036, which established a water use reduction goal of 3% to 6% in per customer or service connection consumption every three years once a full conservation program, with price and non-price components, is in place. These decisions anticipated enactment of policies by the State legislature to reduce urban water use in California 20% by 2020.

3.3 State Per Capita Water Use Policies and Targets

Senate Bill 7 (SBx7-7), which was signed into law in November 2009, amended the State Water Code to require a 20% reduction in urban per capita water use by 2020. Commonly known as the 20x2020 policy, the new requirements apply to every retail urban water supplier subject to the Urban Water Management Planning Act (UWMPA).

3.3.1 SBx7-7 GPCD Reduction Targets

SBx7-7 requires the state to achieve a 20% reduction in urban per capita water use by December 31, 2020. The state is required to make incremental progress toward this goal by reducing per capita water use by at least 10% on or before December 31, 2015. SBx7-7 requires each urban retail water supplier to develop interim and 2020 urban water use targets in accordance with specific requirements described below. Urban retail water suppliers will not be eligible for state water grants or loans unless they comply with SBx7-7's requirements.

Under SBx7-7, an urban retail water supplier may adopt one of four different methods for determining the 2020 gpcd target:

1. Set the 2020 target to 80% of average GPCD for any continuous 10-year period ending no earlier than December 31, 2004, and no later than December 31, 2010.¹⁰
2. Set the 2020 target as the sum of the following:
 - a. 55 GPCD for indoor residential water use
 - b. 90% of baseline CII water uses, where baseline CII GPCD equals the average for any contiguous 10-year period ending no earlier than December 31, 2004, and no later than December 31, 2010.
 - c. Estimated per capita landscape water use for landscape irrigated through residential and dedicated irrigation meters assuming water use efficiency equivalent to the standards of the Model Water Efficient Landscape Ordinance set forth in Section 2.7 of Division 2 of Title 23 of the California Code of Regulations.¹¹
3. Set the 2020 target to 95% of the applicable state hydrologic region¹² target, as set forth in the state's draft 20x2020 Water Conservation Plan (dated April 30, 2009).
4. A method as yet unspecified, to be determined by DWR no later than December 31, 2010.

Additionally, if baseline GPCD is greater than 100 gallons, the 2020 GPCD target can be no greater than 95% of average GPCD calculated over a continuous 5-year period ending no earlier than December 31, 2007 and no later than December 31, 2010, irrespective of the target method adopted.

3.3.2 Regional Compliance

SBx7-7 allows water suppliers to form regional alliances and set regional targets for purposes of compliance. Under the regional compliance approach, water suppliers within the same hydrologic region can comply with SBx7-7 by either meeting their individual target or being part of a regional alliance that meets its regional target.¹³ The regional target is calculated as the population-weighted average target for the water suppliers comprising the regional alliance.

¹⁰ If the supplier meets at least 10% of its retail demand with recycled water, it may extend the period for calculating average baseline GPCD by up to an additional five years.

¹¹ This method requires the use of satellite imagery, site visits, or other best available technology to develop an accurate estimate of landscaped areas served by residential and dedicated irrigation meters.

¹² California is divided into 10 hydrologic regions. A map of these regions can be viewed at: www.water.ca.gov/floodmgmt/hafoo/csc/.

¹³ Water suppliers may also form regional alliances if they are served by the same wholesale water supplier, they are members of a regional agency authorized to plan and implement water conservation, or they are part of an integrated regional water management funding area.

Importantly, being part of a regional alliance does not preclude a water supplier from complying with SBx7-7 by meeting its individual target. A water supplier that is part of a regional alliance will not comply with SBx7-7 only if the regional alliance fails to meet the regional target and the water supplier fails to meet its individual target. This provision of SBx7-7 effectively gives a water supplier that is part of a regional alliance two ways to comply. Cal Water districts sorted by hydrologic region are shown in Table 3-1. Selma District is one of four Cal Water districts within the Tulare Lake hydrologic region. For these districts, Cal Water has calculated both district-specific targets and a regional target.

Table 3-1. Cal Water Districts Sorted by Hydrologic Region

| Hydrologic Region | Cal Water Districts in Region |
|--------------------------|--|
| North Coast | Redwood Valley |
| San Francisco Bay Area | Bear Gulch, Livermore, Los Altos, Mid-Peninsula, South San Francisco |
| Central Coast | King City, Salinas |
| South Coast | Domiguez, East LA, Hermosa-Redondo, Palos Verdes, West Lake |
| Sacramento River | Chico, Dixon, Marysville, Oroville, Willows |
| San Joaquin | Stockton |
| Tulare Lake | Bakersfield, Kern River Valley, Selma , Visalia |
| North Lahontan | None |
| South Lahontan | Antelope Valley |
| Colorado River | None |

3.3.3 Cal Water SBx7-7 Compliance Strategy

Cal Water’s SBx7-7 compliance strategy involves:

1. Identifying for each district the largest allowable interim and 2020 GPCD targets under methods 1 and 3;¹⁴
2. Grouping districts by hydrologic region and calculating population-weighted regional targets where applicable; and
3. Developing conservation programs aimed at achieving the regional and/or district-specific targets.

The resulting SBx7-7 targets and required water demand reductions for Selma District are presented in Section 4 of the plan. It is important to emphasize that SBx7-7 is just one of several factors used to determine the Plan’s recommended

¹⁴ Targets based on method 2 were not considered because the data necessary to accurately estimate landscape areas served by residential and dedicated irrigation meters was not available. Method 4 had not been defined at the time this plan was developed.

level of water savings. Other factors included MOU compliance, cost-effectiveness, and district water supply and quality considerations.

3.4 Urban Water Conservation MOU

The MOU has guided urban water conservation programs in California since it was first adopted in 1991. More than 230 California urban water suppliers have signed the MOU and pledged good faith efforts to comply with its terms. Most urban water conservation programs operated by California water utilities have been shaped to some extent by MOU requirements. While compliance with the MOU is voluntary, access to some types of state funding for water resources management is conditioned on MOU compliance.¹⁵ These eligibility requirements will end July 1, 2016. After that date, access to state funding for water resources management will be conditioned on compliance with SBx7-7 requirements.

3.4.1 MOU Compliance Options

There are three ways in which a water supplier can comply with the MOU. The first way is to implement a set of water conservation best management practices (BMPs) according to the requirements and schedules set forth in Exhibit 1 of the MOU. The second way, called Flex Track compliance, is to implement conservation programs expected to save an equivalent or greater volume of water than the BMPs. The third way, similar to SBx7-7, is to reduce per capita water use. Each of these compliance options is briefly described below.

BMP Implementation Compliance

Originally, the MOU established a set of BMPs that signatories agreed to implement in good faith. For each BMP, the MOU established the actions required by the water supplier (e.g. site surveys, fixture and appliance rebates, water use budgets, volumetric pricing and conservation rate designs), the implementation schedule, and the required level of effort (in the MOU this is referred to as the coverage requirement). Additionally, the MOU established the terms by which a water supplier could opt out of implementing a BMP.

BMPs are grouped into five categories. Two categories, Utility Operations and Education, are “Foundational BMPs” because they are considered to be essential water conservation activities by any utility and are adopted for implementation by all signatories to the MOU as ongoing practices with no time limits. The remaining BMPs are “Programmatic BMPs” and are organized into Residential, Commercial, Industrial, and Institutional (CII), and Landscape categories.

¹⁵ Section 10631.5 of the California Water Code.

Table 3-2 shows the BMPs by category. The requirements and coverage levels of each BMP are set forth in Exhibit 1 of the MOU.

Flex Track Compliance

Under Flex Track, a water supplier can estimate the expected water savings over the 10-year period 2009-2018 if it were to implement the programmatic BMPs in accordance with the MOU's schedule, coverage, and exemption requirements, and then achieve these water savings through any combination of programs it desires.¹⁶ Thus, through the Flex Track compliance option, a water supplier agrees to save a certain volume of water using whatever it determines to be the best combination of programs. Because the savings target depends on the programmatic BMP coverage requirements, which in turn are functions of service area size and composition of demand, the volume of water to be saved under this compliance option must be calculated separately for each supplier. The methodologies and tools for water suppliers to implement these calculations are still being developed by the CUWCC.

GPCD Compliance

Under the GPCD option, a water supplier can comply with the MOU by reducing its baseline GPCD by 18% by 2018. The baseline is the ten-year period 1997-2006. The MOU also establishes interim GPCD targets and the highest acceptable levels of water use deemed to be in compliance with this option. The MOU's GPCD option is similar to using Method 1 to set the SBx7-7 target, except that it uses a fixed baseline period and only runs through 2018. This compliance option may be difficult to achieve for Cal Water districts that are part of a regional alliance for purposes of SBx7-7 compliance because savings as a percent of demand will vary considerably among the districts in the alliance. It may also conflict with district-specific SBx7-7 targets set using method 3 (hydrologic region-based target). Because of these potential conflicts, this is not considered a viable MOU compliance option for Cal Water districts.

3.4.2 Cal Water MOU Compliance Strategy

Cal Water plans to use Flex Track to comply with the MOU. This compliance option affords the most flexibility in selecting conservation programs suited to each Cal Water district and allows for more streamlined reporting. Because CUWCC tools for calculating a district's Flex Track savings target are not yet available, Cal Water developed its own target estimates for planning purposes, as described in Section 4. Cal Water will update these estimates as necessary following the release of the CUWCC Flex Track target calculator.

¹⁶ The supplier is required to implement the foundational BMPs regardless of which compliance option it selects.

Table 3-2. MOU Best Management Practices

| BMP Group | BMP Name |
|--|---|
| 1. Utility Operations Programs (F) | Conservation Coordinator |
| | Water Waste Prevention |
| | Wholesale Agency Assistance Programs |
| | Water Loss Control |
| | Metering & Volumetric Rates |
| | Retail Conservation Pricing |
| 2. Education Programs (F) | Public Information Programs |
| | School Education Programs |
| 3. Residential (P) | Residential Assistance Program |
| | Landscape Water Surveys |
| | High Efficiency Clothes Washer Program |
| | Watersense Toilet Program |
| | Watersense Specifications for Residential Development |
| 4. Commercial, Industrial, Institutional (P) | Reduce baseline CII water use by 10% in 10 years |
| 5. Landscape (P) | Large Landscape Water Budget Programs |
| | Large Landscape Water Surveys |
| <p>F = Foundational BMP, P = Programmatic BMP BMP definitions, coverage requirements, and schedule of implementation are contained in the MOU (www.cuwcc.org).</p> | |

4 SBx7-7 and MOU Savings Targets

4.1 Introduction

This section of the plan presents the SBx7-7 and MOU compliance targets for Selma District. For district-specific SBx7-7 compliance, targets were set to either 80% of baseline GPCD or 95% of the district's hydrologic region target, whichever was greater. For MOU compliance, the Flex Track target was calculated as the volume of expected water savings from cost-effective programmatic BMPs over the 10-year period 2009 - 2018.

4.2 SBx7-7 Target Calculation

Table 4-1 shows the SBx7-7 target calculation for Selma District. This table shows: (1) the maximum allowable target under SBx7-7, (2) the target based on Method 1 – 80% of baseline water use, (3) the target based on Method 3 – 95% of the hydrologic region target, and (4) the selected target for the district.

Maximum Allowable Target

As described in Section 3, the SBx7-7 target for 2020 cannot exceed 95% of the district's five-year baseline water use, where the baseline period ends no earlier than December 31, 2007 and no later than December 31, 2010. The district's 2020 target cannot exceed this level, regardless of which method is used to calculate it. In the case of Selma District, neither target calculation method results in a target exceeding the maximum allowable target, so no adjustment is necessary.

Method 1 Target

Under Method 1, the 2015 and 2020 targets are set to 90% and 80% of baseline water use, respectively. Baseline water use is the average water use for any continuous 10-year period ending between 2004 and 2010. For Selma District, the 10-year base period 1999-2008 yielded the maximum target under this method. The 2015 target is 242 gpcd and a 2020 target is 215 gpcd.

Method 3 Target

Under Method 3, the 2015 and 2020 targets are set to 95% of the 2015 and 2020 targets for the hydrologic region in which the district is located. Selma District is located in the Tulare Lake hydrologic region. The 2015 target is 225 gpcd and the 2020 target is 179 gpcd.


Selected District Target

For Selma District, SBx7-7 non-compliance risk is minimized by selecting the Method 1 targets. Figure 4-1 shows projected per capita demand based on the last five-years of district sales data and how it would need to change in order to meet the SBx7-7 targets.

Table 4-1. Selma District SBx7-7 GPCD Targets

| | |
|---|-------------|
| Maximum Allowable Target | |
| Base Period: | 2003-2007 |
| Per Capita Water Use: | 267 |
| Maximum Allowable 2020 Target: | 254 |
| Method 1: 80% of Baseline Per Capita Daily Water Use | |
| Base Period: | 1999-2008 |
| Per Capita Water Use: | 269 |
| 2015 Target: | 242 |
| 2020 Target: | 215 |
| Method 3: 95% of Hydrologic Region Target | |
| Hydrologic Region: | Tulare Lake |
| 2015 Target: | 225 |
| 2020 Target: | 179 |
| Selected District Target | |
| 2015 Target: | 242 |
| 2020 Target: | 215 |

Figure 4-1. Selma District SBx7-7 Per Capita Target Demand

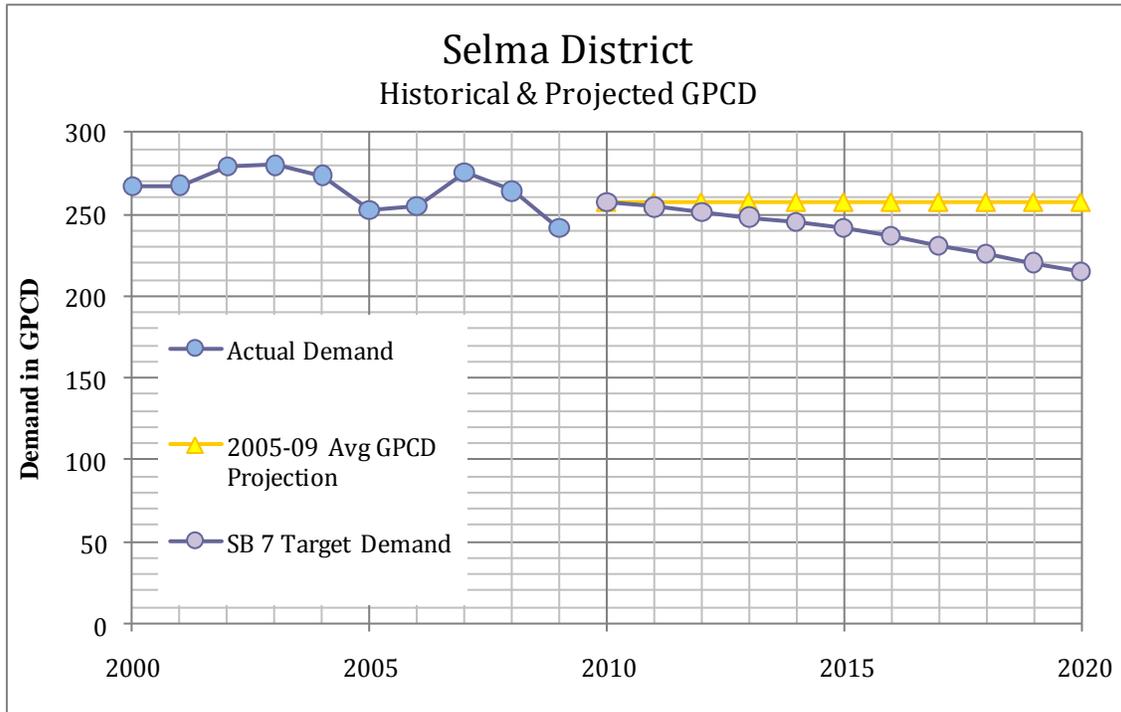

Regional Alliance Target

As discussed in Section 3, water suppliers within the same hydrologic region can form a regional alliance for purposes of SBx7-7 compliance. This gives them two ways to comply with SBx7-7 – they will be in compliance as long as their per capita demand is less than or equal to the district-specific target or the weighted average per capita demand of the regional alliance is less than or equal to the regional target. As shown in Table 4-2, this means that Selma District will be in compliance in 2015 if its per capita demand is less than or equal to 242 gpcd, or average per capita demand for the regional alliance is less than or equal to 250 gpcd.

Table 4-2. Regional SBx7-7 Targets for Cal Water Districts in Tulare Lake HR

| District | Population | 2015 Target (GPCD) | 2020 Target (GPCD) |
|-------------------------------------|------------|--------------------|--------------------|
| Bakersfield | 252,010 | 268 | 239 |
| Kern River Valley | 6,359 | 190 | 179 |
| Selma | 24,260 | 242 | 215 |
| Visalia | 132,930 | 219 | 194 |
| Regional Targets¹ | | 250 | 222 |

¹ Regional targets are the population-weighted average of the district targets.

4.3 MOU Flex Track Target Calculation

As discussed in Section 3, because CUWCC tools for calculating a district's Flex Track savings target are not yet available, Cal Water developed its own target estimates for planning purposes. The targets are based on the expected water savings from cost-effective programmatic BMPs over the ten-year period 2009-2018. The coverage requirements for the programmatic BMPs listed in Table 4-3 were used to calculate the Flex Track targets. Expected water savings and cost-effectiveness were based on the conservation program specifications presented in Section 6 and avoided water supply costs presented in Section 2. The resulting 2015 Flex Track target for Selma District is shown in Table 4-4.

Table 4-3. Programmatic BMPs Used to Calculate Flex Track Target

| BMP No. | Coverage Requirement Used to Calculate Water Savings |
|---|---|
| 3.1 <i>Residential Assistance</i> | Provide leak detection assistance to an average of 1.5 percent per year of current single-family accounts and 1.5 percent per year of current multi-family units during the first ten years after signing the MOU. After completing the ten-year 15 percent target, agencies will maintain a program at the level of high-bill complaints or not less than 0.75 percent per year of current single-family accounts and 0.75 percent per year of current multi-family units. Showerhead distribution will be considered complete when 75 percent market saturation is achieved. |
| 3.2 <i>Landscape Water Surveys</i> | Provide landscape water surveys to an average of 1.5 percent per year of current single-family accounts during the first ten years after signing the MOU. After completing the ten-year 15 percent target, agencies will maintain a program at the level of high-bill complaints or no less than 0.75 percent per year of current single-family accounts. |
| 3.3 <i>High Efficiency Clothes Washer Incentives</i> | Provide financial incentives for the purchase of HECWs that meet an average water factor value of 5.0. If the WaterSense Specification is less than 5.0, then the water factor value will decrease to that amount. Incentives shall be provided to 0.9 percent of current single-family accounts during the first reporting period following BMP implementation, rising to 1.0 percent per year of current single-family accounts for the remainder of ten year period following signing of the MOU. An alternative method is to demonstrate 1.4 percent per year of the market penetration during the first ten years after signing the MOU. |
| 3.4 <i>WSS Toilet Incentives</i> | A financial incentive shall continue to be offered for toilets meeting the current WSS and updated standard whenever a more efficient toilet is identified by WSS. Compliance will entail demonstrating a number of toilet replacements of 3.5 gpf or greater, toilets at or above the level achieved through a retrofit on resale ordinance until 2014, or a market saturation of 75% is demonstrated, whichever is sooner. |
| 4.0 <i>CII Water Use Reduction</i> | Implement measures to achieve the water savings goal for CII accounts of 10% of the baseline water use over a 10-year period. Baseline water use is defined as the water consumed by CII accounts in the agency's service area in 2008. Credit for prior activities, as reported through the BMP database, will be given for up to 50% of the goal; in this case, coverage will consist of reducing annual water use by CII accounts by an amount equal to the adjusted percentage goal within 10 years. |
| 5.1 <i>Dedicated Irrigation Account Budgets</i> | ETo-based water use budgets developed for 90% of CII accounts with dedicated irrigation meters at an average rate of 9% per year over 10 years. |
| 5.2 <i>Non Residential Landscape Surveys</i> | Complete irrigation water use surveys for not less than 15% of CII accounts with mixed-use meters and un-metered accounts within 10 years of the date implementation is to commence. (Note: CII surveys that include both indoor and outdoor components can be credited against coverage requirements for both the Landscape and CII BMPs.) |

Table 4-4. Selma District 2015 MOU Flex Track Target

| BMP | 2015 Savings at Full Coverage | Cost-Effective¹ | 2015 Target Contribution |
|--|--------------------------------------|-----------------------------------|---------------------------------|
| BMP 3.1 Residential Assistance Savings - Single Family | 6.4 AF | FALSE | 0.0 AF |
| BMP 3.1 Residential Assistance Savings - Multi Family | 0.7 AF | FALSE | 0.0 AF |
| BMP 3.2 Landscape Surveys - Single Family | 7.8 AF | FALSE | 0.0 AF |
| BMP 3.3 High Efficiency Clothes Washers | 10.1 AF | FALSE | 0.0 AF |
| BMP 3.4 WSS Toilets - Single Family | 22.4 AF | FALSE | 0.0 AF |
| BMP 3.4 WSS Toilets - Multi Family | 4.8 AF | TRUE | 4.8 AF |
| BMP 4.0 CII Reduction | 84.0 AF | 5.7 AF | 5.7 AF |
| BMP 5.1 Dedicated Irrigation Account Budgets ² | 0.0 AF | NA | NA |
| BMP 5.2 Non Residential Landscape Surveys | 6.4 AF | FALSE | 0.0 AF |
| 2015 Flex Track Target | | | 10.5 AF |
| ¹ True or false, except BMP 4.0 CII Reduction, which shows the calculated volume of cost-effective CII water savings based on the conservation program analysis presented in Section 6. Cost-effectiveness based on avoided water supply costs presented in Section 2 and the conservation program savings and cost assumptions presented in Section 6. ² District does not have dedicated irrigation accounts. | | | |

4.4 Difference from Unadjusted Baseline Water Use

The differences between the unadjusted baseline demand, district-specific SBx7-7 target, and MOU Flex Track target are shown in Table 4-5. This shows the maximum amount of water savings needed for SBx7-7 compliance, as well as the savings required for MOU compliance. Because Selma District is part of a regional alliance, the amount of water savings needed for SBx7-7 compliance may turn out to be less than the amount shown in the table. Also, as will be discussed in the next section, some of reduction in baseline demand needed to achieve SBx7-7 and MOU compliance will come from efficiency codes, conversion of flat rate customers to metered billing, response to adjustments in rates, and savings from past program implementation. Any residual will need to come from new conservation program activity, as will be addressed in Sections 6 and 7 of the plan.

Table 4-5. Selma District Gross Savings Required for SBx7-7 and MOU Compliances

| Gross Water Savings Required by 2015 | SBx7-7 | MOU Flex Track |
|---|---------------|-----------------------|
| 2015 Unadjusted Baseline Demand | 8,199 AF | 8,199 AF |
| 2015 Target Demand | 7,695 AF | 8,189 AF |
| Gross Savings Requirement | 504 AF | 10 AF |

5 Water Savings Required from New Programs

5.1 Introduction

In Section 4 the gross water savings Selma District needs to realize by 2015 in order to satisfy SBx7-7 and MOU compliance requirements were presented. In this section, the volume of water savings that can reasonably be expected from existing efficiency codes, conversion of flat rate customers to metered billing, water rate adjustments, and past conservation program implementation is considered. The results are used to adjust baseline demand so that the volume of water savings that will need to come from new conservation programs can be determined.

5.2 Expected Savings from Efficiency Codes

Two recent California laws are expected to accelerate the replacement of low efficiency plumbing fixtures – primarily toilets and showerheads – with higher efficiency alternatives.¹⁷

- AB 715, passed in 2007, amended the California Building and Safety Code to require by January 1, 2014, that toilets sold or installed in California use no more than 1.28 gallons per flush.¹⁸ It also requires that urinals sold or installed use no more than 0.5 gallons per flush.¹⁹
- SB 407, passed in 2009, amended the California Civil Code to require replacement of low efficiency plumbing fixtures with higher efficiency alternatives when a property undergoes alterations, improvements, or transfer.²⁰ In the case of single-family residential properties, issuance of a certificate of final completion and occupancy or final permit approval by the local building department for building alterations or improvements will be conditional on the replacement of low efficiency plumbing fixtures beginning in 2014. Single-family property owners are required by law to replace any remaining non-compliant plumbing fixtures by no later than January 1, 2017.

¹⁷ Cities and counties also are required, under AB 1881, to adopt water efficient landscape design ordinances at least as effective as the state's model landscape ordinance. The extent and variability of landscape water use in the service area, as well as uncertain enforcement of ordinance requirements by the relevant city or county, make projections of potential water savings highly uncertain and therefore they are not incorporated into the forecast of potential water savings from efficiency codes.

¹⁸ State law currently prohibits the sale and installation of toilets using more than 1.6 gallons per flush.

¹⁹ State law currently prohibits the sale and installation of urinals using more than 1.0 gallon per flush.

²⁰ Non compliant plumbing fixtures include any toilet manufactured to use more than 1.6 gallons per flush, any showerhead manufactured to have a flow capacity more than 2.5 gallons per minute, and any interior faucet that emits more than 2.2 gallons per minute. Compliant water conserving plumbing fixtures means any fixture that is in compliance with current building standards applicable to a newly constructed real property of the same type.

After this date, a seller or transferor of single-family residential real property must disclose in writing to the prospective purchaser or transferee whether the property includes any noncompliant plumbing fixtures. For multi-family and commercial properties non-compliant fixtures must be replaced by January 1, 2019. As with single-family properties, final permits or approvals for alterations or improvements are conditional on the replacement of low efficiency fixtures beginning in 2014.²¹

The phase-in dates for AB 715 and SB 407 mean they will not greatly contribute to meeting the 2015 interim GPCD target under SBx7-7. But they will support meeting the 2020 target. Moreover, since the early 1990's, the sale and installation of toilets manufactured to flush more than 1.6 gallons, showerheads manufactured to have a flow capacity more than 2.5 gallons per minute, and interior faucets manufactured to emit more than 2.2 gallons per minute has been prohibited. These requirements will continue to improve the efficiency of plumbing fixtures in older residential and commercial buildings.

Expected code-driven water savings for the period 2011-2015 are shown in Table 5-1. These estimates incorporate existing plumbing code requirements, as well as the full phase-in of AB 715 requirements starting in 2014.

Table 5-1. Selma District 2011-2015 Code-Driven Water Savings

| Code-Driven Water Savings (AF) | 2011 | 2012 | 2013 | 2014 | 2015 |
|---------------------------------------|-------------|-------------|-------------|-------------|-------------|
| Toilets | | | | | |
| Single Family | 6.5 | 12.8 | 19.0 | 24.9 | 34.5 |
| Multi Family | 0.6 | 1.2 | 1.7 | 2.2 | 3.0 |
| Non Residential | 1.4 | 2.8 | 4.2 | 5.5 | 7.3 |
| <i>Subtotal Toilets</i> | <i>8.6</i> | <i>16.9</i> | <i>24.9</i> | <i>32.7</i> | <i>44.9</i> |
| Showerheads | | | | | |
| Single Family | 1.4 | 2.6 | 3.7 | 4.8 | 5.7 |
| Multi Family | 0.1 | 0.3 | 0.4 | 0.5 | 0.6 |
| <i>Subtotal Showerheads</i> | <i>1.5</i> | <i>2.9</i> | <i>4.1</i> | <i>5.3</i> | <i>6.3</i> |
| Total Savings | 10.1 | 19.7 | 29.0 | 37.9 | 51.2 |

²¹ In the case of multi-family and commercial property, the permit approval requirements apply only if (a) the improvements would increase building floor area by more than 10%, or (b) the value of the improvements exceed \$150,000, or (c) the improvements are in a room containing non-compliance plumbing fixtures.

5.3 Expected Savings from Rates

Water savings from expected rate adjustments in Selma District were also calculated. The estimates are based on inflation-adjusted changes in rates for 2011, 2012, and 2013, as contained in CPUC’s proposed GRC decision. Short-run price elasticity estimates used to calculate potential changes in demand were drawn from the CUWCC’s conservation rate guidebook.²² Expected water savings from the proposed rate adjustments are shown in Table 5-2.²³

Table 5-2. Selma District 2011-2015 Water Savings from Proposed Rate Adjustment

| Rate-Driven Water Savings (AF) | 2011 | 2012 | 2013 | 2014 | 2015 |
|--|-------------|-------------|-------------|-------------|-------------|
| <i>% Change in Inflation-Adjusted Water Rate¹</i> | 21% | -2% | -2% | NA | NA |
| Expected Savings | 33.4 | 64.4 | 92.1 | 86.4 | 73.4 |

¹Percent change does not include adjustments to the future costs of purchased water, assessments charged for pumping groundwater, electricity, and other costs generally beyond Cal Water’s control. Additionally, some water system improvements approved by the CPUC will not be included in rates until they are completed and are in service.

5.4 Expected Savings from Current Programs

In addition to savings from codes and rates, expected on-going water savings from conversion of flat rate customers to metered billing plus conservation program activity occurring in 2009 and 2010 were also taken into account. These savings are shown in Table 5-3.²⁴

²² California Urban Water Conservation Council, “Designing, Evaluating, and Implementing Conservation Rate Structures,” July 1997, p. 8-18. Price elasticity measures the expected percentage change in demand given a one percent change in price. For example, an elasticity of -0.25 indicates that a one percent increase in price would be expected to result in a 0.25 percent decrease in demand.

²³ The savings estimates in the table were derived using the methodology and assumptions contained in *Rebuttal to DRA’s Report on the Conservation Expenditures of California Water Service Company (California Water Service Company Application 09-07-001)*, prepared by David Mitchell and Gary Fiske, March 29, 2010.

²⁴ Estimated savings from 2009 and 2010 meter conversion and conservation program activity are taken from the report *Achieving Conservation Targets: Conservation Program Recommendations and Budgets for California Water Service Company Districts: Test Years 2011 through 2013*, prepared by M.Cubed, Gary Fiske and Associates, and A&N Technical Services, June 2009.

Table 5-3. Selma District Water Savings from Meter Conversion and 2009-10 Conservation Programs

| Existing Program and Metering Savings (AF) | 2011 | 2012 | 2013 | 2014 | 2015 |
|---|-------------|--------------|--------------|--------------|--------------|
| Existing Programs: 2009-10 | 9.5 | 9.4 | 9.3 | 8.7 | 8.1 |
| Metering: 2009-10 | 58.1 | 58.1 | 58.1 | 58.1 | 58.1 |
| Metering: 2011-15 | 29.1 | 58.2 | 111.4 | 164.6 | 217.9 |
| Total Existing Programs and Metering | 96.6 | 125.6 | 178.8 | 231.4 | 284.1 |

5.5 Adjusted Baseline Demand

The adjusted baseline demand is calculated by deducting expected savings from codes, rates, and past programs from the unadjusted demand projection presented in Section 2. The adjusted baseline demand is shown in Table 5-4.

Table 5-4. Selma District Adjusted Baseline Demand Projection

| Adjusted Baseline (AF) | 2011 | 2012 | 2013 | 2014 | 2015 |
|--------------------------------------|--------------|--------------|--------------|--------------|--------------|
| Unadjusted Baseline | 7,553 | 7,712 | 7,871 | 8,035 | 8,199 |
| Less Savings from | | | | | |
| Codes | 10 | 20 | 29 | 38 | 51 |
| Schedule Rate Increases | 33 | 64 | 92 | 86 | 73 |
| Existing Programs & Meter Conversion | 97 | 126 | 179 | 231 | 284 |
| Adjusted Baseline Demand | 7,413 | 7,502 | 7,571 | 7,679 | 7,791 |
| Per Capita (GPCD) | 253 | 251 | 248 | 246 | 245 |

5.6 Water Savings Needed from New Programs

The amount of water savings required from new conservation programs is not the same for SBx7-7 and MOU Flex Track compliance. In the case of SBx7-7, the objective is to reduce 2015 per capita water use at least to the target in Table 4-1, and any expected savings from codes, rates, and existing conservation programs can be credited toward meeting this goal. This is not the case for MOU Flex Track compliance, where the objective is to implement conservation programs that would save at least as much as the Flex Track target. Unlike SBx7-7, water savings from codes, conversion to metered billing, and rates cannot be credited against the Flex Track target. Only savings from existing conservation programs can be deducted.

Savings required from new conservation programs to meet SBx7-7 and MOU Flex Track compliance requirements are summarized in Table 5-5. In the case of SBx7-7, expected savings from codes, rates, and existing programs fall short of the 2015 gross savings requirement by about 96 AF and new program savings would need to reach this level to achieve district-specific SBx7-7 compliance in 2015. Approximately 2 AF of additional water savings are required by 2015 in order for the district to meet its MOU Flex Track target.

Table 5-5. Selma District New Program Savings Required for SBx7-7 and MOU Compliance

| 2015 Net Savings Requirement (AF) | SBx7-7 | MOU Flex Track |
|--|------------|----------------|
| Gross Savings Requirement (Tbl 4-4) | 504 | 10 |
| Less | | |
| Savings from codes (Tbl 5-1) | 51 | NA |
| Savings from rates (Tbl 5-2) | 73 | NA |
| Savings from existing programs (Tbl 5-3) | <u>284</u> | <u>8</u> |
| <i>Subtotal Expected Savings</i> | <i>409</i> | <i>8</i> |
| Savings Required from New Programs | 96 | 2 |

Table 5-6 compares the adjusted baseline demand in gpcd to the 2015 SBx7-7 and MOU Flex Track Targets. Adjusted baseline demand is about 3 gpcd greater than the district's 2015 SBx7-7 target and about the same as its 2015 Flex Track target.

Table 5-6. Selma District 2015 GPCD Required for SBx7-7 and MOU Compliance

| Demand Projection | Demand (GPCD) | Difference from Adjusted Baseline (GPCD) |
|-----------------------|---------------|--|
| Adjusted Baseline | 245 | |
| SBx7-7 Target | 242 | -3 |
| MOU Flex Track Target | 245 | 0 |

While the forgoing analysis indicates that Selma District requires only a modest amount of additional water savings for SBx7-7 or MOU compliance in 2015, this depends to a large extent on the realization of estimated water savings from converting flat rate customers to metered billing plus the scheduled changes in rates.

If these savings turn out to be less than estimated, the district will require additional conservation program savings for compliance.²⁵ Moreover, additional conservation is needed to help with groundwater overdraft and groundwater quality issues confronting the district. The next two sections of the plan describe the analyses undertaken to identify the best mix of new conservation programs to meet these district demand management objectives.

²⁵ Cal Water and San Jose State University Research Foundation are jointly undertaking a study of realized water savings from converting customers from flat rate to metered billing. This study is expected to commence in early 2011. Results from studies such as this one will be used by Cal Water to update the water savings projections contained in this plan.

6 Conservation Program Analysis

6.1 Introduction

Cal Water engaged in a detailed, multi-step process to identify the best mix of programs to achieve the required savings. The process began with an inclusive universe of potential program concepts. These concepts were qualitatively analyzed to eliminate those that were clearly inappropriate for each district and thereby narrow the analytical focus to those remaining programs that were potentially appropriate. Those programs were then subjected to detailed quantitative analysis. This Section describes the steps of the analytical process for Selma District, and the programs that emerged as potential components of a portfolio of programs for the district. Section 7 will then describe the process of creating this portfolio.

6.2 Conservation Program Concepts

As a result of an exhaustive search of the literature, consultation with experts in the field, knowledge of conservation programming by other water suppliers, and the experience of the project team, a universe of more than 75 conservation program concepts was defined. At this point in the process, the goal was to be as inclusive as possible. The list was therefore intentionally large to ensure that all possible program concepts were considered. Cal Water did not want to risk inadvertently excluding a program from consideration.

For the purposes of this plan, a conservation program concept is comprised of two components:

- Targeted technologies or changes in customer behavior; and
- A delivery mechanism by which customers will be encouraged (or required) to adopt the technology(ies) or change their behavior. Key delivery mechanisms that apply to one or more measures/technologies include:
 - **Customer rebates or vouchers.** Customers who choose to participate in the program receive either cash rebates upon suitable evidence of purchase and/or installation or vouchers that can be used to purchase the water efficient device or fixture.
 - **Vendor, distributor and contractor incentives.** Instead of providing incentives to customers, they are provided to 'upstream' entities such as vendors, distributors, or contractors to encourage them to promote water-efficiency devices or fixtures.
 - **Retrofit/conversion on resale ordinance.** Prior to sale of a property, the seller must retrofit or convert to the designated water-efficient technology.

- **Direct distribution.** Devices or fixtures are directly provided to eligible customers at designated sites, either by the utility or by vendors or distributors.
- **Direct install.** Devices or fixtures are delivered and installed at the customer premises.
- **New construction ordinance.** All specified categories of new construction are required to include the designated technology(ies).
- **Audits/Surveys.** These are customer-specific assessments, focused on a particular technology, to determine whether and how that technology is applicable to the customer and the volume of water that might be saved. These audits are to be distinguished from the more general audits and surveys, which are designed to identify a variety of water savings opportunities.
- **Customized incentives.** Unlike the rebate and voucher incentives described above, these incentives are tailored to each customer based on the results of an audit.
- **Mandatory operating standards.** Designated types of equipment are required to be operated in particular ways to reduce water usage.
- **Demonstration.** For new technologies, demonstration projects can be implemented to gather information about their more general applicability.
- **Utility system maintenance.** Water savings from these measures come from enhancements to the utility's own delivery system. Unlike the other mechanisms, this one is not associated with individual customers and occurs on the utility's side of the meter.

Each program may apply to multiple customer classes (Single Family, Multi-Family, Commercial/ Industrial/Institutional, and Large Landscape).

The universe of program concepts, shown in Table 6-1, Table 6-2, and Table 6-3, includes programs targeting indoor, outdoor, and general end-uses. It includes programs that have been successfully implemented by many other utilities as well as programs that do not have such a history. It includes some programs for which there is a considerable amount of available savings and cost data, and others for which little or no such data exists.

Table 6-1. Selma District Indoor Conservation Program Concepts

| Technology/Intervention | Delivery Mechanism | Single Family | Multi-Family | CII |
|--|---|---------------|--------------|-----|
| HE Toilets | Customer rebates or vouchers | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x |
| | Retrofit on resale ordinance | x | x | x |
| | Direct distribution (by utility, community group, vendor) | x | x | x |
| | Direct install | x | x | x |
| Urinals | Customer rebates or vouchers | | | x |
| | Vendor, distributor & contractor incentives | | | x |
| | Retrofit on resale ordinance | | | x |
| | Direct distribution (by utility or vendor) | | | x |
| | Valve replacement | | | x |
| Clotheswashers: in-unit, common area, & coin-op | Customer rebates & vouchers | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x |
| | New construction ordinance | | x | x |
| Industrial laundries | Audits | | | x |
| | Customized incentives | | | x |
| Showerhead (2.0, 1.5 gpm)/ flapper/aerators | Kit distribution or install | x | x | x |
| Showerhead (1.5 gpm) | Customer rebates or vouchers | x | x | x |
| Shower timers, Reminder cards | Direct distribution | x | x | x |
| Faucets (reduced flow, auto shut-off) | Customer rebates or vouchers | x | x | x |
| Hot Water recirculation, point-of-use, or demand Systems | Customer rebates or vouchers | x | x | x |
| | Retrofit on resale ordinance | x | x | x |
| | New construction ordinance | x | x | x |
| Hot water pipe insulation | Retrofit on resale ordinance | x | x | x |
| | New construction ordinance | x | x | x |
| Cooling Towers | Customer rebates, customized incentives | | | x |
| Food Steamers | Customer rebates | | | x |
| Ice Machines | Customer rebates | | | x |
| Steam Sterilizers | Customer rebates | | | x |
| Vacuum Pumps | Customer rebates | | | x |
| Car Washes | Mandatory operating standards | | | x |
| | Customer rebates | | | x |
| | Audits | | | x |
| Dishwashers | Customer rebates or vouchers | x | x | x |
| | New construction ordinance | | x | x |
| | Vendor, distributor & contractor incentives | x | x | x |
| Spray valves | Direct install | | | x |
| | Customer rebates | | | x |

Selma District Conservation Master Plan: 2011-2015

| Technology/Intervention | Delivery Mechanism | Single Family | Multi-Family | CII |
|--|------------------------------|---------------|--------------|-----|
| | Audits | | | x |
| Sensor-operated faucets | Customer rebates or vouchers | | | x |
| Plan requirement (indoor & outdoor) | New construction ordinance | x | x | x |
| Self-generating water softener replacement | Customer rebates | x | x | x |
| | Operating restrictions | x | x | x |
| X Ray film & photo processors | Customer rebates | | | x |
| Industrial process | Audits & incentives | | | x |
| Wet cleaning systems | Customer rebates | | | x |
| Evaporative Coolers | Customer rebates | x | x | X |
| An "x" indicates the program could be offered to the indicated customer class. | | | | |

Table 6-2. Selma District Outdoor Conservation Program Concepts

| Technology/Intervention | Delivery Mechanism | CUSTOMER CLASS | | | |
|---|---|----------------|--------------|-----|-----------|
| | | Single Family | Multi-Family | CII | Lg Lndscp |
| Large Landscape Surveys | | | | | x |
| WBIC | Direct Install | x | x | x | x |
| | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| | Direct distribution | x | x | x | x |
| Irrigation System (including, but not limited to, high efficiency nozzles for pop-up heads, drip, soil moisture sensors, rain shut off, pressure control) | New construction ordinance | x | x | x | x |
| | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| | Retrofit on resale ordinance | x | x | x | x |
| Landscape design | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| | Conversion on resale ordinance | x | x | x | x |
| | New construction ordinance | x | x | x | x |
| Turf buy back (Cash for Grass) | Customer rebate | x | x | x | x |
| Artificial Turf | Customer rebate | x | x | x | x |
| Water Budgets | (Potentially rate-linked) | x | x | x | x |
| Large Landscape Water Use Reports | | | | | x |
| Pool, hot tub covers & other upgrades | Customer rebate or voucher | x | x | x | |
| Water Brooms | Customer rebate or voucher | | | x | |
| | Direct distribution | | | x | |
| Dedicated Irrigation Meters | Customer rebate | x | x | x | |
| | New construction ordinance | x | x | x | |
| An "x" indicates the program could be offered to the indicated customer class. | | | | | |

Table 6-3. Selma District General Conservation Program Concepts

| Technology/Intervention | Delivery Mechanism | CUSTOMER CLASS | | | |
|---|----------------------------|----------------|--------------|-----|-----------|
| | | Single Family | Multi-Family | CII | Lg Lndscp |
| Audits & Surveys (incl high bill contacts)* | | x | x | x | x |
| Meter installation | Direct Install | x | x | x | x |
| Water use meter alerting device | | x | x | x | x |
| "Smart Meters" | Demonstration | x | x | x | x |
| Increased billing frequency | | x | x | x | x |
| Water waste ordinance | | x | x | x | x |
| Water recycling, grey water use, rainwater harvesting | Customized incentives | x | x | x | x |
| New construction guidelines | | x | x | x | x |
| New const conservation offsets | | x | x | x | x |
| System loss prevention, leak detection & repair | Utility system maintenance | | | | |

An "x" indicates the program could be offered to the indicated customer class.

6.2.1 Concept Screening

Once the universe of program concepts was defined, the next step was to subject each program concept to a careful district-specific qualitative screen, the objective of which was to eliminate those program concepts that were clearly inappropriate. For this purpose, six screening criteria were developed:

1. **Implementation feasibility.** Are the administrative, staffing, billing, institutional, legal, and/or political difficulties associated with implementing the program acceptable?
2. **Customer/stakeholder acceptability.** Will the program likely be deemed acceptable by customers and/or other key program stakeholders?
3. **District match.** Is the technology well matched to the customers, appliance stocks, climate, building stock, and/or other characteristics of the service area? Are there enough target sites in the district to warrant developing and operating the program?
4. **Relationship to other programs.** Does the program reinforce rather than duplicate or conflict with other existing or proposed conservation programs?
5. **Program costs.** Are the expected costs of the program acceptable?
6. **Certainty of savings.** Are we able to forecast future program savings with a sufficient degree of certainty? Is our savings forecast sufficiently reliable?

For each program concept, Cal Water staff answered "yes" or "no" for each of these criteria. A "yes" answer on each of these criteria was considered to be essential for program success. Thus, a negative response to any one of the criteria for a particular program concept eliminated that concept from further consideration. Once Cal

Water had completed the initial qualitative screen, it met with local community leaders to share the results and solicit feedback on conservation program concepts for the district.

The final set of programs passing the qualitative screen for Selma District is shown in Table 6-4.

Table 6-4. Selma District Program Concepts Passing Qualitative Screen

| Technology/Intervention | Delivery Mechanism | CUSTOMER CLASS | | | |
|---|--|----------------|--------------|-----|----------|
| | | Single Family | Multi-Family | CII | Lg Lndsp |
| INDOOR | | | | | |
| HE Toilets | Customer rebates or vouchers | x | x | x | |
| | Vendor, distributor & contractor incentives | x | x | x | |
| | Distribution (by utility, community group, vendor) | x | x | x | |
| | Direct install | x | x | x | |
| Urinals | Customer rebates or vouchers | | | x | |
| | Vendor, distributor & contractor incentives | | | x | |
| | Distribution (by utility or vendor) | | | x | |
| | Valve replacement | | | x | |
| Clotheswashers: in-unit, common area, & coin-op | Customer rebates & vouchers | x | x | x | |
| | Vendor, distributor & contractor incentives | x | x | x | |
| Showerhead (2.0, 1.5 gpm)/ flapper/aerators | Kit distribution or install | x | x | | |
| Shower timers, Reminder cards | Distribution | x | x | | |
| Cooling Towers | Customer rebates, customized incentives | | | x | |
| Food Steamers | Customer rebates | | | x | |
| Ice Machines | Customer rebates | | | x | |
| Steam Sterilizers | Customer rebates | | | x | |
| Car Washes | Customer rebates | | | x | |
| | Audits | | | x | |
| Spray valves | Customer rebates | | | x | |
| | Audits | | | x | |
| X Ray film & photo processors | Customer rebates | | | x | |
| Industrial process | Audits & incentives | | | x | |
| | | | | | |
| OUTDOOR | | | | | |

| Technology/Intervention | Delivery Mechanism | CUSTOMER CLASS | | | |
|---|---|----------------|--------------|-----|----------|
| | | Single Family | Multi-Family | CII | Lg Lndsp |
| Large Landscape Surveys | | | | | x |
| WBIC | Direct Install | x | x | x | x |
| | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| | Distribution | x | x | x | x |
| Irrigation System (including, but not limited to, high efficiency nozzles for pop-up heads, drip, soil moisture sensors, rain shut off, pressure control) | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| Landscape design | Customer rebate | x | x | x | x |
| | Vendor, distributor & contractor incentives | x | x | x | x |
| Turf buy back (Cash for Grass) | Customer rebate | x | x | x | x |
| Large Landscape Water Use Reports | | | | | x |
| Pool, hot tub covers & other upgrades | Customer rebate or voucher | x | x | x | |
| | | | | | |
| GENERAL | | | | | |
| Audits & Surveys (incl high bill contacts) | | x | x | x | x |
| Water use meter alerting device | | x | x | x | |
| Water recycling, grey water use, rainwater harvesting | Customized incentives | x | x | x | |
| New construction guidelines | | x | x | x | |
| New const conservation offsets | | x | x | x | |
| Education/outreach | | x | x | x | x |

6.2.2 Preliminary Quantitative Analysis

A preliminary quantitative analysis was conducted on the programs that passed the qualitative screen. To do that, estimates were made of key savings and cost parameters for each of the programs in Table 6-4. Where applicable, these estimates were based on prior Cal Water experience with similar programs. In the absence of such experience, the experience of other water suppliers, the expertise of the project team, consultation with national experts, and published figures, where available, were relied upon. In particular, estimates developed by the California Urban Water Conservation Council and the Alliance for Water Efficiency were utilized where such estimates were available. While in most cases, the savings assumptions for a program do not vary across districts, for several programs, they do due to district-specific characteristics of household size, climate, etc. Other than meter

installation,²⁶ program cost assumptions are uniform across districts, although in some cases, cost sharing with other water utilities reduce Cal Water's share.

The specific savings and cost variables that were estimated for each program are as follows.

Savings Parameters

Unit savings. The savings in gallons per year that can be expected per device or intervention.

Savings decay. The annual rate at which the unit savings will decay due to behavioral attrition or physical device limitations.

Seasonal distribution. The percentage of the annual savings that will occur during the peak season. Generally, this parameter will differ between indoor and outdoor programs.

Useful life. The expected life of the device or intervention over which the savings will persist.

Free riders. The percentage of program participants who would be expected to have acted in the absence of the program and for whom, therefore, there is assumed to be no incremental savings.

Natural replacement. The annual rate at which customers would be expected to replace their inefficient fixtures in the absence of utility intervention, due either to code requirements or market forces.

Cost Parameters

Initial variable cost. The cost the utility must pay per device or intervention at the time that the device is installed or the intervention occurs. This cost could include such things as the cost of a fixture, a survey, a customer rebate, a voucher, plus the cost for program administration and marketing.

Follow-up variable cost. Subsequent annual per-device or intervention costs the utility must pay to maintain the program savings.

Follow-up years. The number of years the follow up costs will persist.

6.2.3 Identification of Core and Non-Core Programs

A key challenge facing Cal Water is finding a way to efficiently scale up conservation programming across its 24 districts with the limited staffing it has to implement and

²⁶ Seven Cal Water districts, including Selma, include a meter installation program as part of their conservation program portfolios.

manage these programs. The current GRC decision authorizes 4 full-time conservation program staff for 2011-13. These staff will be responsible for implementing and managing programs in 24 geographically dispersed districts serving a combined population of over 1.7 million.²⁷ As will be discussed in Section 7, Cal Water intends to propose to the CPUC adding three more conservation positions beginning in 2014 so that it can divide its districts into four program management regions. Even with the added staffing, the most efficient way for Cal Water to manage programs across its geographically dispersed districts is to standardize programs and centralize their implementation and oversight. Using the results of the qualitative screening and preliminary quantitative analysis, Cal Water identified five core programs that it would run in every district over the next five years. The following criteria were used for selecting core programs:

- Scalable – programs were more likely to be selected if they could simultaneously be run at low volumes in smaller districts and at much higher volumes in larger districts.
- Vendor Operation – programs were more likely to be selected if they could be operated by third-parties specializing in water conservation program implementation.
- Scale Economies – programs were more likely to be selected if aggregation of material purchases could lower unit costs of implementation.
- Synergy with Regional Programs – programs were more likely to be selected if they complemented or could leverage regional conservation programs that may be available to the district.
- Program Diversity – programs were selected to ensure a mix of programs for residential, commercial, industrial, and landscape customer segments.
- Proven Track Record – programs were more likely to be selected if they had demonstrated water savings and a proven track record of implementation by other water providers.
- Low Unit Cost – programs were more likely to be selected if they had low unit costs of implementation relative to other program options.²⁸

In addition to the core programs, an additional set of non-core programs was selected. Unlike core programs, Cal Water may not offer non-core programs in every district or in every year. Implementation of non-core programs will depend on whether additional water savings are required for SBx7-7 compliance, MOU compliance, or to help address local supply constraints.

The set of core and non-core programs that Cal Water will offer over the next five years is shown in Table 6-5.

²⁷ By way of comparison, the East Bay Municipal Utility District has a conservation program staff of 21 full-time positions serving a population of 1.3 million within a geographically contiguous and compact service area.

²⁸ A program's unit cost was only one factor taken into account, which had to be balanced against other competing criteria, such as scalability, program diversity, and synergy with regional programs.

Table 6-5. Cal Water Conservation Programs

| Program Name | Description | Target Market |
|--|---|--|
| CORE PROGRAMS | | |
| Rebate/Vouchers for toilets, urinals, and clothes washers | Provide customer rebates for high-efficiency toilets, urinals, and clothes washers | All customer segments |
| Residential Surveys | Provide residential surveys to low-income customers, high-bill customers, and upon customer request or as pre-screen for participation in direct install programs | All residential market segments |
| Residential Showerhead/Water Conservation Kit Distribution | Provide residential showerhead/water conservation kits to customers upon request, as part of residential surveys, and as part of school education curriculum | All residential market segments |
| Pop-Up Nozzle Irrigation System Distribution | Offer high-efficiency pop-up irrigation nozzles through customer vouchers or direct install. | All customer segments |
| Public Information/Education | Provide conservation messaging via radio, bill inserts, direct mail, and other appropriate methods. Provide schools with age appropriate educational materials and activities. Continue sponsorship of Disney Planet Challenge program. | All customer segments |
| NON-CORE PROGRAMS | | |
| Toilet/Urinal Direct Install Program | Offer direct installation programs for replacement of non-HE toilets and urinals | All customer segments |
| Smart Irrigation Controller Contractor Incentives | Offer contractor incentives for installation of smart irrigation controllers | All customer segments |
| Large Landscape Water Use Reports | Expand existing Cal Water Large Landscape Water Use Report Program providing large landscape customers with monthly water use reports and budgets | Non residential customers with significant landscape water use and potential savings |
| Large Landscape Surveys & Irrigation System Incentives | Provide surveys and irrigation system upgrade financial incentives to large landscape customers participating in the Large Landscape Water Use Reports programs and other targeted customers | Non residential customers with significant landscape water use and potential savings |
| Food Industry Rebates/Vouchers | Offer customer/dealer/distributor rebates/vouchers for high-efficiency dishwashers, food steamers, ice machines, and pre-rinse spray valves | Food and drink establishments, institutional food service providers |
| Cooling Tower Retrofits | Offer customer/dealer/distributor rebates/vouchers of cooling tower retrofits | Non-residential market segments with significant HVAC water use |
| Industrial Process Audits and Retrofit Incentives | Offer engineering audits/surveys and financial incentives for process water efficiency improvement | Non-residential market segments with significant industrial process water uses |

6.3 Benefit-Cost Analysis of Core and Non Core Programs

Core and non-core programs were then subjected to a detailed benefit cost analysis, the results of which were used to inform program portfolio development discussed in the next section. The first step in this process was to refine and finalize the savings and cost specifications of each program. The final assumptions for the Selma District programs are provided in Appendix 2.

The program savings and cost assumptions enable the calculation of program benefits and costs to the utility and its ratepayers, and comparisons of these costs in the form of benefit-cost ratios. The tool used to do this comparison was a simplified version of the Alliance for Water Efficiency Tracking Tool. Following are descriptions of how the model calculates and compares conservation program benefits and costs.

Program Benefits

For each acre-foot of water saved by a conservation program in a particular year – and in a particular season – the benefit to the utility is given by that year’s/season’s avoided cost, as described in Section 2.7. The model calculates the programmatic savings (that is, the savings that can be attributed to the utility program) for each year/season based on the program water savings parameters shown in Appendix 2. Each year’s/season’s programmatic savings is then multiplied by that year’s real-dollar avoided costs to compute the annual program benefits. The model then computes the present value of these benefits.²⁹

Program Costs

For each device/intervention, the model uses the program cost parameters shown in Appendix 2 to compute the annual costs the utility will incur. It then computes the present value of these costs.

Benefit-Cost Ratios

For each program, the benefit-cost ratio (BCR) is the quotient of the present value of the program benefits and the present value of the program costs. A BCR greater than 1 indicates that, over time, the program provides a positive net benefit to the utility and its ratepayers. Table 6-6 shows the BCRs for the Selma District programs. As described in Section 7, these BCRs were a key input to the development of the recommended district conservation portfolio.

²⁹ Present values are computed using a 3.4% real discount rate, which is based on a 6% nominal discount rate and a 2.5% annual inflation rate.

Table 6-6. Selma District Core and Non-Core Program Benefit-Cost Ratios

| Program ID | Program Name | Customer Class | BCR |
|-------------------|--|-----------------------|------------|
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | 0.65 |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | 1.38 |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | 0.43 |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | 0.21 |
| 5 | CW common: Cust Reb or Voucher | Multi Family | 0.22 |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | 0.15 |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | 0.25 |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | 0.27 |
| 9 | HE Toilets: Direct Install | Single Family | 0.28 |
| 10 | HE Toilets: Direct Install | Multi Family | 0.77 |
| 11 | HE Toilets: Direct Install | Commercial | 0.26 |
| 12 | Urinals: Direct Install | Commercial | 0.29 |
| 13 | Audits & Surveys (incl high bill contacts) | Single Family | 0.13 |
| 14 | Audits & Surveys (incl high bill contacts) | Multi Family | 0.50 |
| 15 | Audits & Surveys (incl high bill contacts) | Commercial | 0.84 |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | 1.12 |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | 1.12 |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | 1.12 |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | 0.33 |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | 0.33 |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | 0.14 |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | 0.27 |
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | 0.28 |
| 24 | Large Landscape Water Use Reports | Irrigation | 0.30 |
| 25 | Lg Lndscp Surveys & Irrig Sys: Rebates | Irrigation | 0.25 |
| 26 | Comm Irrigation System: Rebates | Commercial | 0.90 |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | 2.58 |
| 28 | Food Steamers: Cust Rebates | Commercial | 0.24 |
| 29 | Ice Machines: Cust Rebates | Commercial | 0.99 |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | 0.77 |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | 0.84 |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | 0.85 |
| 33 | Industrial Process: Audits & Incentives | Industrial | 0.63 |

7 Portfolio Development

7.1 Introduction

This section of the plan presents the recommended conservation program portfolio for Selma District. The program analysis results described in Section 6 provided the starting point for portfolio development. The next step was to determine the annual levels of program activity needed to, at minimum, meet Selma District's water savings targets and local demand management goals. Several considerations informed these decisions, including budgetary constraints included in the current GRC decision, Cal Water conservation program administrative capacity, program market and water savings potential, and the program benefit-cost results presented in Section 6.

7.2 SBx7-7 and MOU Savings Targets

Section 5 showed that, after accounting for water savings from existing water efficiency codes and ordinances, scheduled adjustments to water rates, and past investment in conservation programs, Selma District still needs an additional 96 AF of demand reduction to meet its 2015 SBx7-7 per capita water use target. It also showed that an additional 2 AF of water savings from new programs would be required to satisfy MOU compliance requirements in 2015. Moreover, in order to reach its 2020 SBx7-7 per capita water use target, 2020 demand will need to fall an additional 11% from the 2015 target. The program recommendations presented in this section are designed to both meet the district's 2015 targets and position it to achieve the 2020 targets by establishing a set of programs that can be scaled up over time.

7.3 2011-13 General Rate Case Decision

Cal Water's current GRC decision established conservation budgets for each district for the years 2011-2013. These budgets specify the total annual expenditure on conservation programs allowed under the GRC decision, as well as the maximum amount that can be allocated to (1) program administration and research, (2) public information and school education programs, (3) residential conservation programs, and (4) non-residential conservation programs. Table 7-1 shows these budgetary restrictions for Selma District.

Table 7-1. Selma District GRC Conservation Program Expenditure Constraints

| Budget Constraint (\$000) | 2011 | 2012 | 2013 |
|----------------------------------|-------------|-------------|-------------|
| Overall Budget | \$175.0 | \$175.0 | \$175.0 |
| Admin & Research | \$21.7 | \$21.7 | \$21.7 |
| Public Info & School Educ. | \$21.5 | \$21.5 | \$21.5 |
| Programmatic Activity | \$131.8 | \$131.8 | \$131.8 |
| Expenditure Caps | | | |
| Residential Programs | \$121.0 | \$121.0 | \$121.0 |
| Non Residential Programs | \$137.4 | \$137.4 | \$137.4 |

7.4 Minimum and Maximum Program Levels

For each district, Cal Water specified minimum and maximum program activity levels to guide portfolio development. The minimum levels were those below which it would not be administratively feasible or cost-effective to offer the program in the district, while the maximum levels were those that could reasonably be achieved given district customer characteristics, current market demand, and past experience marketing similar programs/technologies to district customers.³⁰ The constraints placed on annual program activity levels are presented in Appendix 2.

7.5 Recommended Annual Program Activity and Staff Levels

7.5.1 Residential and Non-Residential Conservation Programs

Recommended annual program levels for residential and non-residential programs are shown in Table 7-2. The program levels were derived from the following decision rules:³¹

- For 2011-13, set annual program activity to maximize water savings subject to the GRC conservation program budget constraints and the min/max annual activity constraints. This ensured that the portfolio would reflect the least-cost mix of core and non-core conservation programs consistent with the GRC budget constraints.
- For 2014-15, set annual activity to minimum program levels. For programs with BCRs greater than one, increase activity to its maximum level. This

³⁰ As part of development of this plan, Cal Water matched its non-residential customer accounts to North American Industrial Classification (NAICS) 4-digit codes, which enabled it to estimate the number of businesses in each of its districts that would potentially participate in the non-residential programs. It also identified, using a review and analysis of prior consumption, the number of large landscape customers in each district so that it could accurately assess potential participation levels and savings potential for large landscape conservation programs.

³¹ Linear programming models were used to implement the decision rules.

ensured that the portfolio would benefit ratepayers by helping to lower average water supply costs.

- For 2014-15, if needed to satisfy the 2015 SBx7-7 and MOU Flex Track water savings targets, increase program activity of programs with BCRs less than one in order of cost-effectiveness. This ensured the least-cost set of activity levels needed to achieve the water savings targets.

Table 7-2. Selma District Recommended Residential and Non-Residential Program Levels

| Program | Recommended Annual Activity Levels ¹ | | | | |
|---|---|-------|-------|-------|-------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| CORE PROGRAMS | | | | | |
| Rebates/Vouchers | | | | | |
| Toilets | 70 | 70 | 70 | 90 | 90 |
| Clothes Washers | 60 | 60 | 70 | 60 | 60 |
| Urinals | 0 | 0 | 0 | 0 | 0 |
| Customer Surveys/Audits | 70 | 70 | 70 | 70 | 70 |
| Conservation Kit Distribution | 110 | 110 | 110 | 110 | 110 |
| Pop-Up Nozzle Distribution | 1,100 | 1,100 | 1,220 | 3,300 | 3,300 |
| NON-CORE PROGRAMS | | | | | |
| Direct Install Toilets/Urinals | 140 | 140 | 140 | 130 | 130 |
| Smart Irr. Controller Vendor Incentives | 90 | 90 | 90 | 10 | 10 |
| Large Landscape Water Use Reports | 30 | 30 | 30 | 40 | 40 |
| Large Landscape Surveys/Incentives | 10 | 10 | 10 | 10 | 10 |
| Commercial Kitchen Rebates/Vouchers | 0 | 0 | 0 | 10 | 10 |
| Cooling Tower/Process Water Retrofit Incentives | 0 | 0 | 0 | 0 | 0 |
| ¹ Annual activity levels are aggregated across customer classes and rounded up to the nearest 10 units of activity. Appendix 2 contains the detail modeling results broken down by customer class and program measure. | | | | | |

7.5.2 Administration & Research

District staff levels and expenditure for administration and research for 2011-13 are set by the current GRC. At present, Cal Water divides its 24 districts into two program management regions which are administered by its two conservation program coordinators. Program reporting and analysis will be conducted by its conservation program analyst. Proposed expenditures for 2014 and 2015 assume two additional conservation program coordinator positions and one additional conservation analyst position for a total of seven full-time positions. Given the scale and diversity of programs proposed in this plan and the geographic dispersion of Cal Water’s districts, this is the minimum staffing level recommended for program implementation, and assumes Cal Water will divide its 24 districts into four program management regions, as shown in Figure 7-1, with one program coordinator assigned to each region. Selma District would be within program

management region 3. Program administration costs for 2014-15 are prorated to the districts based on their share of company-wide conservation program expenditures.³² Proposed annual expenditures for administration and research for Selma District are shown in Table 7-3.


7.5.3 Public Information & School Education

District expenditure for public information and school education programs in 2011-13 is set by the current GRC. Recommended expenditures in 2014 and 2015 were set to allow some expansion in these programs to support proposed increases in residential and non-residential program levels.³³ Recommended annual expenditures for public information and school education programs are shown in Table 7-3.

³² Projected expenditure in 2014 and 2015 and the allocation of these expenditures to each Cal Water district are shown in Appendix 2.

³³ Specifically, the recommended level of expenditure in 2014 and 2015 was set to either 110% of the 2013 public information/school education budget or 10% of recommended expenditures for residential and non-residential programs, whichever was greater. This decision rule ensured continuity with 2011-13 public information/school education program levels while allowing for an expansion of this programming in districts with significant increases in residential and non-residential program activity.

Figure 7-1. Cal Water Conservation Program Management Regions

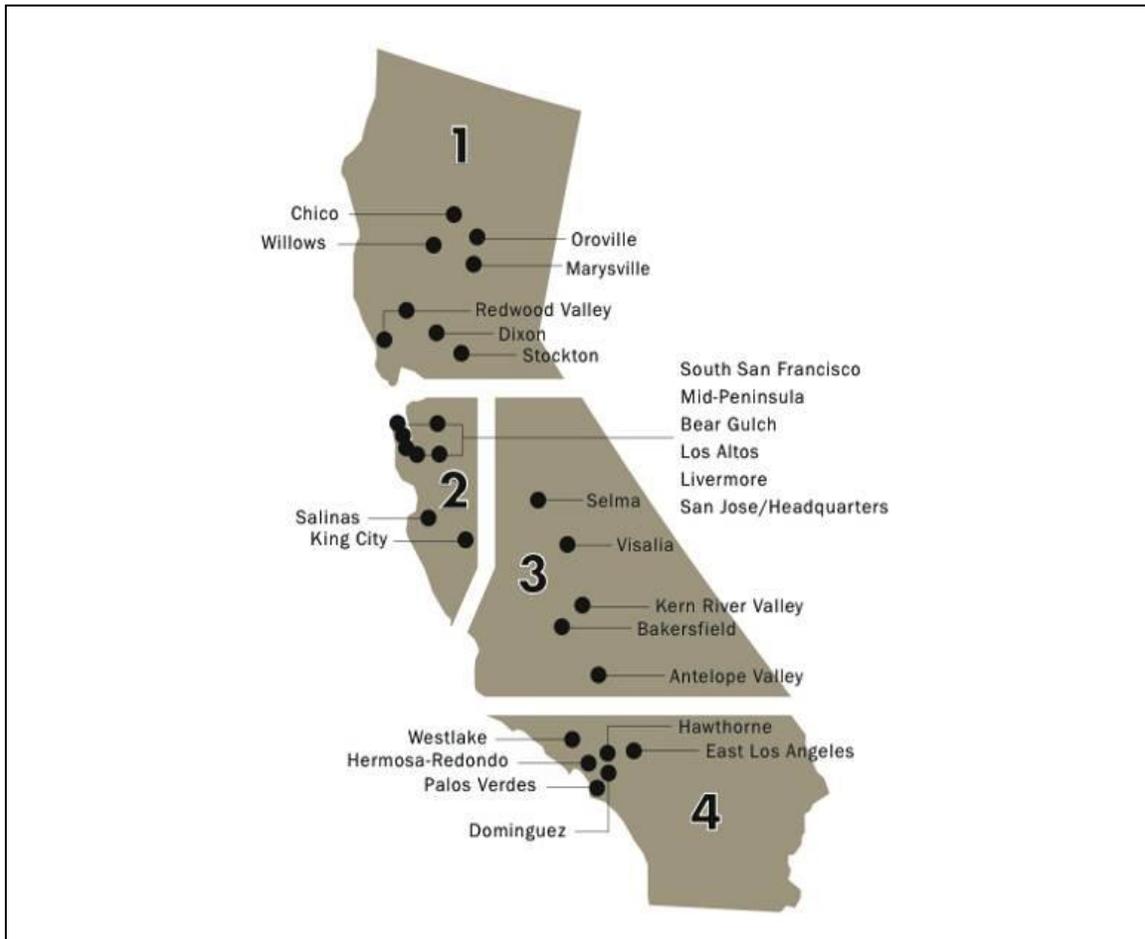


7.6 Projected Annual Program Expenditures

Annual program expenditures based on the recommended program levels and GRC budget allocations are shown in Table 7-3. Appendix 2 provides a detailed breakdown of these expenditures by year and individual program activity. Figure 7-2 shows the recommended expenditure shares by expenditure category over the entirety of the five-year planning period. The plan allocates approximately 75% of projected expenditure to programmatic activity, 14% to public information/education functions, and 11% to program administration and research functions. Within the programmatic expenditure category, approximately 70% of planned expenditure is for residential conservation programs and 30% is for non-residential programs.

Table 7-3. Selma District Projected Annual Conservation Expenditures

| Expenditure Category | Projected Annual Expenditures (\$000) | | | | |
|-------------------------|---------------------------------------|----------------|----------------|----------------|----------------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| Program Costs: | | | | | |
| Residential | \$95.9 | \$95.9 | \$95.9 | \$69.5 | \$69.5 |
| Non-Residential | \$35.9 | \$35.9 | \$35.9 | \$32.5 | \$32.5 |
| Program Subtotal | \$131.8 | \$131.8 | \$131.8 | \$102.1 | \$102.1 |
| Admin/Research | \$21.7 | \$21.7 | \$21.7 | \$11.1 | \$11.1 |
| Public Info/Education | \$21.5 | \$21.5 | \$21.5 | \$23.7 | \$23.7 |
| TOTAL ANNUAL | \$175.0 | \$175.0 | \$175.0 | \$136.9 | \$136.8 |

Figure 7-2. Selma District 2011-15 Conservation Expenditure Shares

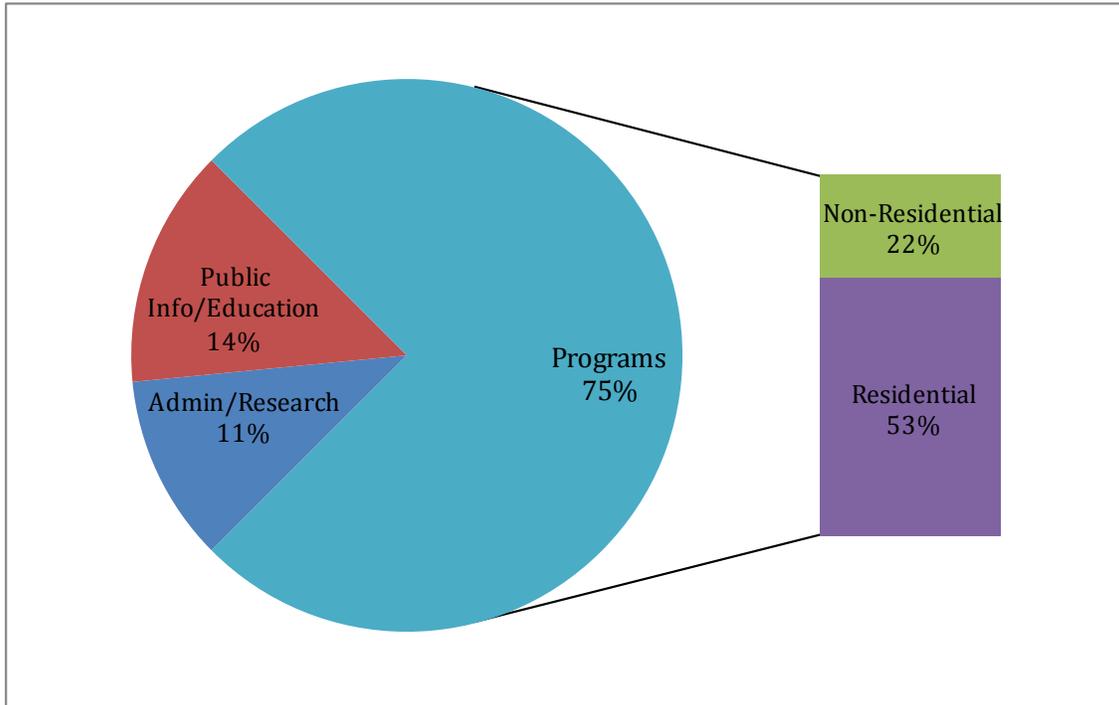

7.7 Projected Portfolio Water Savings

Table 7-4 and Table 7-5 show projected annual water savings broken down by program category and customer class, respectively. By 2015 projected water savings are approximately 118 AF. Programs impacting residential water demands account for approximately three-fourths of these savings, while programs impacting commercial, industrial, and irrigation demands account for one-fourth.

Table 7-4. Selma District Projected Water Savings by Program

| Program | Annual Water Savings (AF) | | | | |
|---|---------------------------|-------------|-------------|-------------|--------------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| CORE PROGRAMS | | | | | |
| Rebates/Vouchers | | | | | |
| Toilets | 2.1 | 4.1 | 6.0 | 9.5 | 12.7 |
| Clothes Washers | 1.0 | 2.0 | 3.3 | 4.2 | 5.1 |
| Urinals | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Customer Surveys/Audits | 2.5 | 4.7 | 6.7 | 8.5 | 10.1 |
| Conservation Kit Distribution | 1.7 | 3.1 | 4.4 | 5.5 | 6.5 |
| Pop-Up Nozzle Distribution | 4.4 | 8.8 | 13.6 | 26.8 | 40.0 |
| Subtotal Core Programs | 11.7 | 22.7 | 34.1 | 54.5 | 74.5 |
| NON-CORE PROGRAMS | | | | | |
| Direct Install Toilets/Urinals | 5.0 | 9.7 | 14.3 | 18.2 | 22.0 |
| Smart Irr. Controller Vendor Incentives | 3.4 | 6.9 | 10.1 | 10.1 | 10.1 |
| Large Landscape Water Use Reports | 2.8 | 2.8 | 2.8 | 4.5 | 4.5 |
| Large Landscape Surveys/Incentives | 0.5 | 1.0 | 1.5 | 2.0 | 2.4 |
| Commercial Kitchen Rebates/Vouchers | 0.0 | 0.0 | 0.0 | 2.5 | 4.9 |
| Cooling Tower/Process Water Retrofit Incentives | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Subtotal Non-Core Programs | 11.7 | 20.3 | 28.7 | 37.2 | 44.0 |
| Total Core and Non-Core Program Savings | 23.3 | 43.1 | 62.7 | 91.7 | 118.4 |

Table 7-5. Selma District Projected Water Savings by Customer Class

| Customer Class | Annual Water Savings (AF) | | | | |
|----------------------------|---------------------------|-------------|-------------|-------------|--------------|
| | 2011 | 2012 | 2013 | 2014 | 2015 |
| Single Family | 11.4 | 22.2 | 32.5 | 47.4 | 61.9 |
| Multi Family | 4.9 | 9.6 | 15.0 | 21.4 | 27.5 |
| Commercial/Industrial | 3.9 | 7.6 | 11.2 | 16.9 | 22.6 |
| Irrigation | 3.2 | 3.6 | 4.0 | 6.0 | 6.4 |
| Total Water Savings | 23.3 | 43.1 | 62.7 | 91.7 | 118.4 |

7.8 Projected Water Demands

Table 7-6 shows the adjusted 2015 baseline demand (in gpcd), the demand targets required to comply with SBx7-7 and the MOU, and the projected 2015 demand based on the recommended conservation portfolio.³⁴ Projected demand in 2015 under the recommended portfolio is approximately the same as 2015 SBx7-7 target and approximately 2% below the MOU Flex Track target.

³⁴ The adjusted baseline demand forecast deducts expected reductions in demand due to codes/ordinances, conversion of flat rate customers to metered billing, scheduled adjustments to water rates, and past conservation program investment.

Between 2015 and 2020, per capita demand will need to decrease another 11% in order for the district to meet its 2020 SBx7-7 target of 215 gpcd. Alternatively, per capita demand for the four Cal Water districts in the Tulare Lake hydrologic region will need to average no more than 222 gpcd in 2020 in order to achieve regional compliance.

Table 7-6. Selma District Recommended Portfolio Projected 2015 Demand

| Demand Projection | Demand (GPCD) | Difference from Adjusted Baseline (GPCD) |
|--------------------------|----------------------|---|
| Adjusted Baseline | 245 | |
| SBx7-7 Target | 242 | -3 |
| MOU Flex Track Target | 245 | 0 |
| Recommended Portfolio | 241 | -4 |

7.9 Program Cut Sheets

As part of plan development, one page program summaries, or “cut sheets,” were developed for each recommended program. These cut sheets provide a quick reference summarizing program design and marketing, expected level of customer participation, projected water savings, and proposed program expenditure for the period 2011 – 2015. Appendix 1 includes a copy of each program cut sheet for Selma District.

8 Plan Monitoring and Updates

8.1 Introduction

This conservation master plan is a working document and, as such, will need to be modified and updated as new information becomes available. Cal Water will need to regularly review the plan and make adjustments to it as appropriate. This section of the plan describes key monitoring and updating activities Cal Water anticipates undertaking following plan implementation

8.2 Program Tracking

Cal Water intends to adopt conservation program tracking software that it can use to track and manage its core and non-core programs. Such software will help Cal Water track customer participation in its programs, manage program materials, track program costs, and estimate program water savings. Cal Water will conduct a review of tracking software options in early 2011 with the goal of selecting the deploying the software in spring 2011.

8.3 2014-16 General Rate Case

Implementation of the recommended programs in 2014 and 2015 is contingent upon the outcome of Cal Water's 2014-16 GRC. Cal Water will not know until late 2013 whether the CPUC will approve the 2014-15 conservation program budgets proposed in this plan. Cal Water will submit its initial filing for the 2014-16 GRC in July 2012. Prior to that filing, Cal Water may elect to update this plan to reflect new information and changed circumstances affecting the baseline water demands, calculated water savings targets, recommended conservation programs, projected water savings, and proposed conservation program budgets.

8.4 2015 UWMP

Under SBx7-7 water suppliers may update their baseline demands and per capita water use targets in their 2015 UWMP. As part of its 2015 UWMP preparation, Cal Water may elect to update its baseline demand estimates and gpcd targets, if new information warrants doing so. Depending on the final methodology adopted by DWR for the fourth target calculation method, Cal Water may decide to update the SBx7-7 targets included in the plan using this alternative methodology.

8.5 MOU Flex Track Target

The CUWCC-sanctioned tools for calculating the Flex Track target for MOU compliance were not available during this plans development. Therefore, Cal Water used its own Flex Track calculator to calculate the required volume of water savings. CUWCC tools for calculating the Flex Track target are expected to be available sometime in early 2011. Cal Water may elect to update this plan to reflect a revised Flex Track target based on a CUWCC-sanctioned Flex Track target calculator.

8.6 Water Savings Verification

Cal Water intends to undertake various research projects to verify water savings projections included in these plans. For example, Cal Water and San Jose State University Research Foundation are jointly undertaking a study of realized water savings from converting customers from flat rate to metered billing. This study is expected to commence in early 2011. Results from studies such as this one will be used by Cal Water to update the water savings projections contained in this plan.

8.7 Local Codes and Ordinances

Water waste prohibitions and codes and ordinances affecting new construction and landscape design and irrigation enacted by cities and counties in the communities served by Cal Water may alter demands in ways not anticipated by this plan.³⁵ Cal Water will work with local planning and enforcement departments to ensure that its conservation programs are consistent with and complementary to local water use codes and ordinances, and may elect to modify the design or level of implementation of programs included in the plan in order to do so.

8.8 2015 Plan Update

Cal Water plans to update these plans no less frequently than every five years. These plan updates will correspond to the update and reporting cycle for the UWMPs Cal Water prepares for each district every five years. Plan updates may entail adjustment of existing programs and addition of new programs based on performance history, community input, and changes to state and local conservation requirements.

³⁵ For example, AB 1881, passed in 2006, gave cities and counties until January 2010 to update an existing or adopt a new landscape water use ordinance to comply with the state's updated model landscape ordinance.

Appendix 1

Conservation Program Cut Sheets

The program cut sheets in this appendix provide a quick reference summarizing program design and marketing, expected level of customer participation, projected water savings, and proposed program expenditure for the period 2011 – 2015.



High Efficiency Toilet Rebate Program

Selma District

Program Description

High-efficiency toilets use approximately 70% less water than non-efficient toilets and 20% less water than ultra-low flush toilets. This program will provide customer incentives for residential and non-residential high-efficiency toilets. Cal Water will centrally administer the program as part of a company-wide toilet rebate program.



Program Marketing

This program will be available to all residential and non-residential customers. Cal Water will market the program through direct mail, print media, bill stuffers, and its website. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.



| Year | Rebate Goal |
|------|-------------|
| 2011 | 70 |
| 2012 | 70 |
| 2013 | 70 |
| 2014 | 90 |
| 2015 | 90 |

*Combined goal for single family, multi family, and commercial toilet rebates.

IMPLEMENTATION COST

Costs Per Rebate and Per AF of Water Savings: Program costs vary by fixture type and customer class. Expected program costs per fixture (including marketing and administration) and per AF of water savings are shown below.

| Customer Class | Program Cost (\$/Rebate) | Water Savings (\$/AF) |
|-----------------|--------------------------|-----------------------|
| Single Family | \$150 | \$460 |
| Multi Family | \$130 | \$220 |
| Non-Residential | \$250 | \$670 |

*Costs rounded to nearest \$10.

WATER SAVINGS

Fixture and Program Savings: Projected water savings per fixture vary by customer class. Projected savings per fixture, and annual and lifetime program water savings are shown below.

| Customer Class | Unit Savings (gal/yr) | Lifetime Savings (AF/Rebate) |
|-----------------|-----------------------|------------------------------|
| Single Family | 8,800 | 0.5 |
| Multi Family | 15,900 | 1.0 |
| Non-Residential | 10,300 | 0.6 |

*Unit savings rounded to nearest 100 gal.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$13,000 |
| 2012 | \$13,000 |
| 2013 | \$13,000 |
| 2014 | \$12,700 |
| 2015 | \$12,700 |
| Five-Year Cost | \$64,400 |

*Annual cost rounded to nearest \$100.

| Year | Water Savings (AF) |
|-----------------------------|--------------------|
| 2011 | 2.1 |
| 2012 | 4.1 |
| 2013 | 6.0 |
| 2014 | 9.5 |
| 2015 | 12.7 |
| 5-Year Total Savings | 34.4 |



High Efficiency Clothes Washer Rebate Program

Selma District



Program Description

Washing clothes is the second biggest use of water inside most homes, accounting for approximately 20% of indoor water use for a typical family. High-efficiency clothes washers can cut this water use by up to 60%, and save a significant amount of energy too. Unfortunately, many households and businesses are still purchasing low-efficiency washers because of their

lower up-front purchase cost. Rebates are an effective way to level the playing field.

This program will provide customer incentives for residential and non-residential high-efficiency clothes washers. The program will target single-family households, multi-family units, multi-family common laundry areas, and commercial coin-op laundries.

Cal Water will centrally administer the program as part of a company-wide toilet rebate program.



Program Marketing

This program will be available to all residential and non-residential customers. Cal Water will market the program through direct mail, print media, bill stuffers, and its website. Expected program participation levels (rounded up to nearest 10 units) are shown in the table below.

| Year | Rebate Goal |
|------|-------------|
| 2011 | 60 |
| 2012 | 60 |
| 2013 | 70 |
| 2014 | 60 |
| 2015 | 60 |

*Combined rebates for single family, multi family, and commercial customers.

IMPLEMENTATION COST

Costs per Rebate and per AF of Water Savings: Program costs vary by fixture type and customer class. Expected program costs per rebate (including marketing and administration) and per AF of water savings are shown below.

| Washer Location | Program Cost (\$/Rebate) | Water Savings (\$/AF) |
|------------------------|--------------------------|-----------------------|
| Single Family | \$170 | \$1,200 |
| Multi Family - In Unit | \$170 | \$1,640 |
| Multi Family - Common | \$460 | \$950 |
| Commercial Coin-op | NA | NA |

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$10,200 |
| 2012 | \$10,200 |
| 2013 | \$12,000 |
| 2014 | \$10,200 |
| 2015 | \$10,200 |
| Five-Year Cost | \$52,800 |

WATER SAVINGS

Fixture and Program Savings: Projected water savings per fixture vary by customer class. Projected savings per fixture, and annual and lifetime program water savings are shown below.

| Customer Class | Unit Savings (gal/yr) | Lifetime Savings (AF/Rebate) |
|------------------------|-----------------------|------------------------------|
| Single Family | 7,100 | 0.3 |
| Multi Family - In Unit | 5,200 | 0.2 |
| Multi Family - Common | 25,300 | 1.1 |
| Commercial Coin-op | 31,400 | 1.3 |

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 1.0 |
| 2012 | 2.0 |
| 2013 | 3.3 |
| 2014 | 4.2 |
| 2015 | 5.1 |
| Total Five-Year Savings | 15.6 |

*Annual cost rounded to nearest \$100.



Toilet/Urinal Direct Install Program

Selma District

Program Description

High-efficiency toilets and urinals use significantly less water than non-efficient models. This program will offer direct installation of high-efficiency toilets and urinals to Cal Water residential and commercial customers. The program will primarily target multi-family and commercial properties with older plumbing fixtures, where water savings potential is greatest.

Residential direct installations will include high-efficiency showerhead replacement and bathroom faucet aerators, in addition to toilet replacement. On the commercial side,

the program will replace non-efficient toilets and flush valves for both toilets and urinals.

Cal Water will centrally administer the program as part of a company-wide program.

Program Marketing

Cal Water will market this program primarily to multi-family and commercial properties with older plumbing fixtures using direct mail. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.

| Year | Program Production Goal |
|------|-------------------------|
| 2011 | 140 |
| 2012 | 140 |
| 2013 | 140 |
| 2014 | 130 |
| 2015 | 130 |

*Combined goal for single family, multi family, and commercial direct installations.



IMPLEMENTATION COST

Costs Per Rebate and Per AF of Water Savings: Program costs vary by fixture type and customer class. Expected program costs per fixture (including marketing and administration) and per AF of water savings are shown below.

| Customer Class/ Fixture | Program Cost (\$/Install) | Water Savings (\$/AF) |
|----------------------------|------------------------------|--------------------------|
| Single Family | \$400 | \$1,050 |
| Multi Family | \$270 | \$390 |
| Comm. Toilet | \$500 | \$1,120 |
| Comm. Urinal | \$240 | \$1,030 |

*Rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$51,000 |
| 2012 | \$51,000 |
| 2013 | \$51,000 |
| 2014 | \$45,000 |
| 2015 | \$45,000 |
| Five-Year Cost | \$243,000 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Fixture and Program Savings: Projected annual and lifetime water savings per fixture and for the five-year program are shown below.

| Customer Class/ Fixture | Unit Savings (gal/yr) | Lifetime Savings (AF/Installation) |
|----------------------------|--------------------------|---------------------------------------|
| Single Family | 10,500 | 0.6 |
| Multi Family | 18,900 | 1.2 |
| Comm. Toilet | 12,200 | 0.7 |
| Comm. Urinal | 6,200 | 0.4 |

*Unit savings rounded to nearest 100 gal.

| Year | Program Water Savings (AF) |
|--------------------------------|----------------------------|
| 2011 | 5.0 |
| 2012 | 9.7 |
| 2013 | 14.3 |
| 2014 | 18.2 |
| 2015 | 22.0 |
| Five-Year Total Savings | 69.2 |



Residential & Commercial Survey Program

Selma District

Program Description

This program will provide residential and non-residential water use surveys to Cal Water customers. Residential surveys will evaluate a customer's indoor and outdoor water use and provide information on how to reduce household water use. Customers will receive a report with specific water saving recommendations as well as information on available Cal Water



conservation rebate programs that may benefit them. Multi family and commercial surveys will be used to assist high-bill customers, as well as to screen potential properties for the bathroom fixture direct installation program (if available in the district).

Surveys will be conducted by trained professionals. Cal Water will centrally administer the program as part of a company-wide program.

Program Marketing

This program will be available to all residential and non-residential customers. Cal Water will market the program through direct mail, print media, bill stuffers, and its website. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.

| Year | Survey Goal |
|------|-------------|
| 2011 | 70 |
| 2012 | 70 |
| 2013 | 70 |
| 2014 | 70 |
| 2015 | 70 |

*Combined surveys for single family, multi family, and commercial customers.



IMPLEMENTATION COST

Costs Per Rebate and Per AF of Water Savings: Program costs vary by fixture type and customer class. Expected program costs per fixture (including marketing and administration) and per AF of water savings are shown below.

| Customer Class | Program Cost (\$/Survey) | Water Savings (\$/AF) |
|-----------------|--------------------------|-----------------------|
| Single Family | \$210 | \$1,470 |
| Multi Family | \$60 | \$390 |
| Non-Residential | \$1,070 | \$290 |

*Cost rounded to nearest dollar. Water savings cost rounded to nearest \$10. Multi family program cost is per property complex.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$11,600 |
| 2012 | \$11,600 |
| 2013 | \$11,600 |
| 2014 | \$11,600 |
| 2015 | \$11,600 |
| Five-Year Cost | \$58,000 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Fixture and Program Savings: Projected water savings per fixture vary by customer class. Projected savings per fixture, and annual and lifetime program water savings are shown below.

| Customer Class | Unit Savings (gal/yr) | Lifetime Savings (AF/Survey) |
|-----------------|-----------------------|------------------------------|
| Single Family | 12,300 | 0.2 |
| Multi Family | 12,700 | 0.2 |
| Non-Residential | 208,600 | 2.6 |

*Unit savings rounded to nearest 100 gal/yr.

| Year | Water Savings (AF) |
|--------------------------|--------------------|
| 2011 | 2.5 |
| 2012 | 4.7 |
| 2013 | 6.7 |
| 2014 | 8.5 |
| 2015 | 10.1 |
| Five-Year Savings | 32.5 |



Residential Conservation Kit Distribution Program

Selma District

Program Description

This program will offer Cal Water residential customers conservation kits featuring a range of water-saving plumbing retrofit fixtures. Kits will be available at no charge to customers, who can request them via Cal Water's website, via mail, or by contacting or visiting their district.

Each kit can include up to two of each of the following items: high-efficiency

showerhead, kitchen faucet aerator, bathroom faucet aerator, full-stop hose nozzle, and toilet leak detection tablets. Customers may customize items and quantities included in their kit.

Cal Water will centrally administer this program as part of a company-wide program operated in each of its 24 service districts.

| Year | Kits Distributed |
|------|------------------|
| 2011 | 110 |
| 2012 | 110 |
| 2013 | 110 |
| 2014 | 110 |
| 2015 | 110 |



Program Marketing

This program will be available to all residential customers. Cal Water will market the program through direct mail, print media, bill stuffers, and through its website. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.



IMPLEMENTATION COST

Costs Per Nozzle and Per AF of Water Savings: Bulk purchasing will help keep program costs low. Kit distribution costs about \$29/kit, including the costs for the kit, marketing, and administration.

| Fixture | Program Cost (\$/Kit) | Water Savings (\$/AF) |
|------------------------------|-----------------------|-----------------------|
| Residential Conservation Kit | \$29 | \$550 |

*Water savings cost rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$3,200 |
| 2012 | \$3,200 |
| 2013 | \$3,200 |
| 2014 | \$3,200 |
| 2015 | \$3,200 |
| Five-Year Cost | \$16,000 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Kit and Program Savings: Projected savings per kit are based on prior program experience and assume a 50% to 60% installation rate for each device included in the kit. Annual and lifetime savings per kit and for the five-year program are shown below.

| Fixture | Unit Savings (gal/yr) | Lifetime Savings (gal/Kit) |
|------------------------------|-----------------------|----------------------------|
| Residential Conservation Kit | 5,100 | 25,500 |

*Unit savings rounded to nearest 100 gal/yr. Savings assumed to last five years.

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 1.7 |
| 2012 | 3.1 |
| 2013 | 4.4 |
| 2014 | 5.5 |
| 2015 | 6.5 |
| Five-Year Total Savings | 21.2 |



Sprinkler Nozzle Distribution Program

Selma District

Program Description

Water efficient sprinkler nozzles use up to 20% less water than a standard sprinkler head by distributing water more slowly and uniformly to the landscape. In addition to reducing water use, water directed from these nozzles reduces run-off onto streets and sidewalks with a more directed flow.

Customers will be able to obtain the



nozzles either directly through Cal Water or via a web-voucher program. Restrictions on the number of nozzles individual customers may receive will vary by customer class and/or landscape size.

Cal Water will centrally administer this program as part of a company-wide program operated in each of its 24 service districts.



Program Marketing

This program will be available to all residential and non-residential customers. Cal Water will market the program through direct mail, print media, bill stuffers, and its website. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.

| Year | Nozzles Distributed |
|------|---------------------|
| 2011 | 1,100 |
| 2012 | 1,100 |
| 2013 | 1,220 |
| 2014 | 3,300 |
| 2015 | 3,300 |

IMPLEMENTATION COST

Costs Per Nozzle and Per AF of Water Savings: Bulk purchasing will help keep program costs low. Nozzles are expected to cost about \$3/nozzle. Program marketing and administration is estimated at under \$1/nozzle.

| Fixture | Program Cost (\$/Nozzle) | Water Savings (\$/AF) |
|------------------|--------------------------|-----------------------|
| Sprinkler Nozzle | \$4 | \$190 |

*Fixture cost rounded to nearest dollar. Water savings cost rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$4,100 |
| 2012 | \$4,100 |
| 2013 | \$4,500 |
| 2014 | \$12,200 |
| 2015 | \$12,200 |
| Five-Year Cost | \$37,100 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Nozzle and Program Savings: Projected savings per nozzle, and annual and lifetime program water savings are shown below. These estimates are based on Metropolitan Water District's Save Water-Save A Buck program estimates.

| Fixture | Unit Savings (gal/yr) | Lifetime Savings (gal) |
|------------------|-----------------------|------------------------|
| Sprinkler Nozzle | 1,300 | 6,500 |

*Unit savings rounded to nearest 100 gal/yr. Nozzles assumed to have a five-year useful life.

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 4.4 |
| 2012 | 8.8 |
| 2013 | 13.6 |
| 2014 | 26.8 |
| 2015 | 40.0 |
| Five-Year Total Savings | 93.6 |



Smart Irrigation Controller Distribution Program

Selma District



Program Description

Weather-based “smart” irrigation controllers allow for more accurate, customized irrigation by automatically adjusting the schedule and amount of water in response to changing weather conditions. Empirical studies have shown savings of 15% to 25% of irrigation water use.

This program will target residential and non-residential customers with high landscape water use. The program will

offer incentives to either the customer or contractor for proper installation of the Smart Controller at customer sites.

The landscape contractor has the direct relationship with customers and is typically the entity customers listen to when making landscape and irrigation decisions. The program will educate contractors about the customer benefits of Smart Controllers along with proper installation of the devices.

Program Marketing

This program will be offered to all residential and non-residential customers. Cal Water will market the program through direct mail, print media, bill stuffers, and its website. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.

| Year | Distribution Goal |
|------|-------------------|
| 2011 | 90 |
| 2012 | 90 |
| 2013 | 90 |
| 2014 | 10 |
| 2015 | 10 |



IMPLEMENTATION COST

Costs Per Rebate and Per AF of Water Savings: Program costs vary by rebate and customer class. Expected program costs per rebate (including marketing and administration) and per AF of water savings are shown below.

| Customer Class | Program Cost (\$/Rebate) | Water Savings (\$/AF) |
|-----------------|--------------------------|-----------------------|
| Single Family | \$480 | \$1,740 |
| Multi Family | \$480 | \$990 |
| Non-Residential | \$480 | \$990 |

*Rebate cost rounded to nearest dollar. Water savings cost rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$41,900 |
| 2012 | \$41,900 |
| 2013 | \$39,700 |
| 2014 | \$100 |
| 2015 | \$100 |
| Five-Year Cost | \$123,700 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Rebate and Program Savings: Projected water savings per rebate vary by customer class. Projected savings per rebate, and annual and lifetime program water savings are shown below.

| Customer Class | Unit Savings (gal/yr) | Lifetime Savings (AF/Rebate) |
|-----------------|-----------------------|------------------------------|
| Single Family | 10,100 | 0.3 |
| Multi Family | 17,800 | 0.5 |
| Non-Residential | 17,800 | 0.5 |

*Unit savings rounded to nearest 100 gal/yr.

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 3.4 |
| 2012 | 6.9 |
| 2013 | 10.1 |
| 2014 | 10.1 |
| 2015 | 10.1 |
| Five-Year Total Savings | 40.6 |



Large Landscape Water Use Report Program

Selma District



Program Description

A landscape water budget calculates the recommended amount of water for irrigation based on landscape size, plant mix, weather, and season. Empirical studies have shown that providing customers with landscape budgets can reduce irrigation water use by 10% to 20%.

This program will provide participating large landscape customers monthly

reports comparing actual landscape water use to their budget. The reports will show whether irrigation is excessive and how much the customer's water costs could fall by irrigating more efficiently. Customers having trouble staying within budget may request a large landscape site evaluation and may be eligible for landscape equipment incentives.

Program Marketing

Cal Water is already implementing this program in several districts. The program will be expanded to more customers in these districts and extended to other districts. Satellite imagery and billing data are used to identify good candidates for the program. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.



| Year | Participating Large Landscapes |
|------|--------------------------------|
| 2011 | 30 |
| 2012 | 30 |
| 2013 | 30 |
| 2014 | 40 |
| 2015 | 40 |

IMPLEMENTATION COST

Costs per Property and per AF of Water Savings: Expected program costs per property (including marketing and administration) and per AF of water savings are shown below. Costs per property include the amortized one-time cost to measure the property's landscape area and set up the budget.

| Customer Type | Program Cost (\$/Yr/Property) | Water Savings (\$/AF) |
|---|-------------------------------|-----------------------|
| Customers with Significant Landscape Area | \$60 | \$610 |

*rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$1,700 |
| 2012 | \$1,700 |
| 2013 | \$1,700 |
| 2014 | \$2,700 |
| 2015 | \$2,700 |
| Five-Year Cost | \$10,500 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Program Savings: Projected average annual and lifetime water savings per property are shown below. Cumulative program water savings over five-years are also shown.

| Customer Type | Unit Savings (gal/yr) | Lifetime Savings (AF) |
|---|-----------------------|-----------------------|
| Customers with Significant Landscape Area | 36,500 | 2.8 |

*Unit savings rounded to nearest 100 gallons. Lifetime savings calculated

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 2.8 |
| 2012 | 2.8 |
| 2013 | 2.8 |
| 2014 | 4.5 |
| 2015 | 4.5 |
| Five-Year Total Savings | 17.4 |



Large Landscape Surveys

Selma District



Program Description

This program will provide landscape water use evaluations, recommendations, and education to commercial and industrial customers with significant landscaped area.

Participating customers will receive a detailed assessment of the water use efficiency of their current landscape and

irrigation system. Participants will receive a report summarizing the results of the assessment and recommended changes to irrigation systems and practices.

Program Marketing

Cal Water is already implementing this program in several districts. The program will be expanded to more customers in these districts and extended to other districts. This program will target HOA, apartment complex, commercial, and industrial properties with significant landscape water use. Customers participating in Cal Water's Landscape Water Use Report program will be the primary targets for program participation. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.



| Year | Participating Large Landscapes |
|------|--------------------------------|
| 2011 | 10 |
| 2012 | 10 |
| 2013 | 10 |
| 2014 | 10 |
| 2015 | 10 |

IMPLEMENTATION COST

Costs per Property and per AF of Water Savings: Expected program costs per survey (including marketing and administration) and per AF of water savings are shown below.

| Target Participant | Program Cost (\$/Survey) | Water Savings (\$/AF) |
|---|--------------------------|-----------------------|
| Customers with Significant Landscape Area | \$1,400 | \$790 |

*rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$1,500 |
| 2012 | \$1,500 |
| 2013 | \$1,500 |
| 2014 | \$1,500 |
| 2015 | \$1,500 |
| Five-Year Cost | \$7,500 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Program Savings: Projected average annual and lifetime water savings per survey are shown below. Cumulative program water savings over five-years are also shown.

| Target Participant | Unit Savings (gal/yr) | Lifetime Savings (AF/Survey) |
|---|-----------------------|------------------------------|
| Customers with Significant Landscape Area | 125,500 | 1.9 |

*Unit savings rounded to nearest 100 gallons.

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 0.4 |
| 2012 | 0.8 |
| 2013 | 1.2 |
| 2014 | 1.5 |
| 2015 | 1.9 |
| Five-Year Total Savings | 5.8 |



Irrigation System Rebates

Selma District



Program Description

This program will provide customized irrigation system rebates to commercial and industrial customers with significant landscaped area.

Participating customers can receive rebates on a variety of irrigation system equipment and changes to landscape, including commercial-grade weather-

based controllers, rotating sprinkler nozzles, and replacement of turf or other high-water use landscape with climate-appropriate low-water use landscape. Eligibility and rebate amounts will be determined on a customer-by-customer basis.

Program Marketing

This program will target HOA, apartment complex, commercial, and industrial properties with significant landscape water use. The program will be marketed primarily through direct mail and via landscape contractor networks. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.

| Year | Participating Customers |
|------|-------------------------|
| 2011 | 10 |
| 2012 | 10 |
| 2013 | 10 |
| 2014 | 10 |
| 2015 | 10 |



IMPLEMENTATION COST

Costs per Rebate and per AF of Water Savings: Expected program costs per rebate (including marketing and administration) and per AF of water savings are shown below. Individual rebate amounts will vary by participant. The amount shown below is the average rebate amount across all expected participants.

| Target Participant | Program Cost (\$/Rebate) | Water Savings (\$/AF) |
|---|--------------------------|-----------------------|
| Customers with Significant Landscape Area | \$520 | \$310 |

*rounded to nearest \$10.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$300 |
| 2012 | \$300 |
| 2013 | \$300 |
| 2014 | \$300 |
| 2015 | \$300 |
| Five-Year Cost | \$1,500 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Program Savings: Projected average annual and lifetime water savings per rebate are shown below. Cumulative program water savings over five-years are also shown.

| Target Participant | Unit Savings (gal/yr) | Lifetime Savings (AF/Rebate) |
|---|-----------------------|------------------------------|
| Customers with Significant Landscape Area | 62,700 | 1.9 |

*Unit savings rounded to nearest 100 gallons.

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 0.1 |
| 2012 | 0.2 |
| 2013 | 0.3 |
| 2014 | 0.4 |
| 2015 | 0.5 |
| Five-Year Total Savings | 1.5 |



Commercial Kitchen Rebate Program

Selma District



commercial and institutional customers with significant kitchen water use.

Cal Water will centrally administer the program. The program will be offered in all Cal Water Districts starting in 2014.



Program Description

Potential water savings in commercial kitchens are significant. However, financial barriers often prevent these facilities from taking simple steps to improve water use efficiency.

This program will provide financial incentives for high-efficiency commercial dishwashers, food steamers, ice machines, and pre-rinse spray valves. The program will target

Program Marketing

Cal Water will market this program through direct mail campaigns and its website. Commercial customers with significant kitchen water use participating in Cal Water's commercial survey program will be directed to the program as well. Expected program participation levels (rounded up to nearest 10 units) are shown in the table to the right.

| Year | Rebate Goal |
|------|-------------|
| 2011 | 0 |
| 2012 | 0 |
| 2013 | 0 |
| 2014 | 10 |
| 2015 | 10 |

IMPLEMENTATION COST

Costs per Rebate and per AF of Water Savings: Expected program costs per rebate (including marketing and administration) and per AF of water savings are shown below.

| Customer Target | Program Cost (\$/Rebate)* | Water Savings (\$/AF)* |
|---------------------|---------------------------|------------------------|
| Commercial Kitchens | \$1,080 | \$370 |

*Rounded to nearest \$10. Average cost per rebate or AF based on expected mix of devices rebated.

| Year | Annual Program Cost |
|-----------------------|---------------------|
| 2011 | \$ 0 |
| 2012 | \$ 0 |
| 2013 | \$ 0 |
| 2014 | \$7,700 |
| 2015 | \$7,700 |
| Five-Year Cost | \$15,400 |

*Annual cost rounded to nearest \$100.

WATER SAVINGS

Fixture and Program Savings: Projected annual and lifetime water savings per fixture and from program implementation are shown below.

| Customer Target | Unit Savings (gal/yr)* | Lifetime Savings (AF/Rebate) |
|---------------------|------------------------|------------------------------|
| Commercial Kitchens | 113,300 | 3.5 |

*Rounded to nearest 100 gallons. Average for expected mix of devices rebated.

| Year | Water Savings (AF) |
|--------------------------------|--------------------|
| 2011 | 0.0 |
| 2012 | 0.0 |
| 2013 | 0.0 |
| 2014 | 2.5 |
| 2015 | 4.9 |
| Five-Year Total Savings | 7.4 |

Appendix 2

Conservation Program Modeling Assumptions and Results

Table A- 1. Selma District Minimum Activity Level Constraints

| Activity ID | Activity Name | Customer Class | 2011 | 2012 | 2013 | 2014 | 2015 |
|-------------|--|----------------|------|------|------|------|------|
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | 18 | 18 | 18 | 18 | 18 |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | 10 | 10 | 10 | 10 | 10 |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | 9 | 9 | 9 | 9 | 9 |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | 50 | 50 | 50 | 50 | 50 |
| 5 | CW common: Cust Reb or Voucher | Multi Family | 1 | 1 | 1 | 1 | 1 |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | 5 | 5 | 5 | 5 | 5 |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | 0 | 0 | 0 | 0 | 0 |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | 0 | 0 | 0 | 0 | 0 |
| 9 | HE Toilets: Direct Install | Single Family | 50 | 50 | 50 | 50 | 50 |
| 10 | HE Toilets: Direct Install | Multi Family | 27 | 27 | 27 | 27 | 27 |
| 11 | HE Toilets: Direct Install | Commercial | 24 | 24 | 24 | 24 | 24 |
| 12 | Urinals: Direct Install | Commercial | 25 | 25 | 25 | 25 | 25 |
| 13 | Audits & Surveys (incl high bill contacts) | Single Family | 50 | 50 | 50 | 50 | 50 |
| 14 | Audits & Surveys (incl high bill contacts) | Multi Family | 11 | 11 | 11 | 11 | 11 |
| 15 | Audits & Surveys (incl high bill contacts) | Commercial | 0 | 0 | 0 | 0 | 0 |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | 825 | 825 | 825 | 825 | 825 |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | 138 | 138 | 138 | 138 | 138 |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | 138 | 138 | 138 | 138 | 138 |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | 100 | 100 | 100 | 100 | 100 |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | 6 | 6 | 6 | 6 | 6 |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | 0 | 0 | 0 | 0 | 0 |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | 0 | 0 | 0 | 0 | 0 |
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | 0 | 0 | 0 | 0 | 0 |
| 24 | Large Landscape Water Use Reports | Irrigation | 25 | 25 | 25 | 40 | 40 |
| 25 | Lg Lndscp Surveys & Irrig Sys: Rebates | Irrigation | 1 | 1 | 1 | 1 | 1 |
| 26 | Comm Irrigation System: Rebates | Commercial | 1 | 1 | 1 | 1 | 1 |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | 0 | 0 | 0 | 1 | 1 |
| 28 | Food Steamers: Cust Rebates | Commercial | 0 | 0 | 0 | 1 | 1 |
| 29 | Ice Machines: Cust Rebates | Commercial | 0 | 0 | 0 | 2 | 2 |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | 0 | 0 | 0 | 2 | 2 |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | 0 | 0 | 0 | 0 | 0 |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | 0 | 0 | 0 | 0 | 0 |
| 33 | Industrial Process: Audits & Incentives | Industrial | 0 | 0 | 0 | 0 | 0 |

Table A- 2. Selma District Maximum Activity Level Constraints

| Activity ID | Activity Name | Customer Class | 2011 | 2012 | 2013 | 2014 | 2015 |
|-------------|--|----------------|-------|-------|-------|-------|-------|
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | 74 | 74 | 74 | 111 | 111 |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | 40 | 40 | 40 | 60 | 60 |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | 36 | 36 | 36 | 53 | 53 |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | 236 | 236 | 236 | 236 | 236 |
| 5 | CW common: Cust Reb or Voucher | Multi Family | 5 | 5 | 5 | 5 | 5 |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | 21 | 21 | 21 | 21 | 21 |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | 0 | 0 | 0 | 0 | 0 |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | 0 | 0 | 0 | 0 | 0 |
| 9 | HE Toilets: Direct Install | Single Family | 100 | 100 | 100 | 100 | 100 |
| 10 | HE Toilets: Direct Install | Multi Family | 40 | 40 | 40 | 60 | 60 |
| 11 | HE Toilets: Direct Install | Commercial | 36 | 36 | 36 | 53 | 53 |
| 12 | Urinals: Direct Install | Commercial | 116 | 116 | 116 | 116 | 116 |
| 13 | Audits & Surveys (incl high bill contacts) | Single Family | 100 | 100 | 100 | 121 | 121 |
| 14 | Audits & Surveys (incl high bill contacts) | Multi Family | 33 | 33 | 33 | 50 | 50 |
| 15 | Audits & Surveys (incl high bill contacts) | Commercial | 2 | 2 | 2 | 2 | 2 |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | 2,475 | 2,475 | 2,475 | 2,475 | 2,475 |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | 412 | 412 | 412 | 412 | 412 |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | 412 | 412 | 412 | 412 | 412 |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | 125 | 125 | 125 | 125 | 125 |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | 13 | 13 | 13 | 13 | 13 |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | 80 | 80 | 80 | 80 | 80 |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | 30 | 30 | 30 | 30 | 30 |
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | 1 | 1 | 1 | 1 | 1 |
| 24 | Large Landscape Water Use Reports | Irrigation | 40 | 40 | 40 | 40 | 40 |
| 25 | Lg Lndscp Surveys & Irrig Sys: Rebates | Irrigation | 2 | 2 | 2 | 2 | 2 |
| 26 | Comm Irrigation System: Rebates | Commercial | 2 | 2 | 2 | 2 | 2 |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | 0 | 0 | 0 | 2 | 2 |
| 28 | Food Steamers: Cust Rebates | Commercial | 0 | 0 | 0 | 4 | 4 |
| 29 | Ice Machines: Cust Rebates | Commercial | 0 | 0 | 0 | 9 | 9 |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | 0 | 0 | 0 | 8 | 8 |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | 0 | 0 | 0 | 0 | 0 |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | 0 | 0 | 0 | 0 | 0 |
| 33 | Industrial Process: Audits & Incentives | Industrial | 0 | 0 | 0 | 0 | 0 |

Table A- 3. Selma District Program Savings and Cost Assumptions

| Activity ID | Activity Name | Customer Class | Unit Savings (gal/yr) | Useful Life (yrs) | Free Riders (%) | Unit Costs (\$) | Annual Natural Replacement Rate (%) |
|-------------|--|----------------|---|-------------------|-----------------|--|-------------------------------------|
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | 8,788 ----- Based on toilet savings formula in CUWCC Costs & Savings Study. Varies with persons per household. Assumes that replaced toilets are 25% ULFTs, 75% non ULFTs. | 25 | | \$140.00 ----- \$100 rebate + \$40 administration | 4.00% |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | 15,853 ----- Based on toilet savings formula in CUWCC Costs & Savings Study. Varies with persons per household. Assumes that replaced toilets are 25% ULFTs, 75% non ULFTs. | 25 | | \$125.00 ----- \$100 rebate + \$25 administration | 4.00% |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | 10,261 ----- CUWCC CII Toilet Savings Study and Zip Code Toilet Inventory. Assumes 25% of replaced toilets are ULFTs and 75% are not ULFTs. | 25 | | \$240.00 ----- \$200 rebate + \$40 administration | 4.00% |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | 7,079 ----- CUWCC Cost and Savings Study, revised 2005. | 12 | 20% | \$165.00 ----- \$125 rebate + \$40 administration | 4.00% |
| 5 | CW Common: Cust Reb or Voucher | Multi Family | 25,310 ----- Alliance for Water Efficiency Guide, p. 136. | 8 | | \$440.00 ----- \$400 rebate + \$40 administration | 4.17% |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | 5,244 ----- CUWCC Cost and Savings Study, revised 2005. | 12 | 20% | \$165.00 ----- \$125 rebate + \$40 administration | 4.17% |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | 31,435 ----- Alliance for Water Efficiency Guide, p. 159. | 8 | | \$440.00 ----- \$400 rebate + \$40 administration | 4.17% |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | 9,310 ----- Savings estimate for 0.5 gpf urinal from Alliance for Water Efficiency Library. Savings for 0.25 gpf urinal is 1.5 x the AWE figure. | 25 | | \$340.00 ----- \$300 rebate + \$40 administration | 4.00% |
| 9 | HE Toilets: Direct Install | Single Family | 10,472 ----- Based on toilet savings formula in CUWCC Costs & Savings Study. Varies with persons per household. Based on Cal Water's existing direct install program, assumes that replaced toilets are 10% ULFTs, 50% 5 gpf and 40% 3.5 gpf. | 25 | | \$384.50 ----- Based on Cal Water program experience. | 4.00% |
| 10 | HE Toilets: Direct Install | Multi Family | 18,891 ----- Based on toilet savings formula in CUWCC Costs & Savings Study. Varies with persons per household. Based on Cal Water's existing direct install program, assumes that replaced toilets are 10% ULFTs, 50% 5 gpf and 40% 3.5 gpf. | 25 | | \$254.50 ----- Based on Cal Water program experience. | 4.00% |
| 11 | HE Toilets: Direct Install | Commercial | 12,228 ----- Based on toilet savings formula in CUWCC Costs & Savings Study. Varies with persons per household. Based on Cal Water's existing direct install program, assumes that replaced toilets are 10% ULFTs, 50% 5 gpf and 40% 3.5 gpf. | 25 | | \$479.50 ----- Based on Cal Water program experience. | 4.00% |
| 12 | Urinals: Direct Install | Commercial | 6,207 ----- Alliance for Water Efficiency Library. | 25 | | \$224.50 ----- Based on experience of other water utilities. | 4.00% |

Selma District Conservation Master Plan: 2011-2015

| | | | | | | | |
|----|---|---------------|---|----|--|---|--------|
| 13 | Audits & Surveys | Single Family | 11,753 ----- Chesnut, T.W., C. N. McSpadden, and D. M. Pekelney, "What is the Reliable Yield from Residential Home Water Survey Programs? The Experience of the Los Angeles Department of Water and Power", Proceedings of the American Water Works Association Conference in Anaheim, June 1995. | 5 | | \$201.50 ----- Whitcomb, J. Residential Water Survey Evaluation. Contra Costa Water District. May 2000 | |
| 14 | Audits & Surveys | Multi Family | 12,071 ----- Assumes 5% of per-acct usage | 5 | | \$54.59 ----- Based on \$56 per AF of annual per-acct usage. | |
| 15 | Audits & Surveys | Commercial | 198,573 ----- Based on AWWARF, <i>Water Use Efficiency in IRP</i> , pg 155-58. CII typical survey savings potential is around 15%. Assuming half of recommended conservation activities are completed, this results in 7.5% savings per audit. | 10 | | \$1,016.50 ----- Based on AWWARF, <i>Water Use Efficiency in IRP</i> , pg 155-58. | |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | 1,303 ----- Source: MWDSC Save Water - Save A Buck program assumptions. | 5 | | \$3.53 ----- \$3 per nozzle material cost + \$0.5 per nozzle marketing cost + \$0.03 per nozzle to cover fixed setup costs. | |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | 1,303 ----- Source: MWDSC Save Water - Save A Buck program assumptions. | 5 | | \$3.53 ----- \$3 per nozzle material cost + \$0.5 per nozzle marketing cost + \$0.03 per nozzle to cover fixed setup costs. | |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | 1,303 ----- Source: MWDSC Save Water - Save A Buck program assumptions. | 5 | | \$3.53 ----- \$3 per nozzle material cost + \$0.5 per nozzle marketing cost + \$0.03 per nozzle to cover fixed setup costs. | |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | 5,091 ----- Based on Cal Water program experience: 2.628 gpy showerhead 821 gpy kitchen aerator 1.642 gpy bathroom aerator | 5 | | \$29.00 ----- Based on Cal Water program experience: \$26 for kit + \$3 for marketing | 12.00% |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | 5,091 ----- Based on Cal Water program experience: 2.628 gpy showerhead 821 gpy kitchen aerator 1.642 gpy bathroom aerator | 5 | | \$29.00 ----- Based on Cal Water program experience: \$26 for kit + \$3 for marketing | 12.00% |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | 10,143 ----- Based on district-specific landscape savings model. | 10 | | \$460.00 ----- Required vendor incentive assumed to be less than estimated \$530 customer rebate. | |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | 17,800 ----- Based on district-specific landscape savings model. | 10 | | \$460.00 ----- Required vendor incentive assumed to be less than estimated \$530 customer rebate. | |

Selma District Conservation Master Plan: 2011-2015

| | | | | | | |
|----|---|------------|--|----|--|--|
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | 17,800 ----- Based on district-specific landscape savings model. | 10 | \$460.00 ----- Required vendor incentive assumed to be less than estimated \$530 customer rebate. | |
| 24 | Large Landscape Water Use Reports | Irrigation | 36,509 ----- Based on district-specific landscape savings model. | 1 | \$64.99 ----- Set up cost of \$142 amortized over 10 years, plus \$48/year report cost. | |
| 25 | Lg Lndscp Surveys & Irrig Sys: Rebates | Irrigation | 125,468 ----- Based on district-specific landscape savings model. | 5 | \$1,400.00 | |
| 26 | Comm Irrigation System: Rebates | Commercial | 62,734 ----- Based on district-specific landscape savings model. | 10 | \$515.00 | |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | 57,757 ----- Source: Alliance for Water Efficiency Library | 20 | \$330.00 ----- Source: Alliance for Water Efficiency Library. Incentive is half the cost difference between conventional and water-efficient machines. | |
| 28 | Food Steamers: Cust Rebates | Commercial | 81,407 ----- Source: MOU pp. 45-46. | 10 | \$2,411.00 ----- Half of average fixture cost from industry sources + marketing + admin cost | |
| 29 | Ice Machines: Cust Rebates | Commercial | 271,739 ----- Source: MOU pp. 45-46. | 10 | \$1,985.00 ----- Half of fixture cost in CUWCC PBMP Year 2 Report + admin + mktg | |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | 28,285 ----- Industry sources | 5 | \$110.00 ----- Half of estimated fixture cost + admin | |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | 336,129 ----- Source: MOU pp. 45-46. | 5 | \$1,000.00 ----- Based on Cal Water program experience. | |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | 1,296,502 ----- Source: MOU pp. 45-46. | 5 | \$3,810.00 ----- Industry data + admin costs | |
| 33 | Industrial Process: Audits & Incentives | Industrial | 325,851 ----- Activity levels and costs expressed relative to AF of savings. | 5 | \$1,282.80 ----- Based on experience of other water utilities. Includes cost of audit + rebate per AF savings | |

Table A- 4. Selma District Program Activity Levels

| Activity ID | Program | Class | Annual Activity Levels | | | | |
|-------------|--|---------------|------------------------|------|------|-------|-------|
| | | | 2011 | 2012 | 2013 | 2014 | 2015 |
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | 18 | 18 | 18 | 18 | 18 |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | 10 | 10 | 10 | 60 | 60 |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | 36 | 36 | 36 | 9 | 9 |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | 50 | 50 | 50 | 50 | 50 |
| 5 | CW common: Cust Reb or Voucher | Multi Family | 1 | 1 | 5 | 1 | 1 |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | 5 | 5 | 5 | 5 | 5 |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | 0 | 0 | 0 | 0 | 0 |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | 0 | 0 | 0 | 0 | 0 |
| 9 | HE Toilets: Direct Install | Single Family | 50 | 50 | 50 | 50 | 50 |
| 10 | HE Toilets: Direct Install | Multi Family | 27 | 27 | 27 | 27 | 27 |
| 11 | HE Toilets: Direct Install | Commercial | 36 | 36 | 36 | 24 | 24 |
| 12 | Urinals: Direct Install | Commercial | 25 | 25 | 25 | 25 | 25 |
| 13 | Audits & Surveys (incl high bill contacts) | Single Family | 50 | 50 | 50 | 50 | 50 |
| 14 | Audits & Surveys (incl high bill contacts) | Multi Family | 11 | 11 | 11 | 11 | 11 |
| 15 | Audits & Surveys (incl high bill contacts) | Commercial | 0 | 0 | 0 | 0 | 0 |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | 825 | 825 | 825 | 2,475 | 2,475 |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | 138 | 138 | 248 | 412 | 412 |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | 138 | 138 | 138 | 412 | 412 |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | 100 | 100 | 100 | 100 | 100 |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | 6 | 6 | 6 | 6 | 6 |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | 56 | 56 | 51 | 0 | 0 |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | 30 | 30 | 30 | 0 | 0 |
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | 1 | 1 | 1 | 0 | 0 |
| 24 | Large Landscape Water Use Reports | Irrigation | 25 | 25 | 25 | 40 | 40 |
| 25 | Lg Lndscp Surveys & Irrig Sys: Rebates | Irrigation | 1 | 1 | 1 | 1 | 1 |
| 26 | Comm Irrigation System: Rebates | Commercial | 1 | 1 | 1 | 1 | 1 |

Selma District Conservation Master Plan: 2011-2015

| Activity ID | Program | Class | Annual Activity Levels | | | | |
|-------------|---|------------|------------------------|------|------|------|------|
| | | | 2011 | 2012 | 2013 | 2014 | 2015 |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | 0 | 0 | 0 | 2 | 2 |
| 28 | Food Steamers: Cust Rebates | Commercial | 0 | 0 | 0 | 1 | 1 |
| 29 | Ice Machines: Cust Rebates | Commercial | 0 | 0 | 0 | 2 | 2 |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | 0 | 0 | 0 | 2 | 2 |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | 0 | 0 | 0 | 0 | 0 |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | 0 | 0 | 0 | 0 | 0 |
| 33 | Industrial Process: Audits & Incentives | Industrial | 0 | 0 | 0 | 0 | 0 |

Selma District Conservation Master Plan: 2011-2015

Table A- 5. Selma District Program Costs

| Activity ID | Program | Class | Annual Cost | | | | |
|-------------|--|---------------|-------------|----------|----------|----------|----------|
| | | | 2011 | 2012 | 2013 | 2014 | 2015 |
| 1 | HE Toilets: Cust Rebates or Vouchers | Single Family | \$2,570 | \$2,570 | \$2,570 | \$2,570 | \$2,570 |
| 2 | HE Toilets: Cust Rebates or Vouchers | Multi Family | \$1,234 | \$1,234 | \$1,234 | \$7,438 | \$7,438 |
| 3 | HE Toilets: Cust Rebates or Vouchers | Commercial | \$8,535 | \$8,535 | \$8,535 | \$2,105 | \$2,105 |
| 4 | Clotheswasher: Cust Reb or Voucher | Single Family | \$8,250 | \$8,250 | \$8,250 | \$8,250 | \$8,250 |
| 5 | CW common: Cust Reb or Voucher | Multi Family | \$579 | \$579 | \$2,317 | \$579 | \$579 |
| 6 | CW in-unit: Cust Reb or Voucher | Multi Family | \$886 | \$886 | \$886 | \$886 | \$886 |
| 7 | CW coin-op: Cust Reb or Voucher | Commercial | \$0 | \$0 | \$0 | \$0 | \$0 |
| 8 | Urinals (0.25 gpf): Cust Rebates or Vouchers | Commercial | \$0 | \$0 | \$0 | \$0 | \$0 |
| 9 | HE Toilets: Direct Install | Single Family | \$19,075 | \$19,075 | \$19,075 | \$19,075 | \$19,075 |
| 10 | HE Toilets: Direct Install | Multi Family | \$6,791 | \$6,791 | \$6,791 | \$6,791 | \$6,791 |
| 11 | HE Toilets: Direct Install | Commercial | \$17,052 | \$17,052 | \$17,052 | \$11,368 | \$11,368 |
| 12 | Urinals: Direct Install | Commercial | \$5,613 | \$5,613 | \$5,613 | \$5,613 | \$5,613 |
| 13 | Audits & Surveys (incl high bill contacts) | Single Family | \$10,075 | \$10,075 | \$10,075 | \$10,075 | \$10,075 |
| 14 | Audits & Surveys (incl high bill contacts) | Multi Family | \$601 | \$601 | \$601 | \$601 | \$601 |
| 15 | Audits & Surveys (incl high bill contacts) | Commercial | \$413 | \$413 | \$413 | \$413 | \$413 |
| 16 | High Efficiency Pop-Up Nozzle Web Voucher | Single Family | \$2,912 | \$2,912 | \$2,912 | \$8,737 | \$8,737 |
| 17 | High Efficiency Pop-Up Nozzle Web Voucher | Multi Family | \$485 | \$485 | \$877 | \$1,454 | \$1,454 |
| 18 | High Efficiency Pop-Up Nozzle Web Voucher | Commercial | \$485 | \$485 | \$485 | \$1,454 | \$1,454 |
| 19 | Showerhead/Aerator,Tablet Kit Dist | Single Family | \$2,900 | \$2,900 | \$2,900 | \$2,900 | \$2,900 |
| 20 | Showerhead/Aerator,Tablet Kit Dist | Multi Family | \$187 | \$187 | \$187 | \$187 | \$187 |
| 21 | WBIC Vendor, Dist, & Cont Inc | Single Family | \$25,597 | \$25,597 | \$23,467 | \$0 | \$0 |
| 22 | WBIC Vendor, Dist, & Cont Inc | Multi Family | \$13,800 | \$13,800 | \$13,800 | \$0 | \$0 |
| 23 | WBIC Vendor, Dist, & Cont Inc | Commercial | \$460 | \$460 | \$460 | \$34 | \$34 |
| 24 | Large Landscape Water Use Reports | Irrigation | \$1,625 | \$1,625 | \$1,625 | \$2,600 | \$2,600 |
| 25 | Lg Lndscp Surveys & Irrig | Irrigation | \$1,400 | \$1,400 | \$1,400 | \$1,400 | \$1,400 |

Selma District Conservation Master Plan: 2011-2015

| Activity ID | Program | Class | Annual Cost | | | | |
|-------------|---|------------|-------------|-------|-------|---------|---------|
| | | | 2011 | 2012 | 2013 | 2014 | 2015 |
| | Sys: Rebates | | | | | | |
| 26 | Comm Irrigation System: Rebates | Commercial | \$276 | \$276 | \$276 | \$276 | \$276 |
| 27 | Dishwashers: Vendor, Dist & Cont Inc | Commercial | \$0 | \$0 | \$0 | \$682 | \$682 |
| 28 | Food Steamers: Cust Rebates | Commercial | \$0 | \$0 | \$0 | \$2,411 | \$2,411 |
| 29 | Ice Machines: Cust Rebates | Commercial | \$0 | \$0 | \$0 | \$3,970 | \$3,970 |
| 30 | Pre-Rinse Spray Valves: Cust rebates | Commercial | \$0 | \$0 | \$0 | \$220 | \$220 |
| 31 | Cooling Tower Cond Cont: Cust Reb, Inc | Industrial | \$0 | \$0 | \$0 | \$0 | \$0 |
| 32 | Cooling Tower pH Cont: Cust Reb, Inc | Industrial | \$0 | \$0 | \$0 | \$0 | \$0 |
| 33 | Industrial Process: Audits & Incentives | Industrial | \$0 | \$0 | \$0 | \$0 | \$0 |