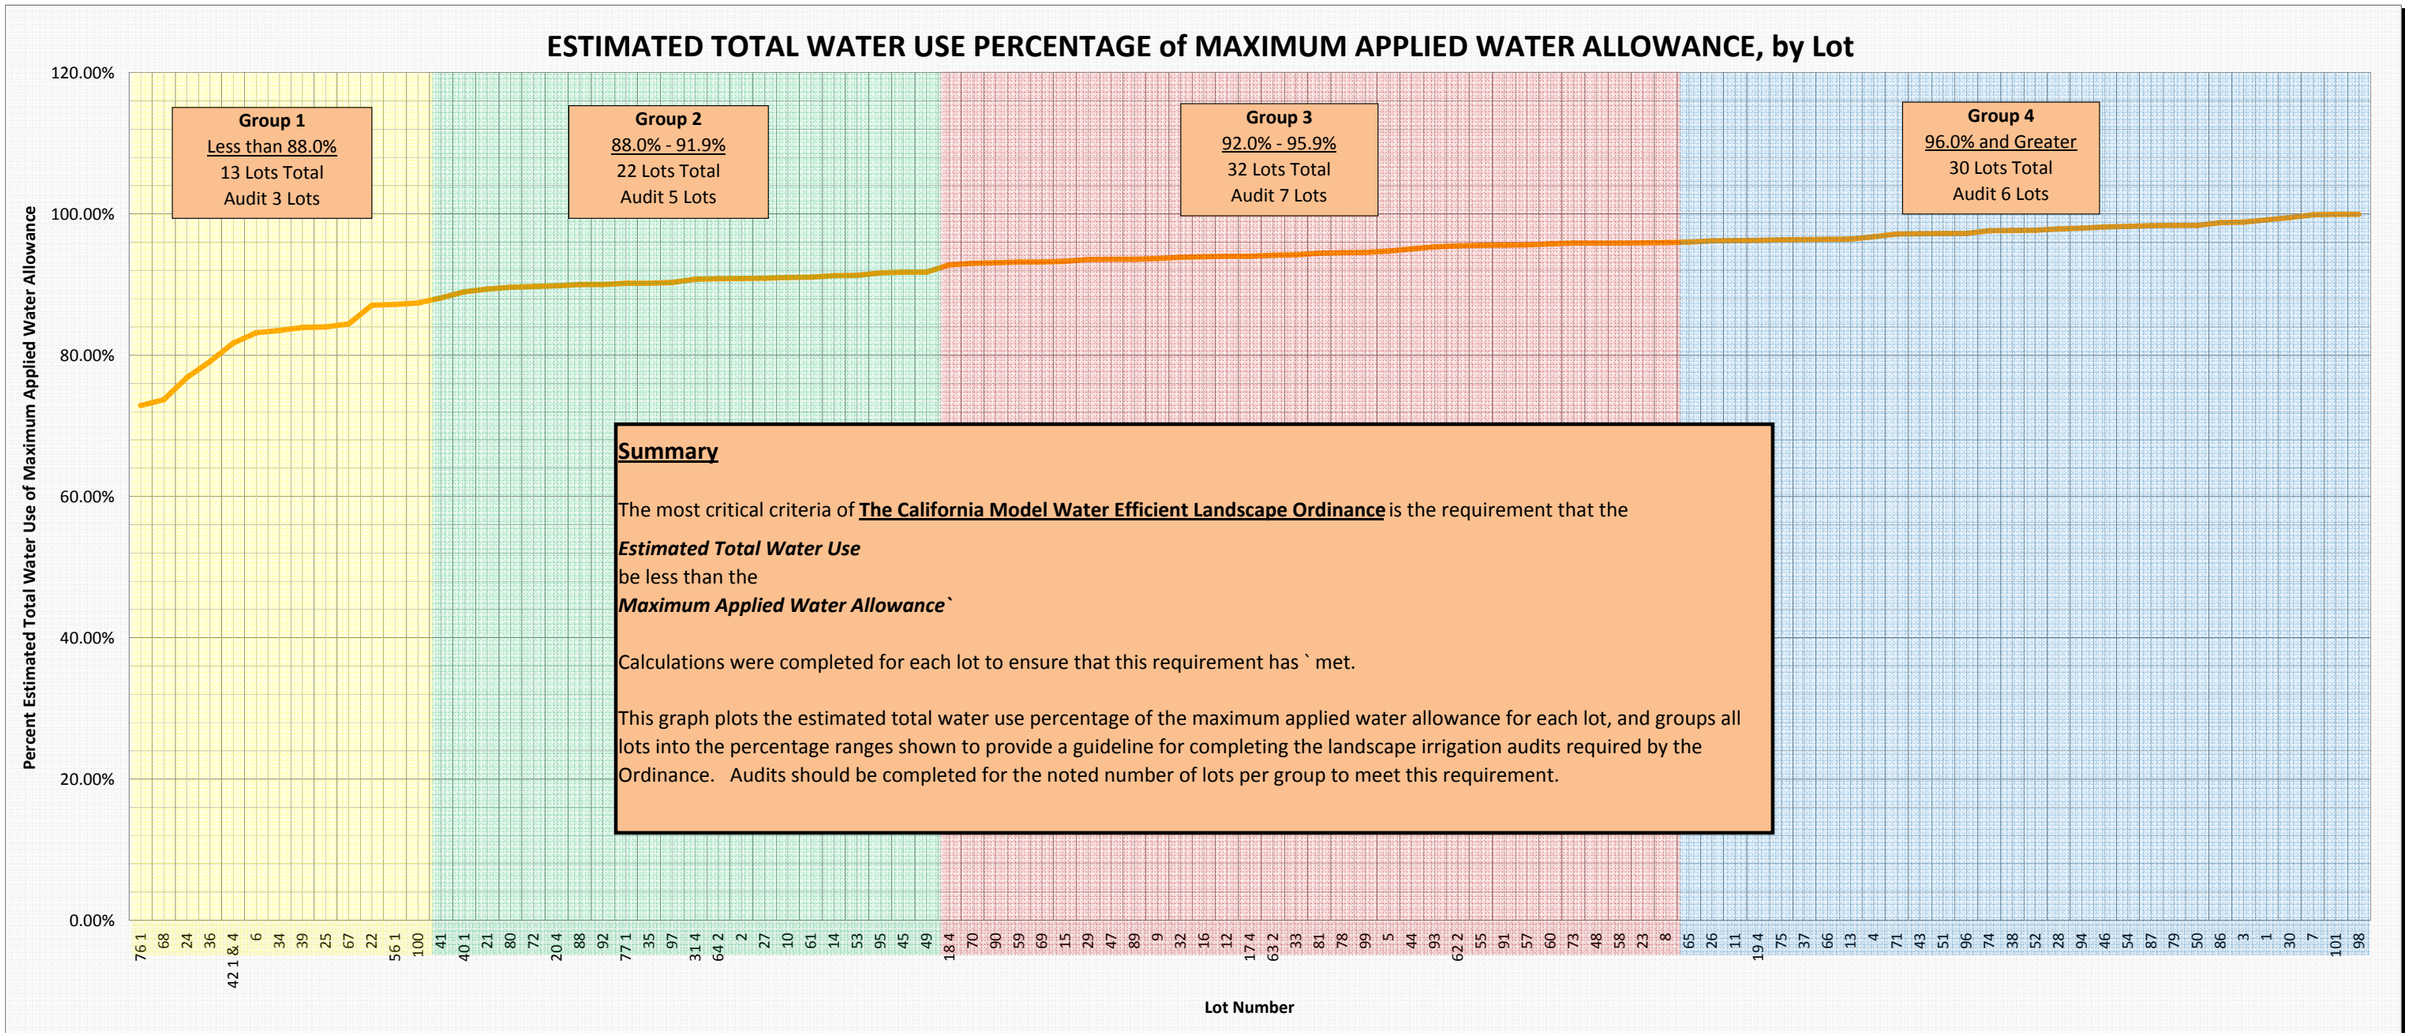
ESTIMATED TOTAL WATER USE PERCENTAGE of MAXIMUM APPLIED WATER ALLOWANCE, by Lot
Percent Estimated Total Water Use of Maximum Applied Water Allowance
120.00%
100.00%
80.00%
60.00%
40.00%
20.00%
0.00%
Group 1
Less than 88.0%
13 Lots Total
Audit 3 Lots
Group 2
88.0% - 91.9%
22 Lots Total
Audit 5 Lots
Group 3
92.0% - 95.9%
32 Lots Total
Audit 7 Lots
Group 4
96.0% and Greater
30 Lots Total
Audit 6 Lots
Summary
The most critical criteria of The California Model Water Efficient Landscape Ordinance is the requirement that the
Estimated Total Water Use
be less than the
Maximum Applied Water Allowance`
Calculations were completed for each lot to ensure that this requirement has ` met.
This graph plots the estimated total water use percentage of the maximum applied water allowance for each lot, and groups all lots into the percentage ranges shown to provide a guideline for completing the landscape irrigation audits required by the Ordinance. Audits should be completed for the noted number of lots per group to meet this requirement.
76 1 68 24 36 42 1 & 4 6 34 39 25 67 22 56 1 100
41 40 1 21 80 72 20 4 88 92 77 1 35 97 31 4 64 2 2 27 10 61 14 53 95 45 49
18 4 70 90 59 69 15 29 47 89 9 32 16 12 17 4 63 2 33 81 78 99 5 44 93 62 2 55 91 57 60 73 48 58 23 8
65 26 11 19 4 75 37 66 13 4 71 43 51 96 74 38 52 28 94 46 54 87 79 50 86 3 1 30 7 101 98
Lot Number